
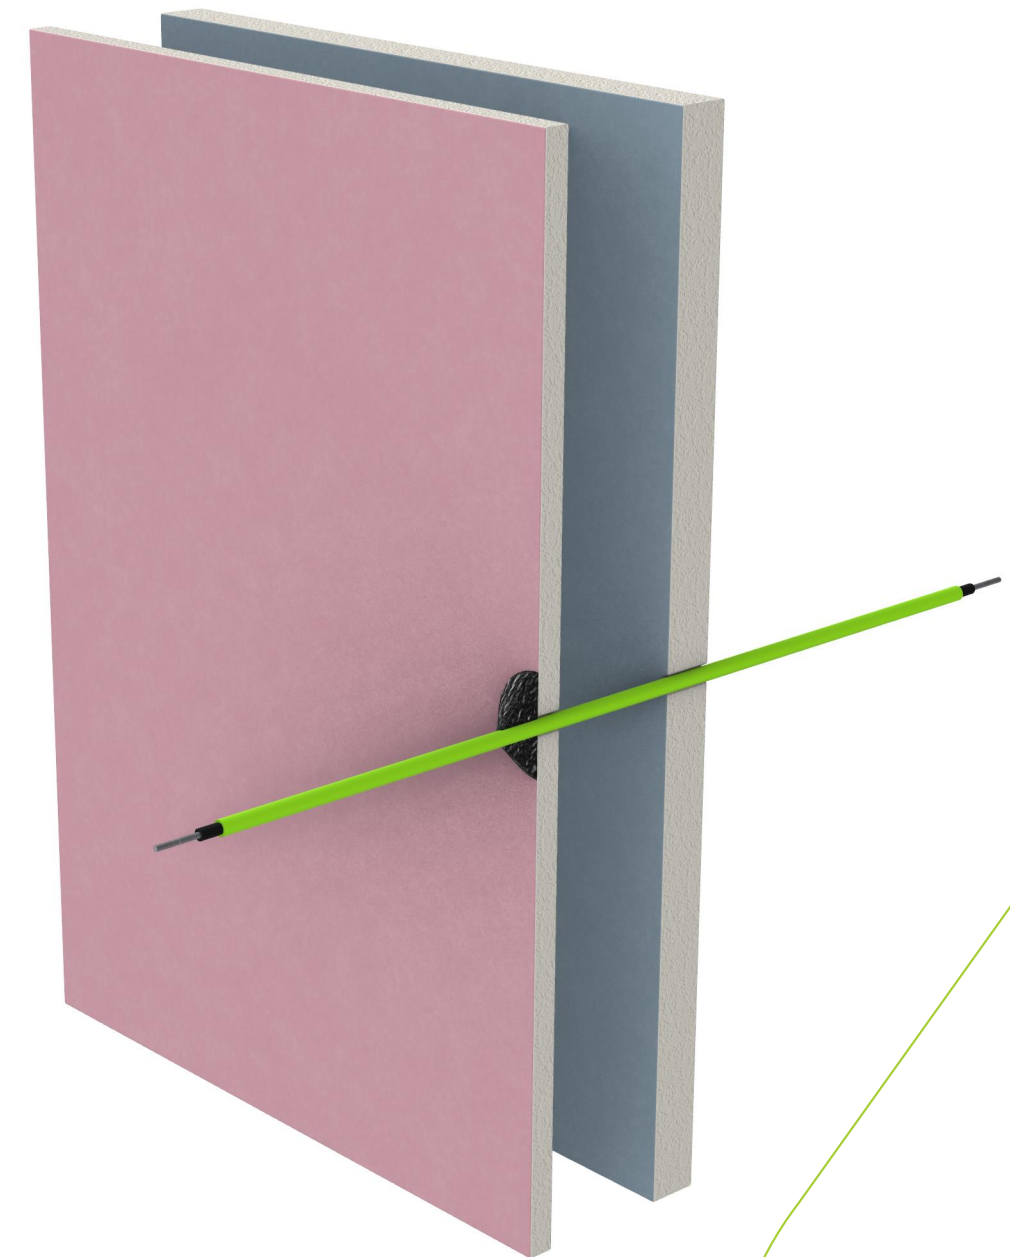


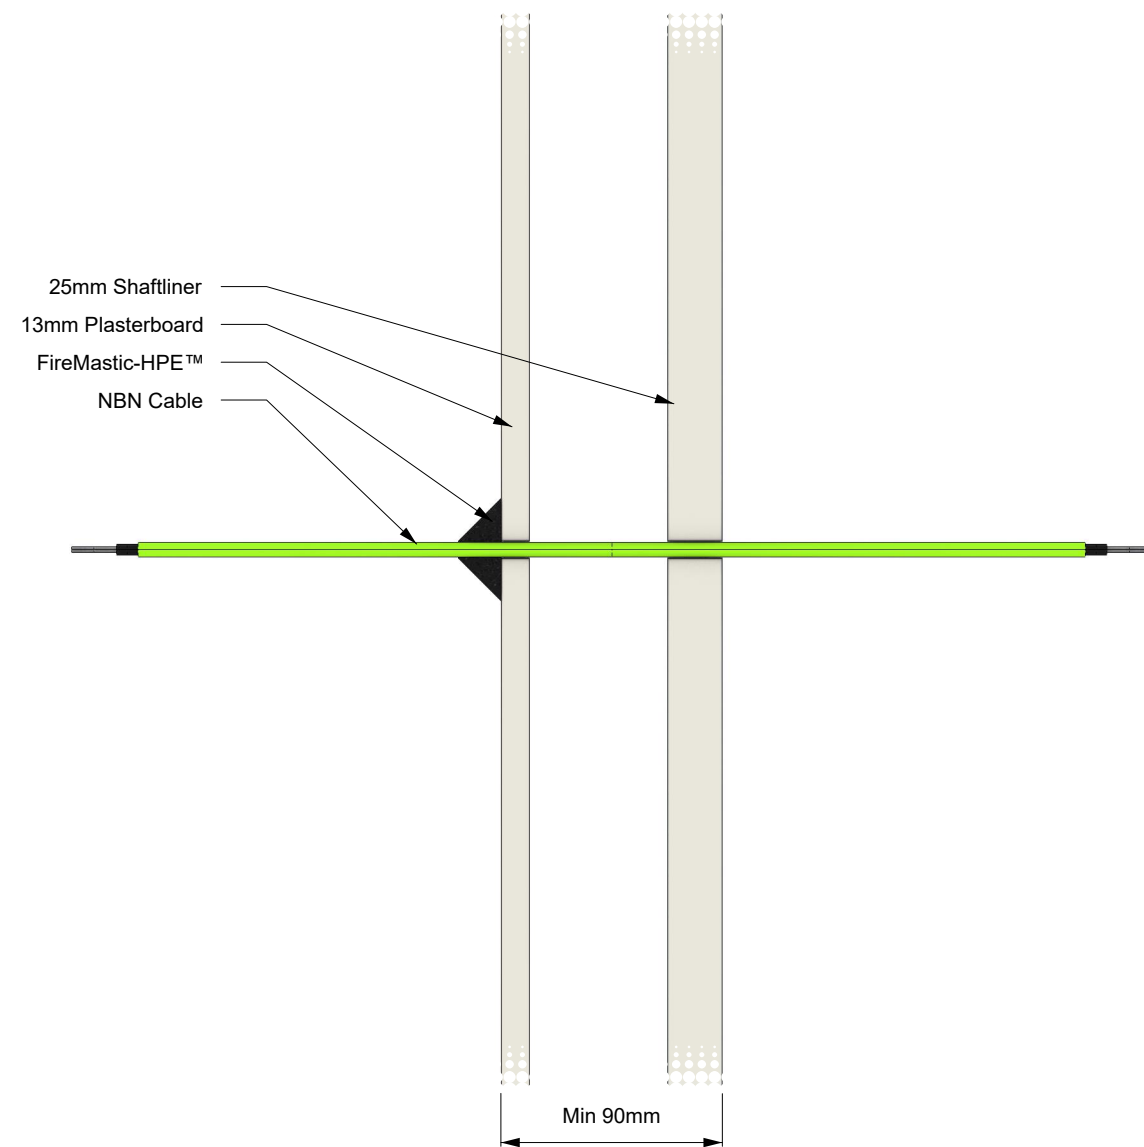

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Single core 5 mm OD NBN cable. 20 mm × 20 mm fillet on non-exposed side only OR exposed side only.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Fibre Optic / NBN	-	-		Report Reference:		WF FAS 190335	
Substrate:	Shaftliner	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2003.12	
Min Substrate Thickness (mm):	90	8	1.5		Date:	25/11/24	Rev:	01
Sealant Depth (mm):	0	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	20	The sealant can be installed on either side of the system						
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							