
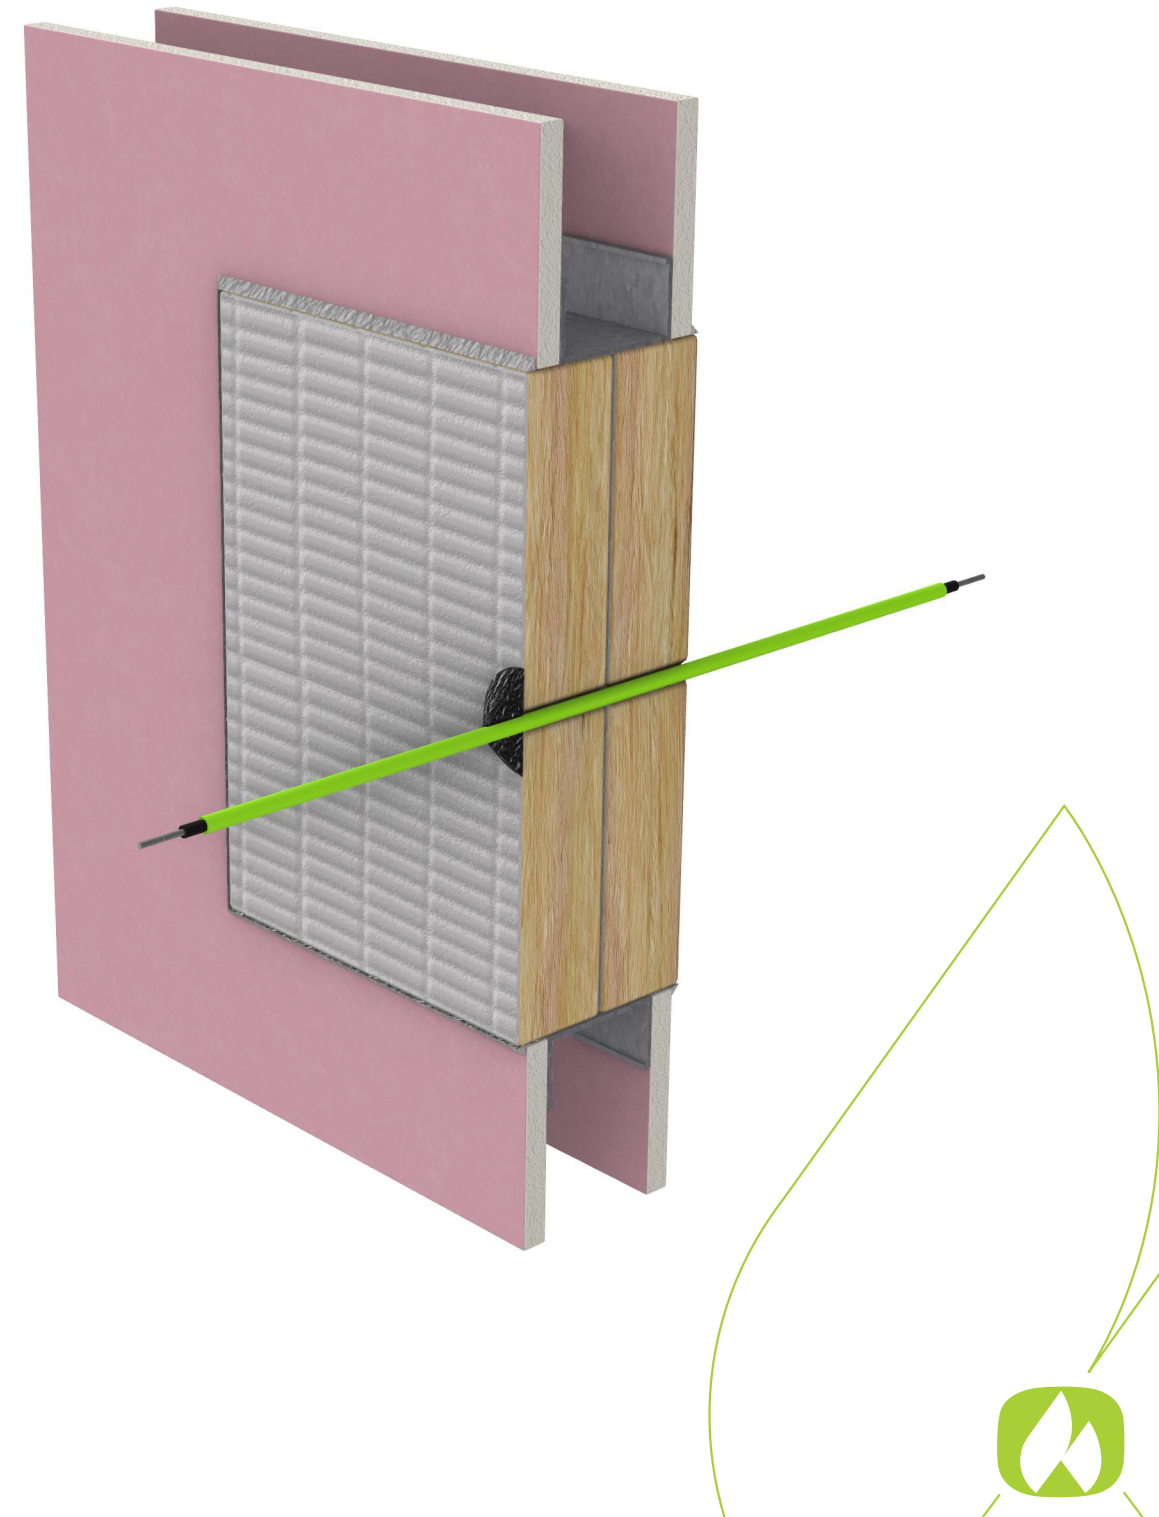


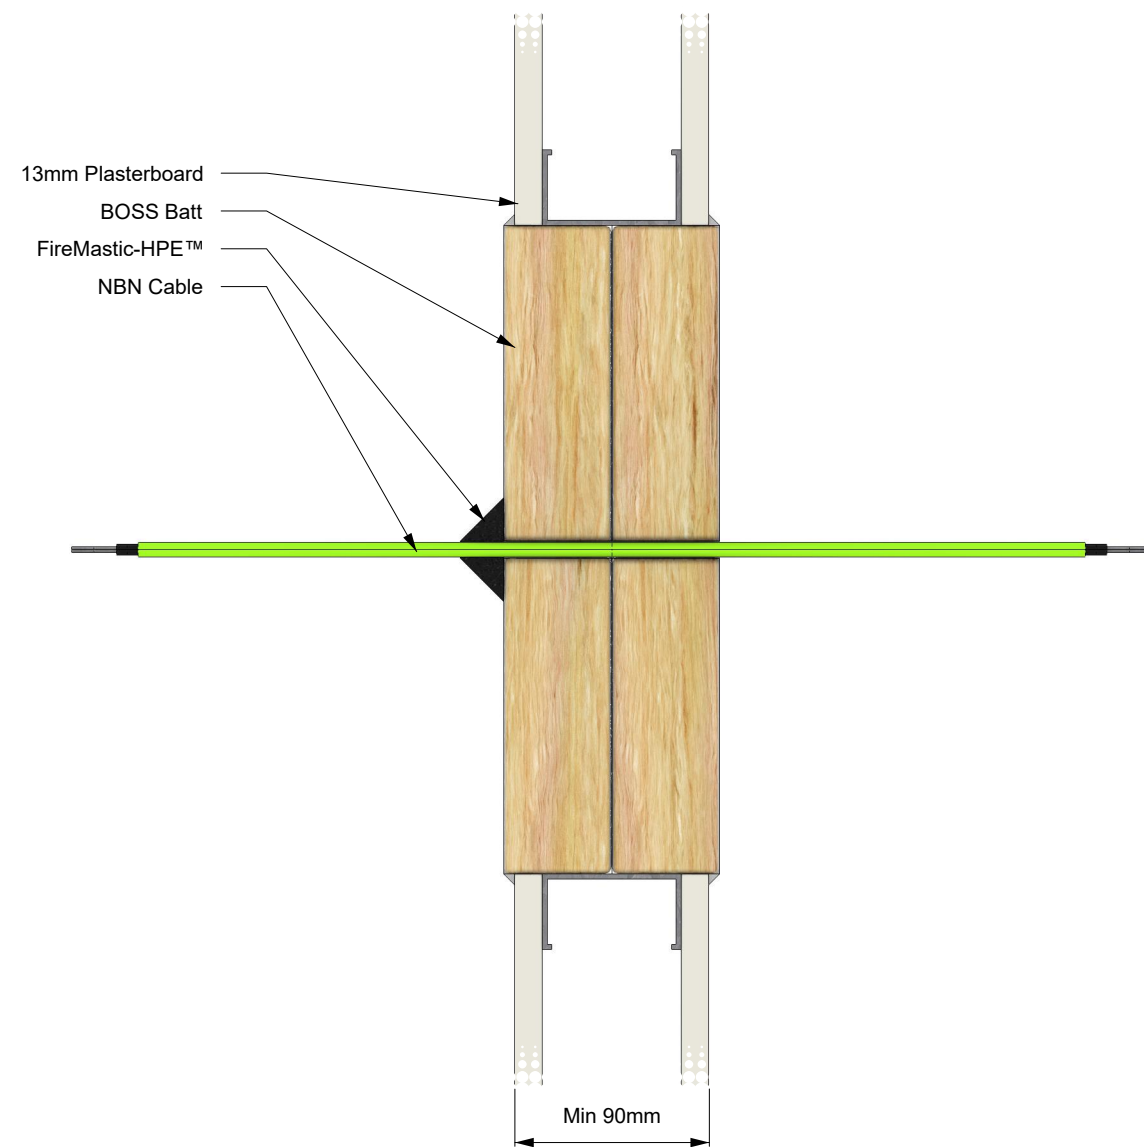

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Single core 5 mm OD NBN cable. 20 mm × 20 mm fillet on non-exposed side only OR exposed side only.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Fibre Optic / NBN	-	-		Report Reference:		WF FAS 190335	
Substrate:	2 layers BOSS Batt - Friction fitted	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2003.13	
Min Substrate Thickness (mm):	90	8	1.5		Date:		25/11/24	Rev:
Sealant Depth (mm):	0	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	20	The sealant can be installed on either side of the system						
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.