
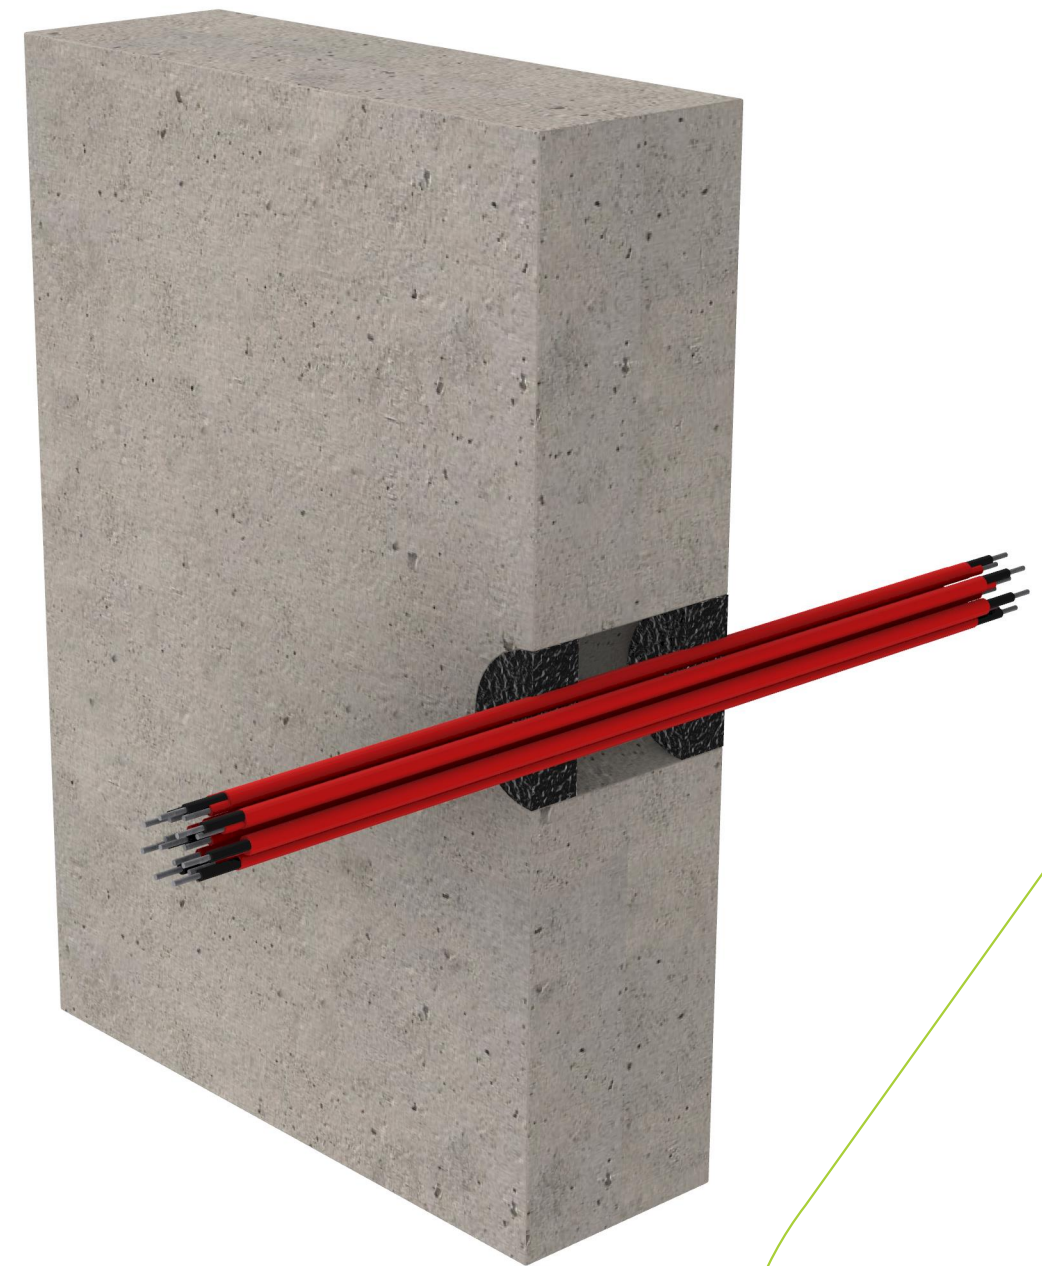


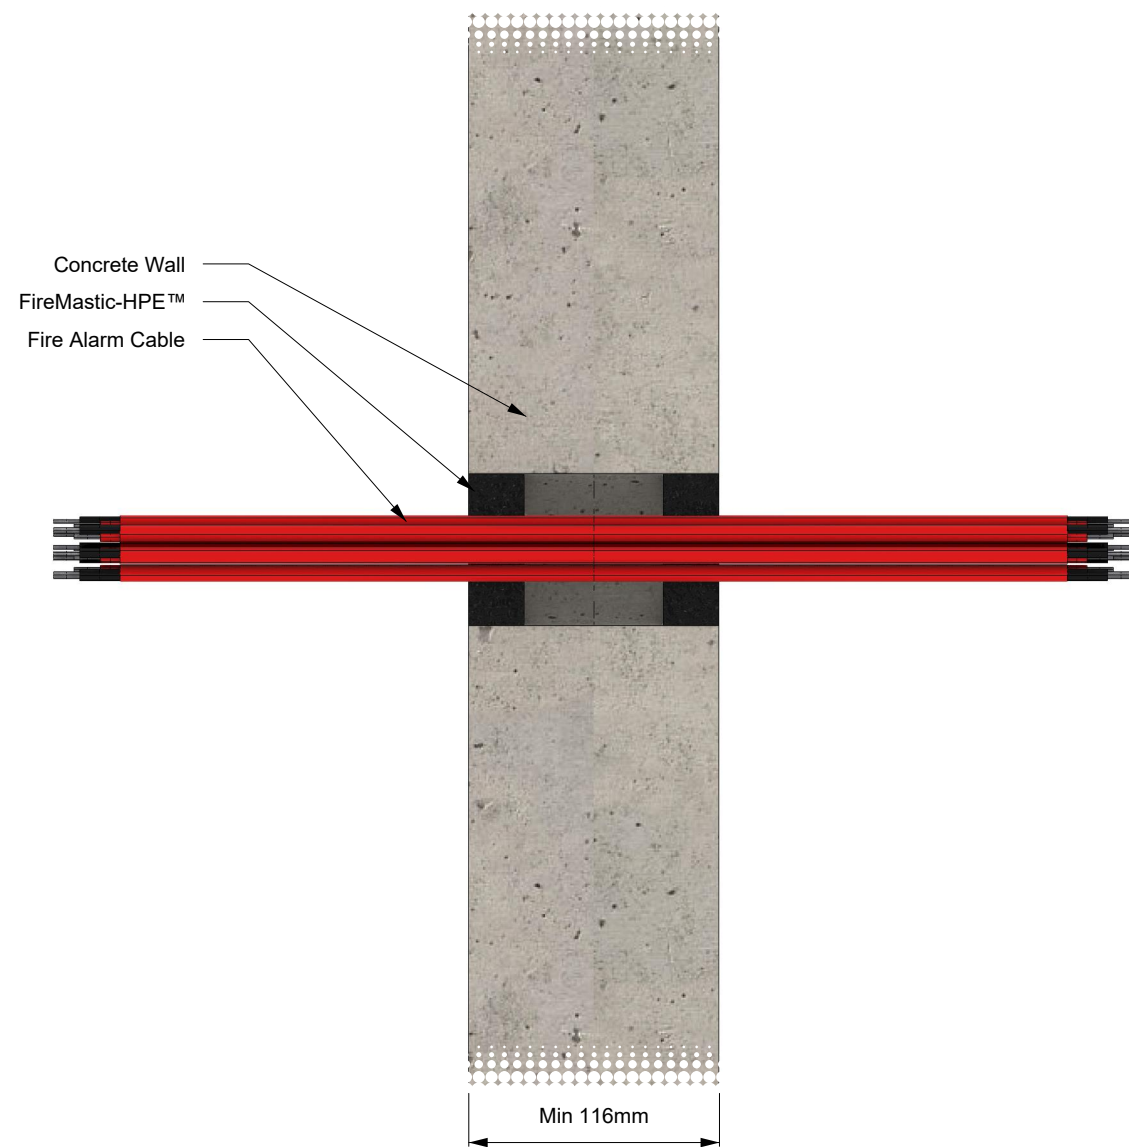

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS		SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Bundle of 8 Fire Alarm Cables - 2C x 1.5 mm² - Approx Dia ea 10.3 mm.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005		
Service:	Fire Alarm	-	-		Report Reference:		WF FAS 190335		
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2004.4		
Min Substrate Thickness (mm):	116	70	15		Date:	25/11/24	Rev:	01	
Sealant Depth (mm):	26	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	0								
Wrap Length (mm):	-								
FRL / FRR:	-/120/120								

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.