
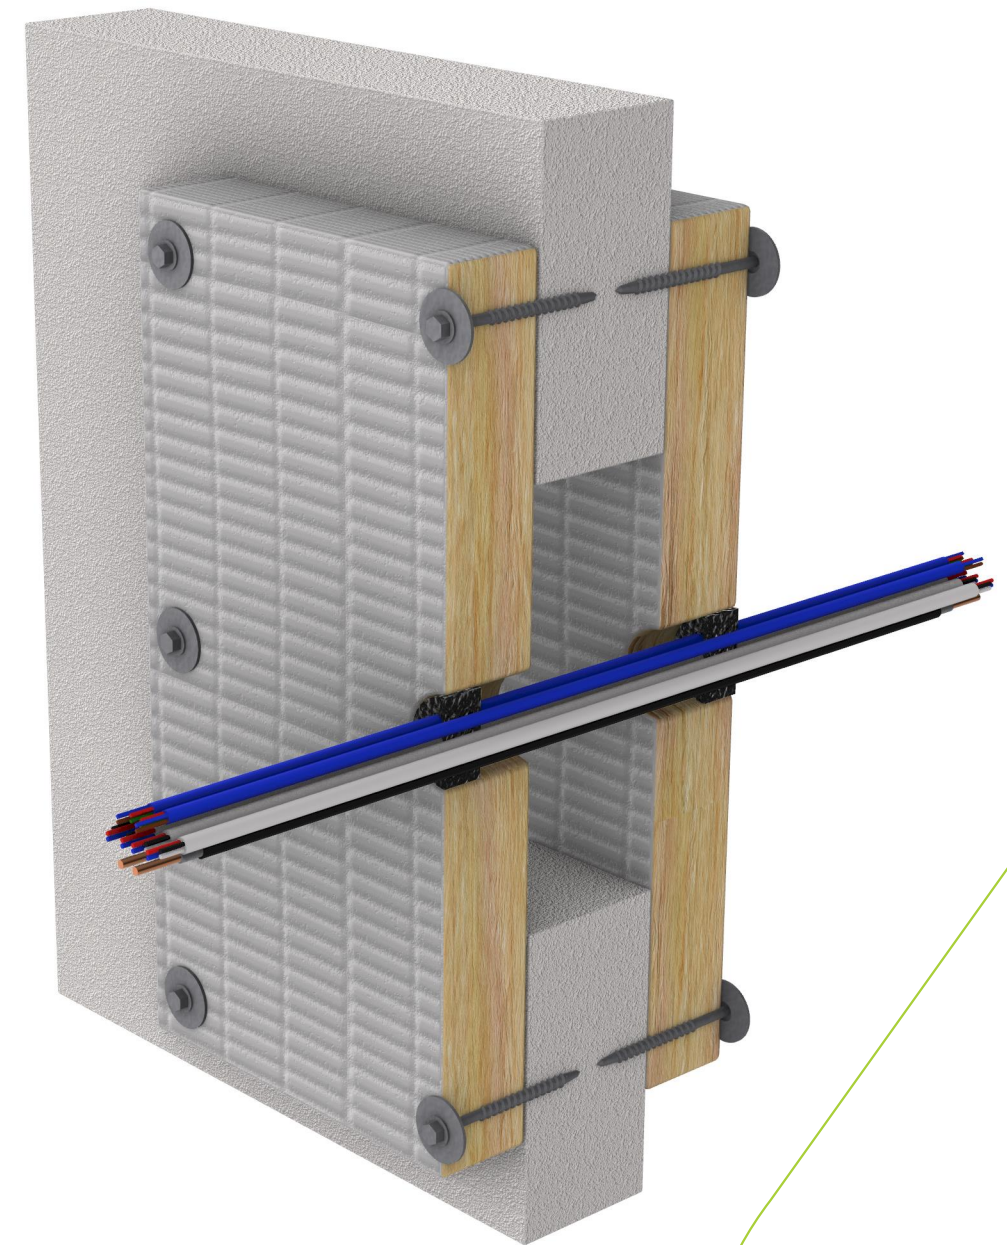


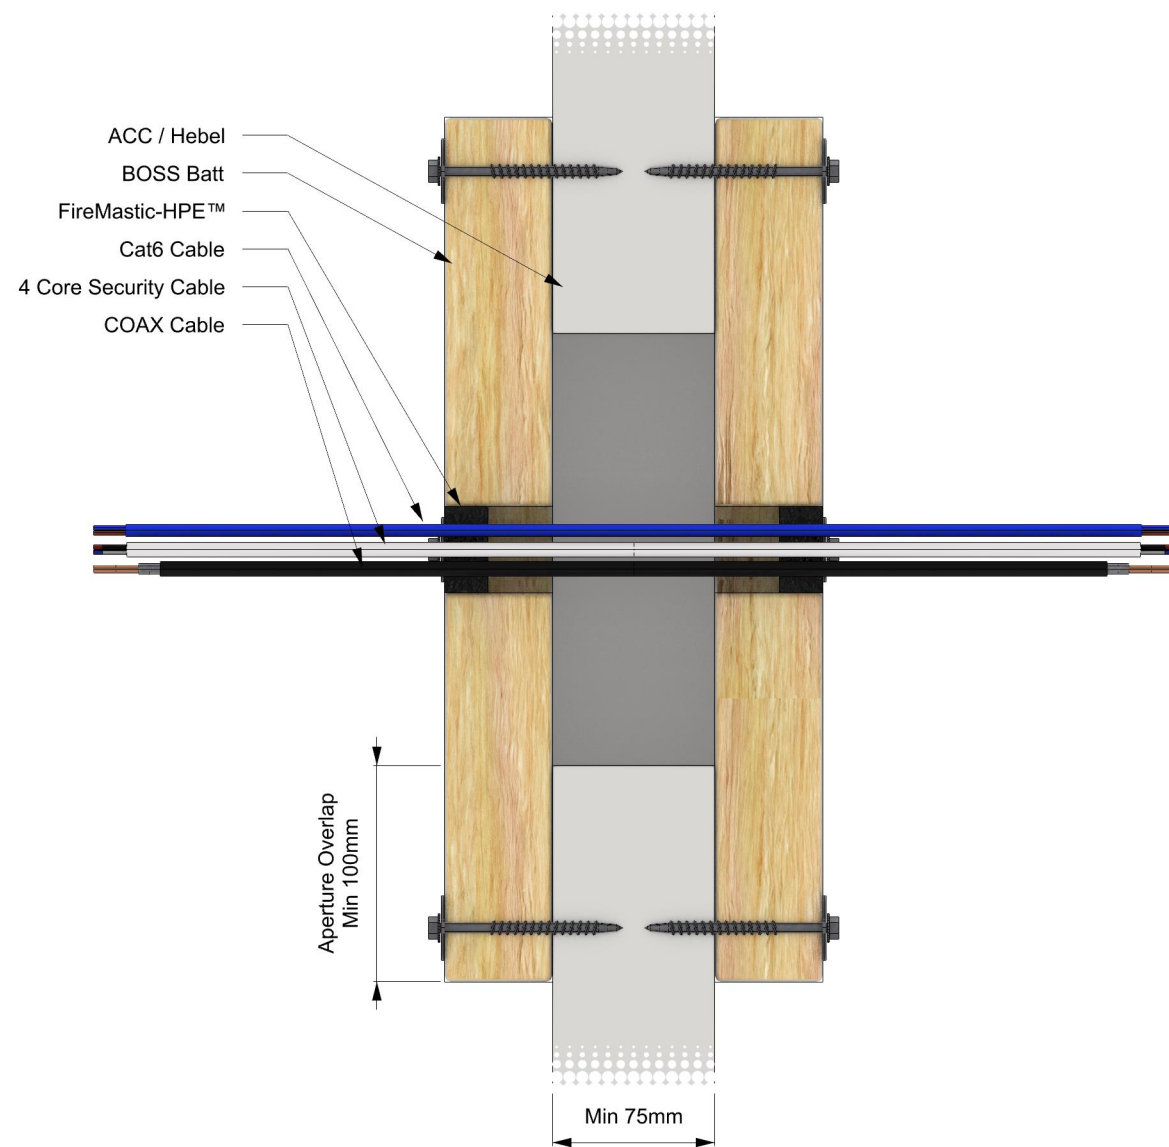

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 2 x RG6 Coax cables Up to 2 x CAT6 cables, Up to 2 x 4 core security security cable (7/0.20mm) Up to 6 of any type of the above listed cables. Sealant to a depth of 20 mm in annular gap and finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Mixed Comms Bundle	-	-		Report Reference:		WF FAS 190335	
Substrate:	2 layers BOSS Batt - Pattress fitted either side	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2011.14	
Min Substrate Thickness (mm):	75	40	-		Date:	26/11/24	Rev:	01
Sealant Depth (mm):	20	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.