
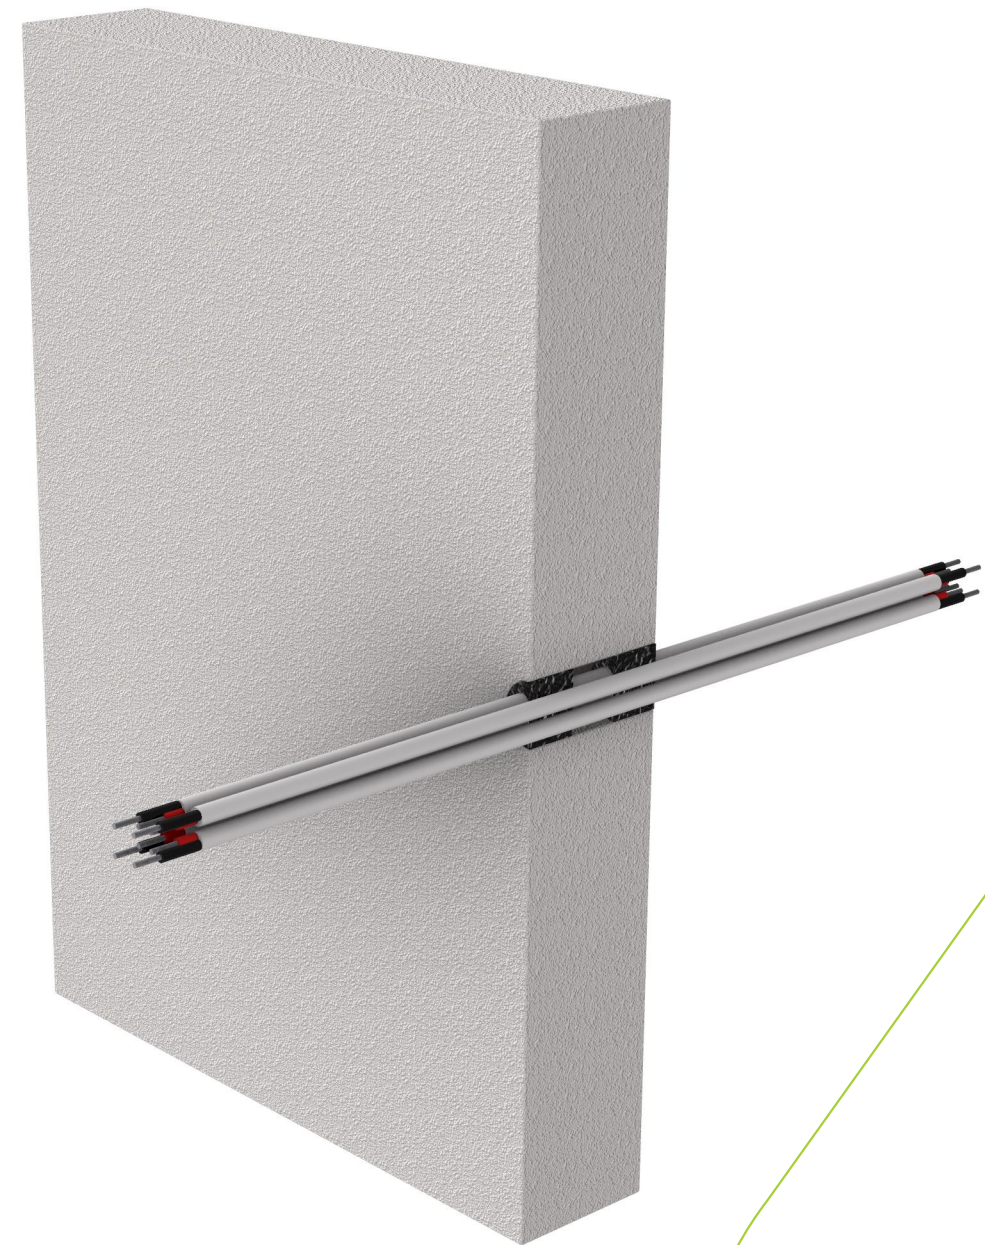


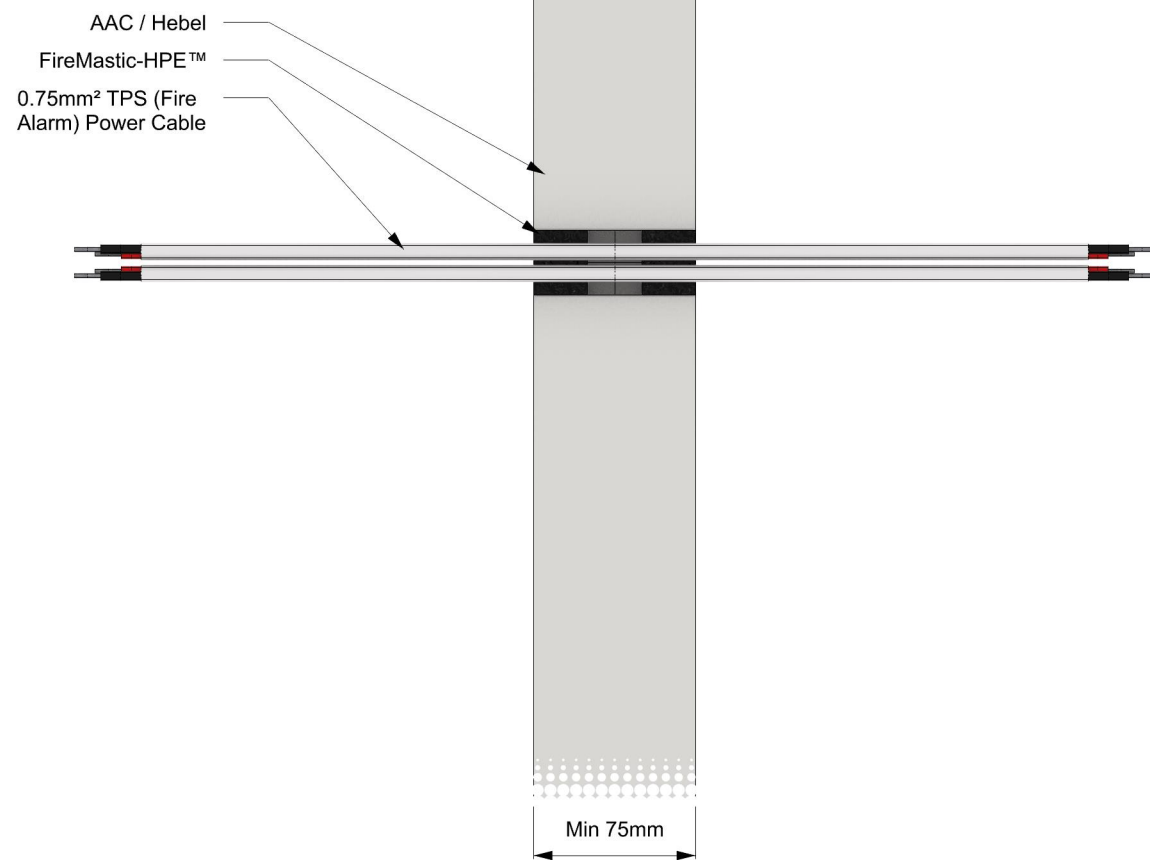

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 4 x 0.75 mm² TPS (Fire Alarm) Power Cables. Sealant to a depth of 25 mm in annular gap and finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Fire Alarm	-	-		Report Reference:		WF FAS 190335	
Substrate:	AAC / Hebel	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2014.7	
Min Substrate Thickness (mm):	75	30	-		Date:	26/11/24	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							