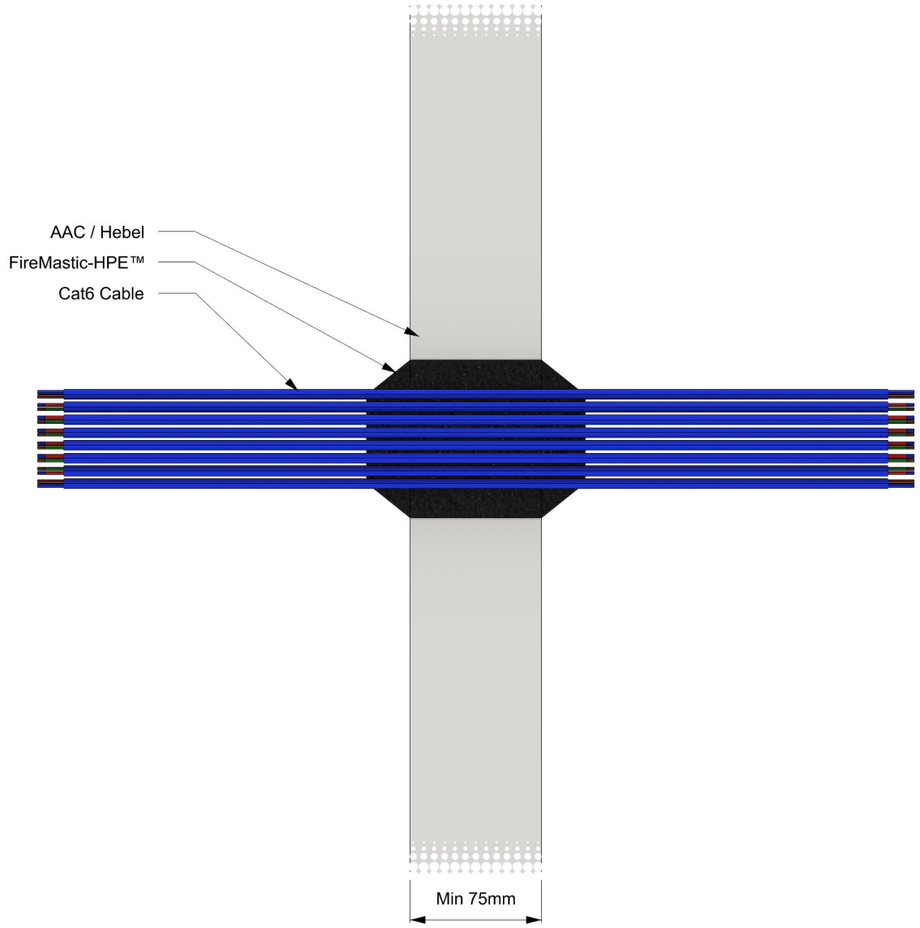

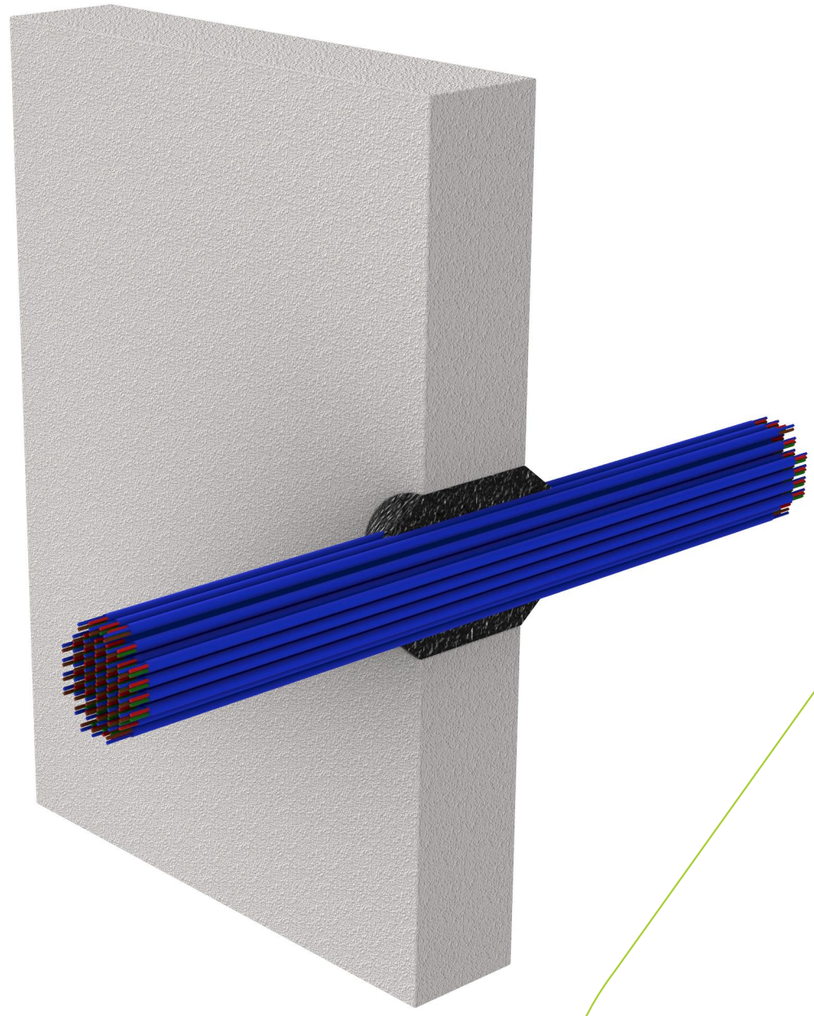

SYSTEM DESCRIPTION	
Orientation:	Wall
Trade / Type:	Electrical
Service:	CAT
Substrate:	AAC / Hebel
Min Substrate Thickness (mm):	75
Sealant Depth (mm):	75
Sealant Fillet (mm):	25
Wrap Length (mm):	-
FRL / FRR:	-/90/90

FIRE STOPPING INFORMATION	
BOSS FireMastic-HPE™	-
-	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
90	-
ADDITIONAL INFORMATION	

SERVICE SIZE & DETAILS

Up to 38 x Cat6 data cables (50 mm diam.). Sealant to full depth of wall in annular gap with 25 mm x 25 mm fillet to both sides.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2017.7		
Date:	26/11/24	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.