
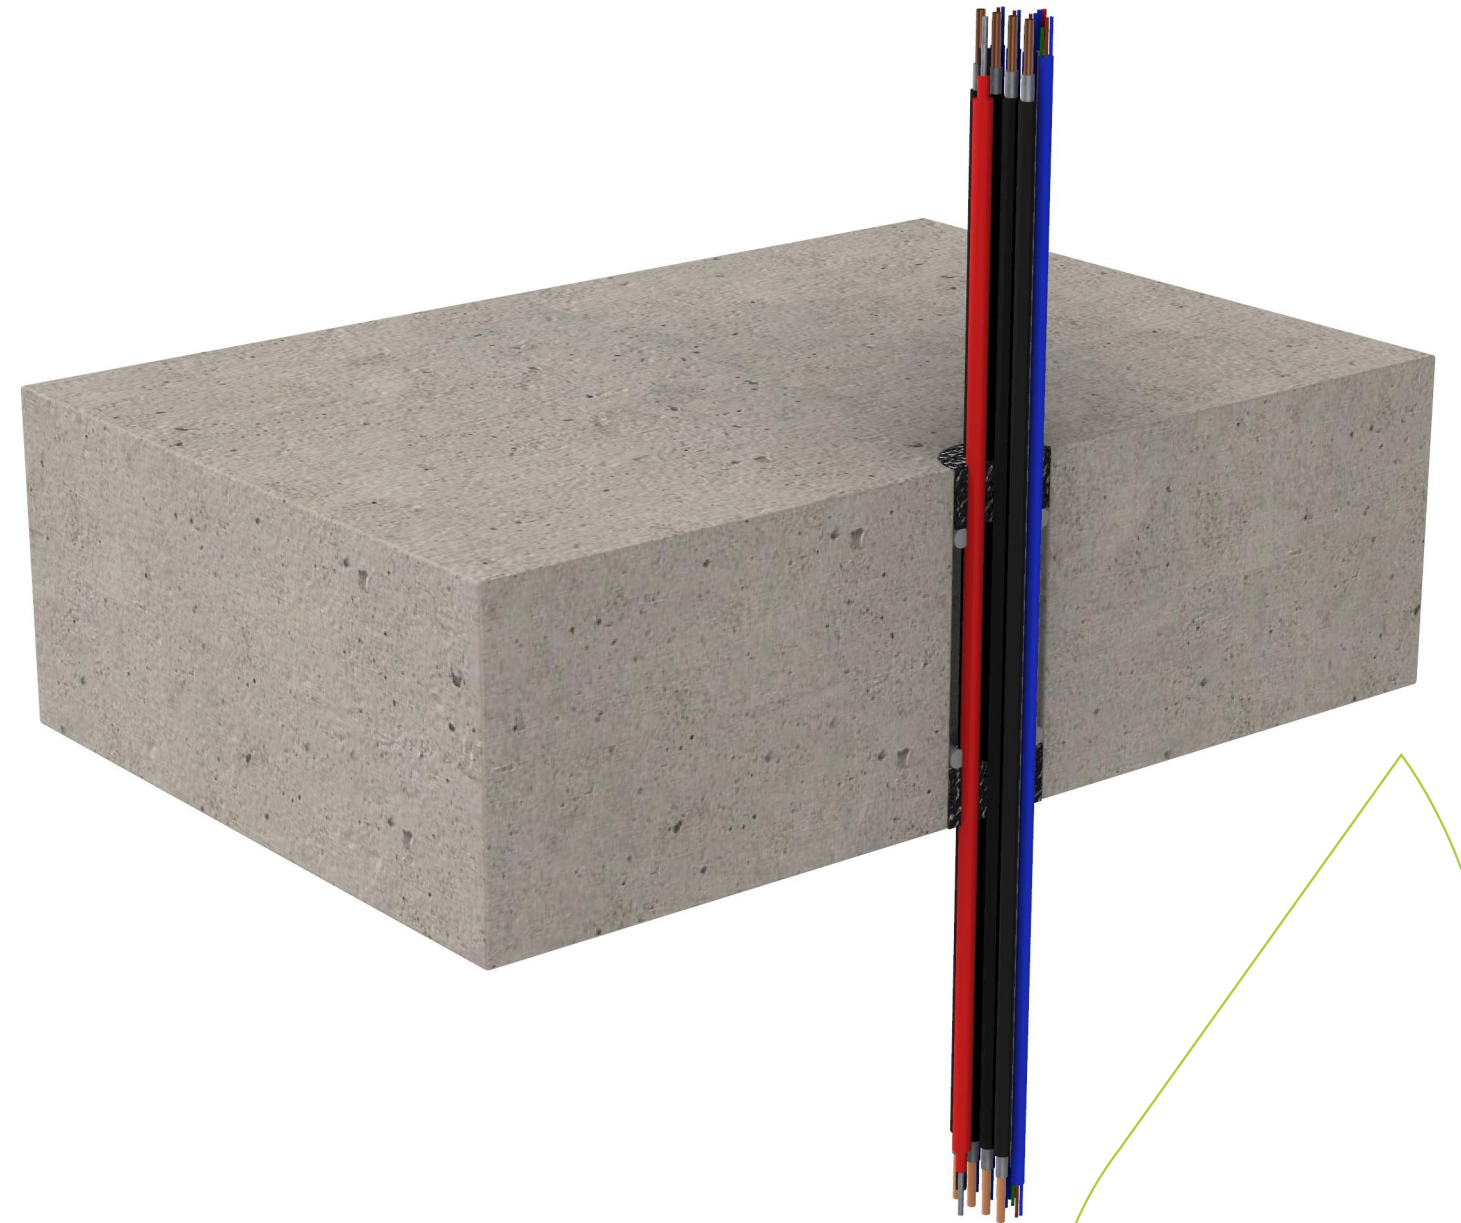


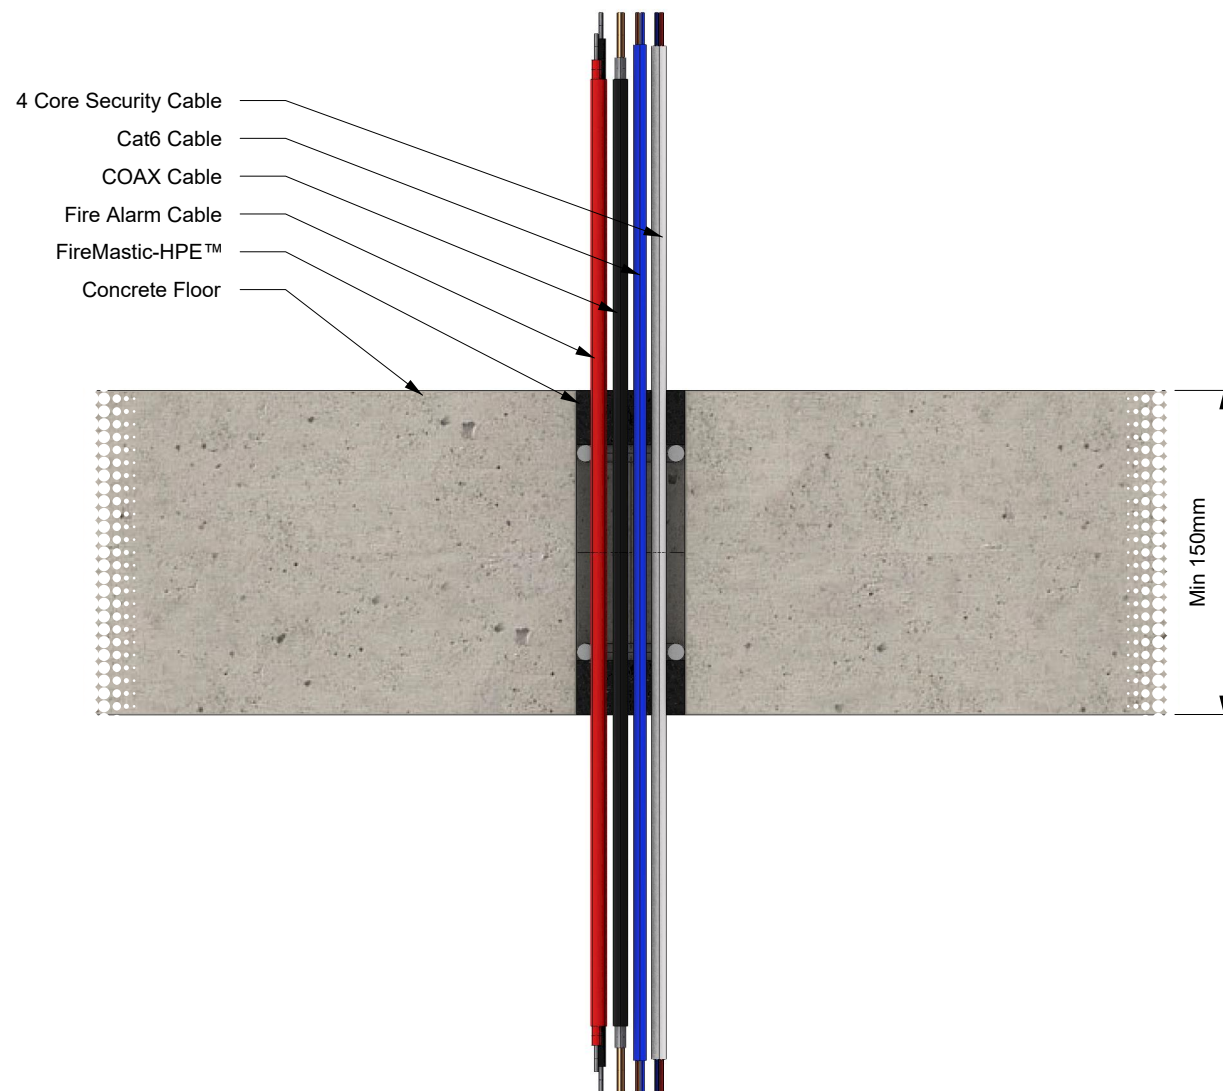

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS FireMastic-HPE™	-	Cable bundle of: •Up to 4 x RG6 Coax cables •Up to 4 x Cat6 cables •Up to 2 fire alarm cables •1 x security cable Sealant to depth of 25 mm in annular gap to backing rod finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Mixed Comms Bundle	-	-		Report Reference:		WF FAS 190335	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2020.25	
Min Substrate Thickness (mm):	150	50	-		Date:		26/11/24	Rev:
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/240/240							