
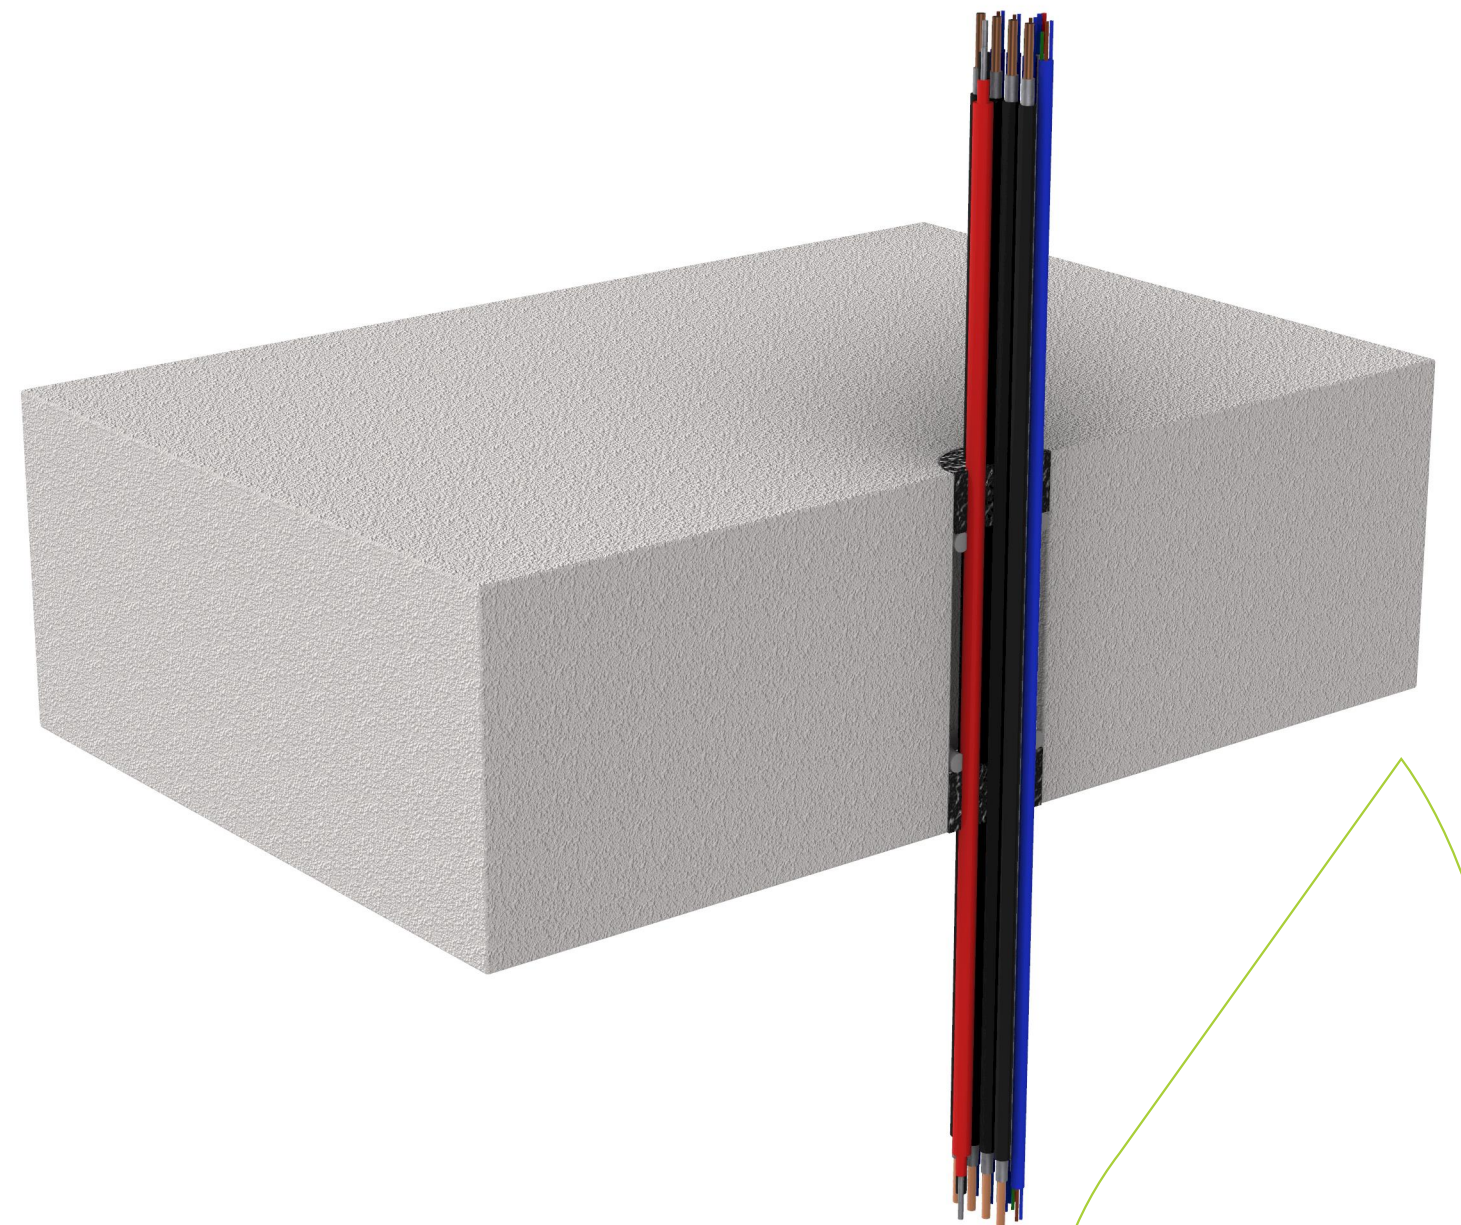


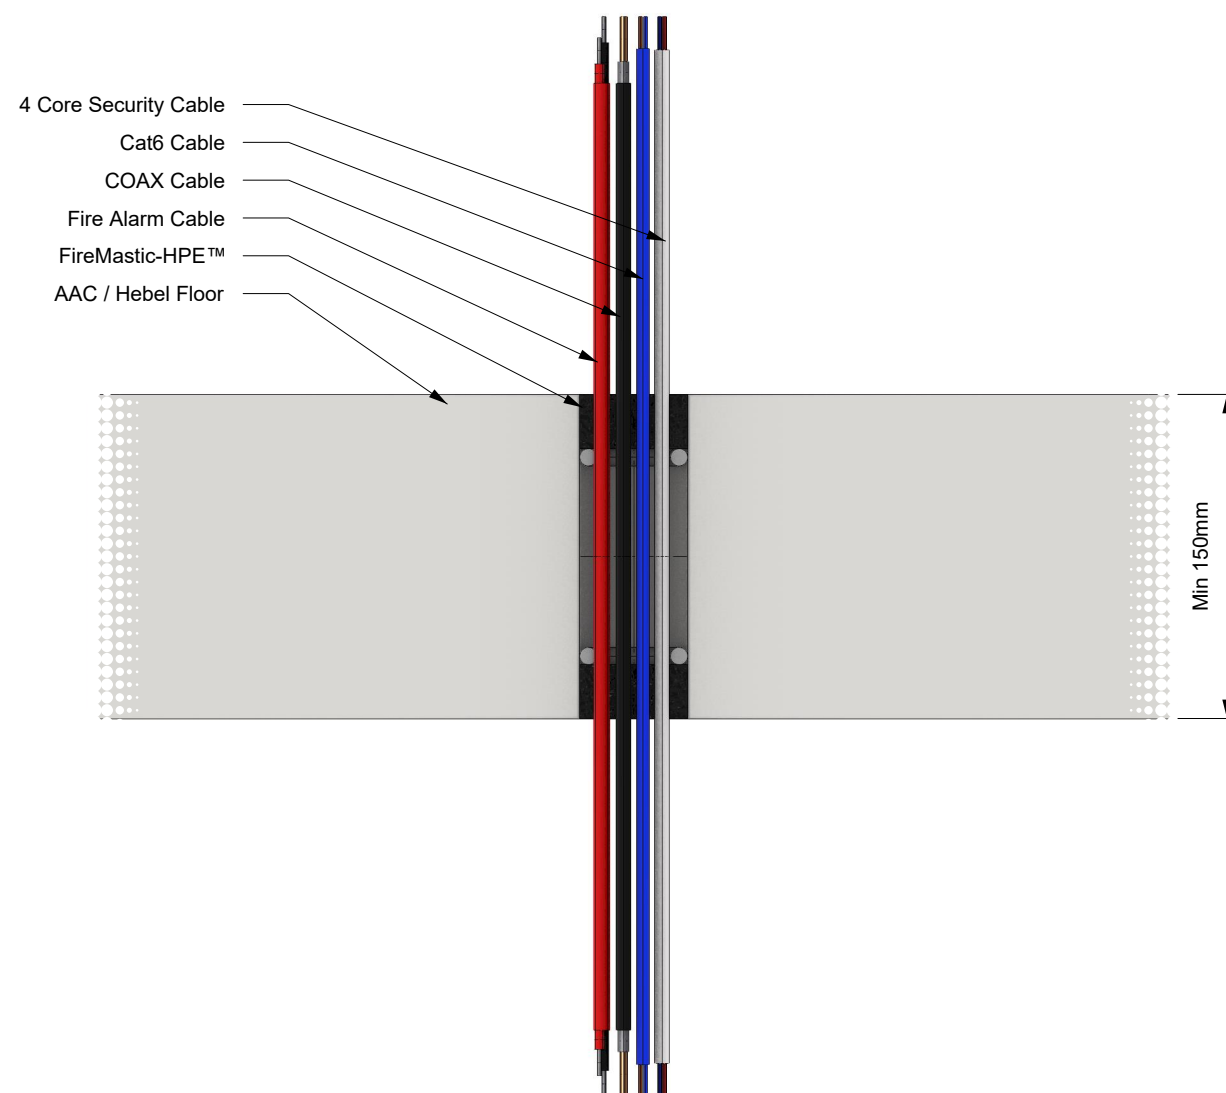

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS FireMastic-HPE™	-	Cable bundle of: •Up to 4 x RG6 Coax cables •Up to 4 x Cat6 cables •Up to 2 fire alarm cables •1 x security cable Sealant to depth of 25 mm in annular gap to backing rod finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Mixed Comms Bundle	-	-		Report Reference:		WF FAS 190335	
Substrate:	AAC / Hebel Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2020.26	
Min Substrate Thickness (mm):	150	50	-		Date:	26/11/24	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/240/240							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.