
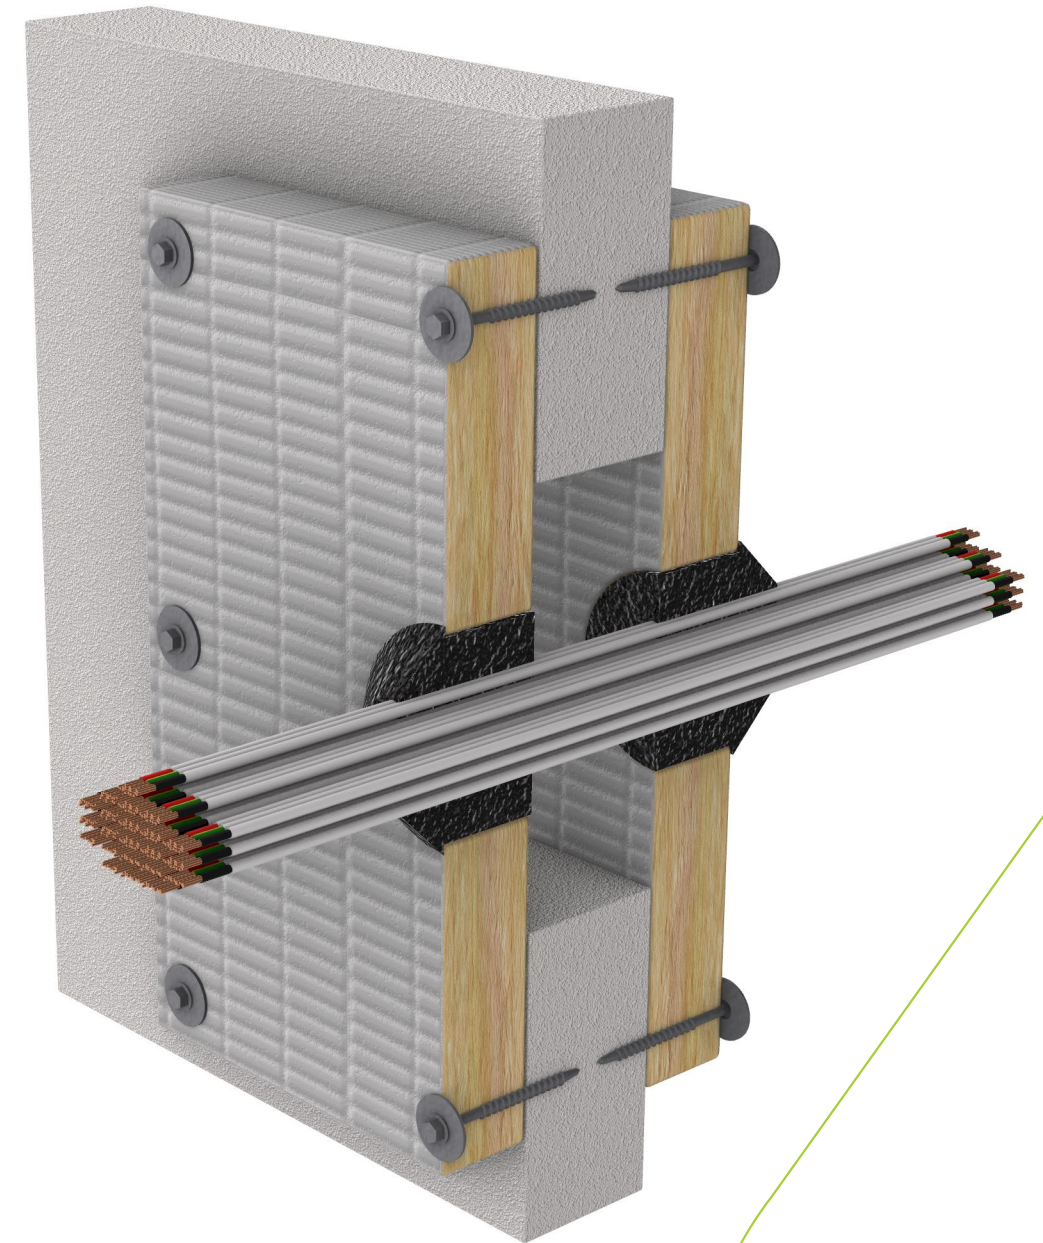


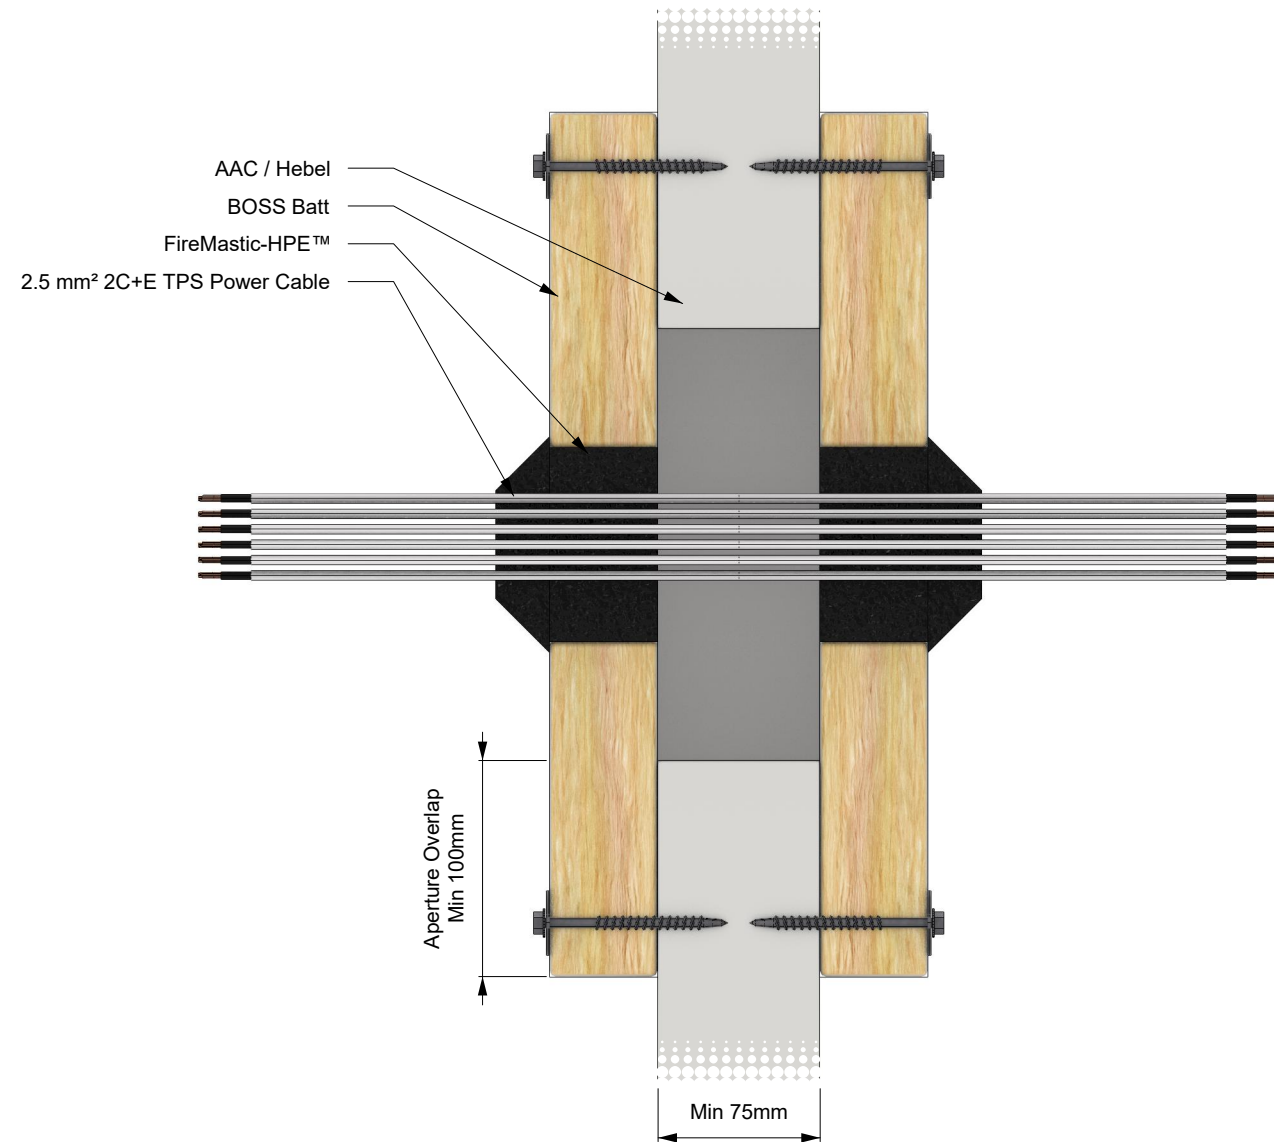

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION					
Orientation:	Wall	BOSS FireMastic-HPE™	-		Up to 22 x 2.5 mm², 2C+E TPS Power Cables. Sealant full depth of the wall in annular gap with 25 mm x 25 mm fillet on both sides.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Electrical	-	-			Supplementary Standard:		AS 4072.1-2005		
Service:	TPS	-	-			Report Reference:		WF FAS 190335		
Substrate:	2 layers BOSS Batt - Pattress fitted either side	APERTURE (mm)	ANNULAR GAP (mm)			Drawing Number:		BF-2036.14		
Min Substrate Thickness (mm):	75	90	-			ADDITIONAL INFORMATION	Date:	03/12/24	Rev:	01
Sealant Depth (mm):	Full depth									
Sealant Fillet (mm):	25									
Wrap Length (mm):	-									
FRL / FRR:	-/90/90									

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.