
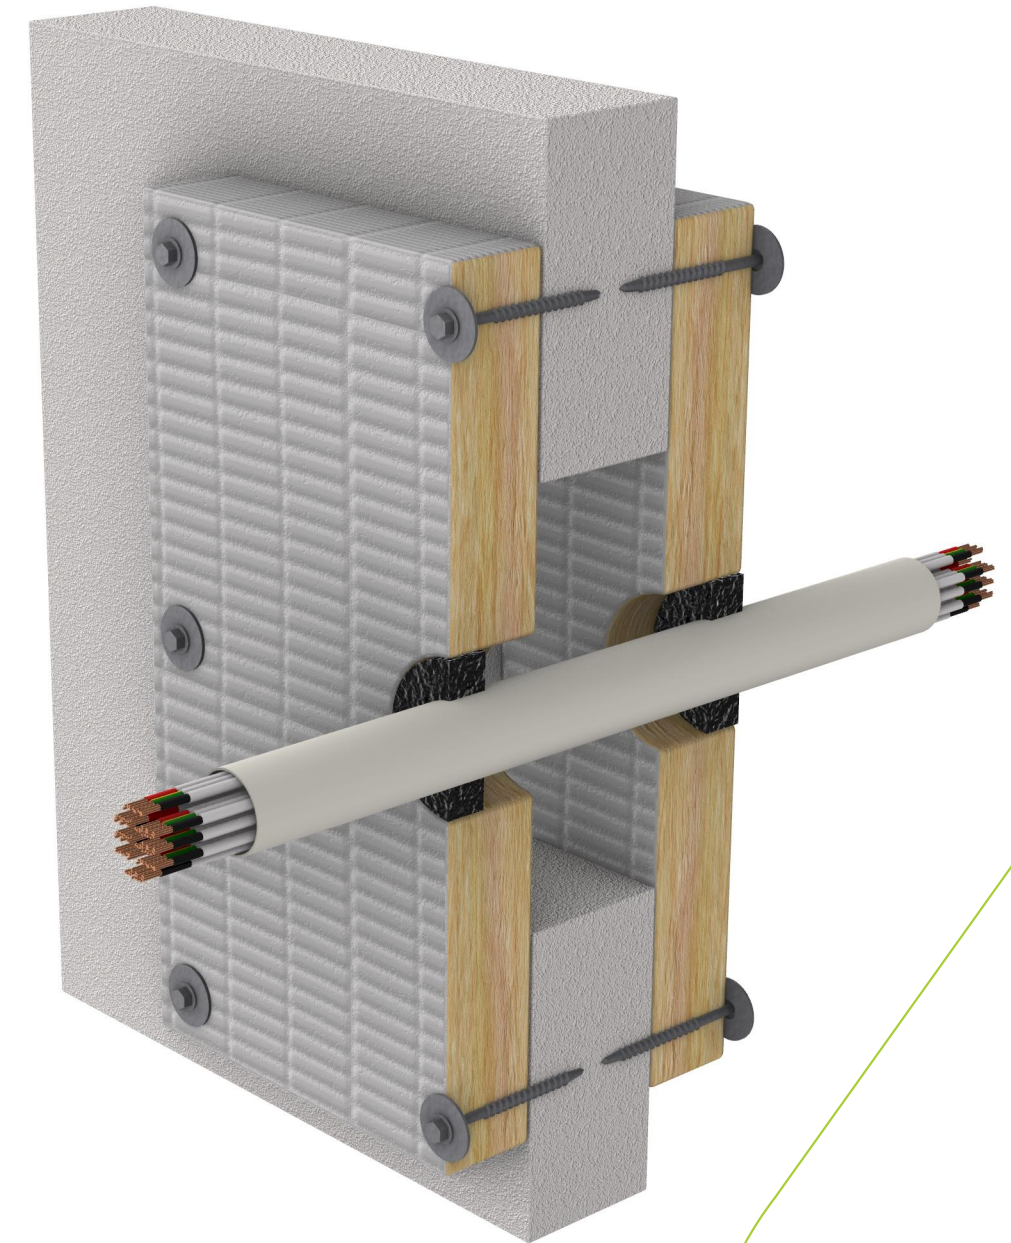


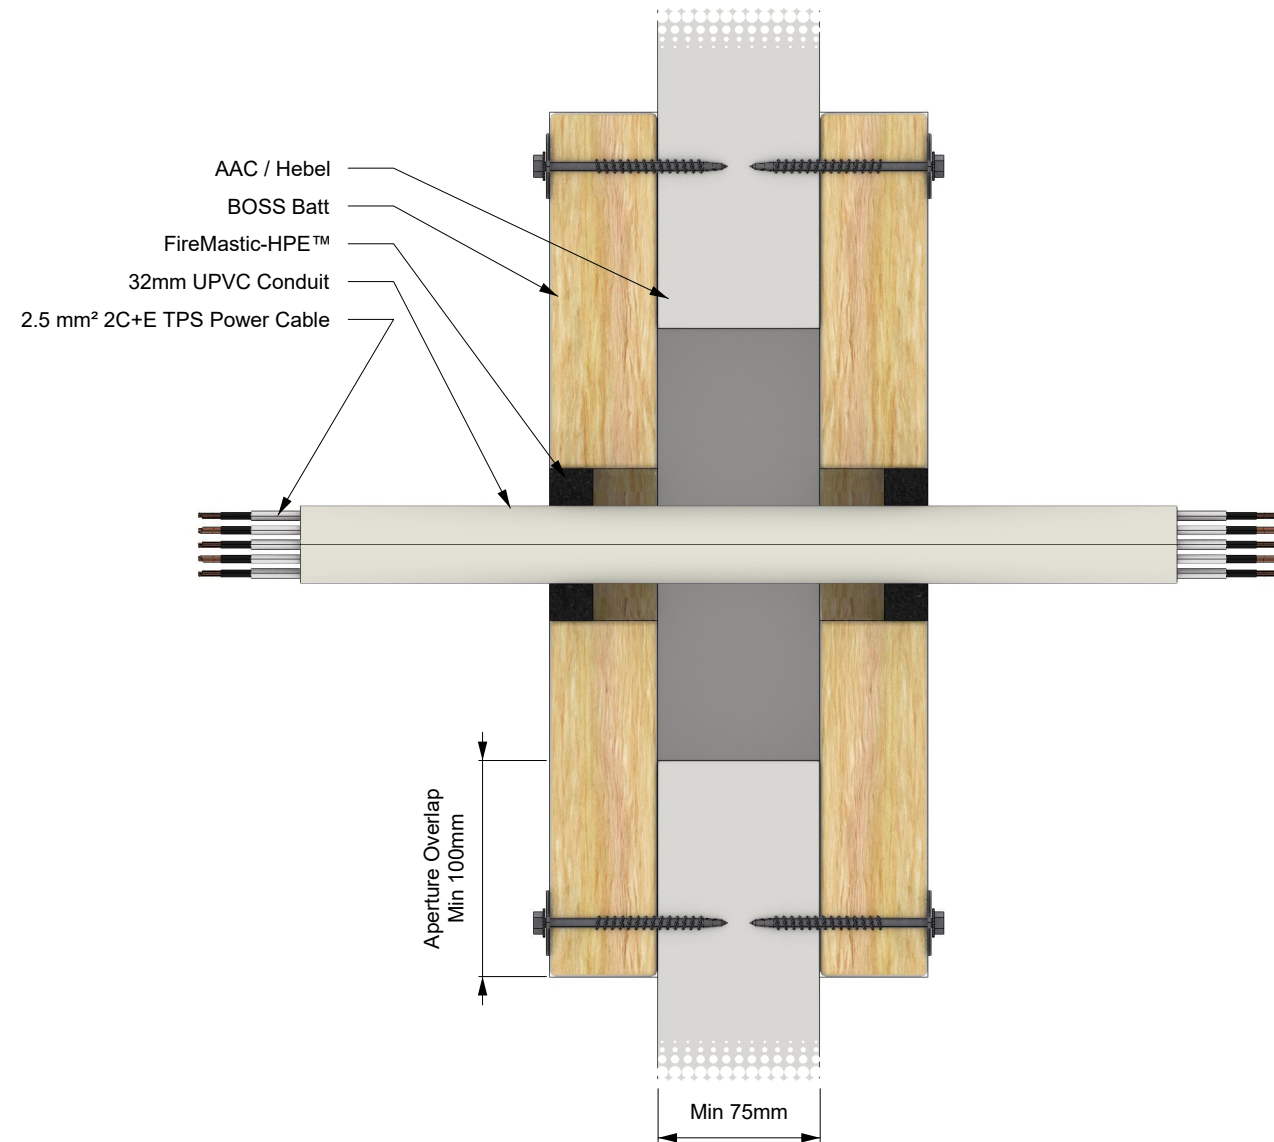

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS FireMastic-HPE™	-		Up to 8 x 2.5 mm² 2C+E TPS Power Cables inside a uPVC conduit. Conduit up to 32 mm diameter with wall thickness up to 1.9 mm. Sealant to depth of 20 mm in annular gap finished flush.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Electrical	-	-			Supplementary Standard:		AS 4072.1-2005	
Service:	Conduit Incl. cables	-	-			Report Reference:		WF FAS 190335	
Substrate:	2 layers BOSS Batt - Pattress fitted either side	APERTURE (mm)	ANNULAR GAP (mm)			Drawing Number:		BF-2037.14	
Min Substrate Thickness (mm):	75	70	-			Date:	03/12/24	Rev:	01
Sealant Depth (mm):	20	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	0								
Wrap Length (mm):	-								
FRL / FRR:	-/90/90								

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.