# BOSS BF-2051-26

AU: 1300 502 677 | NZ: 0800 502 677 www.bossfire.com

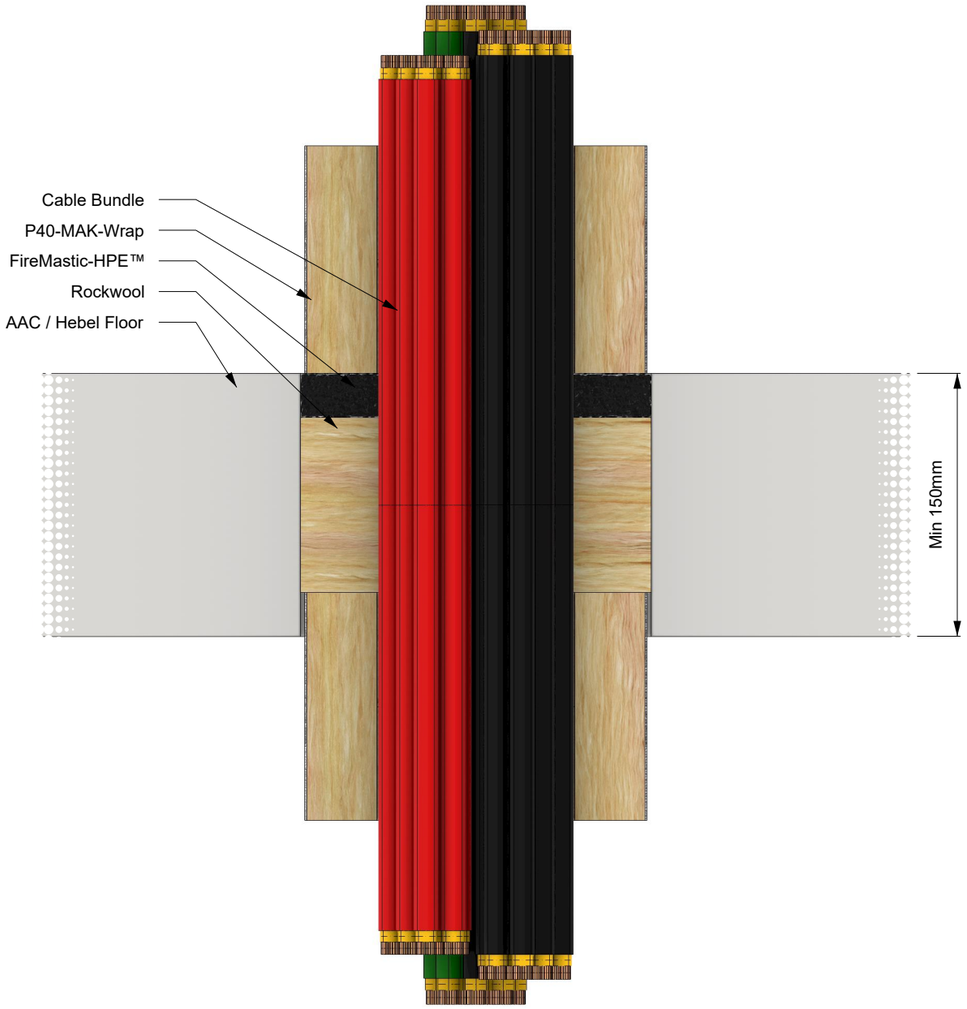


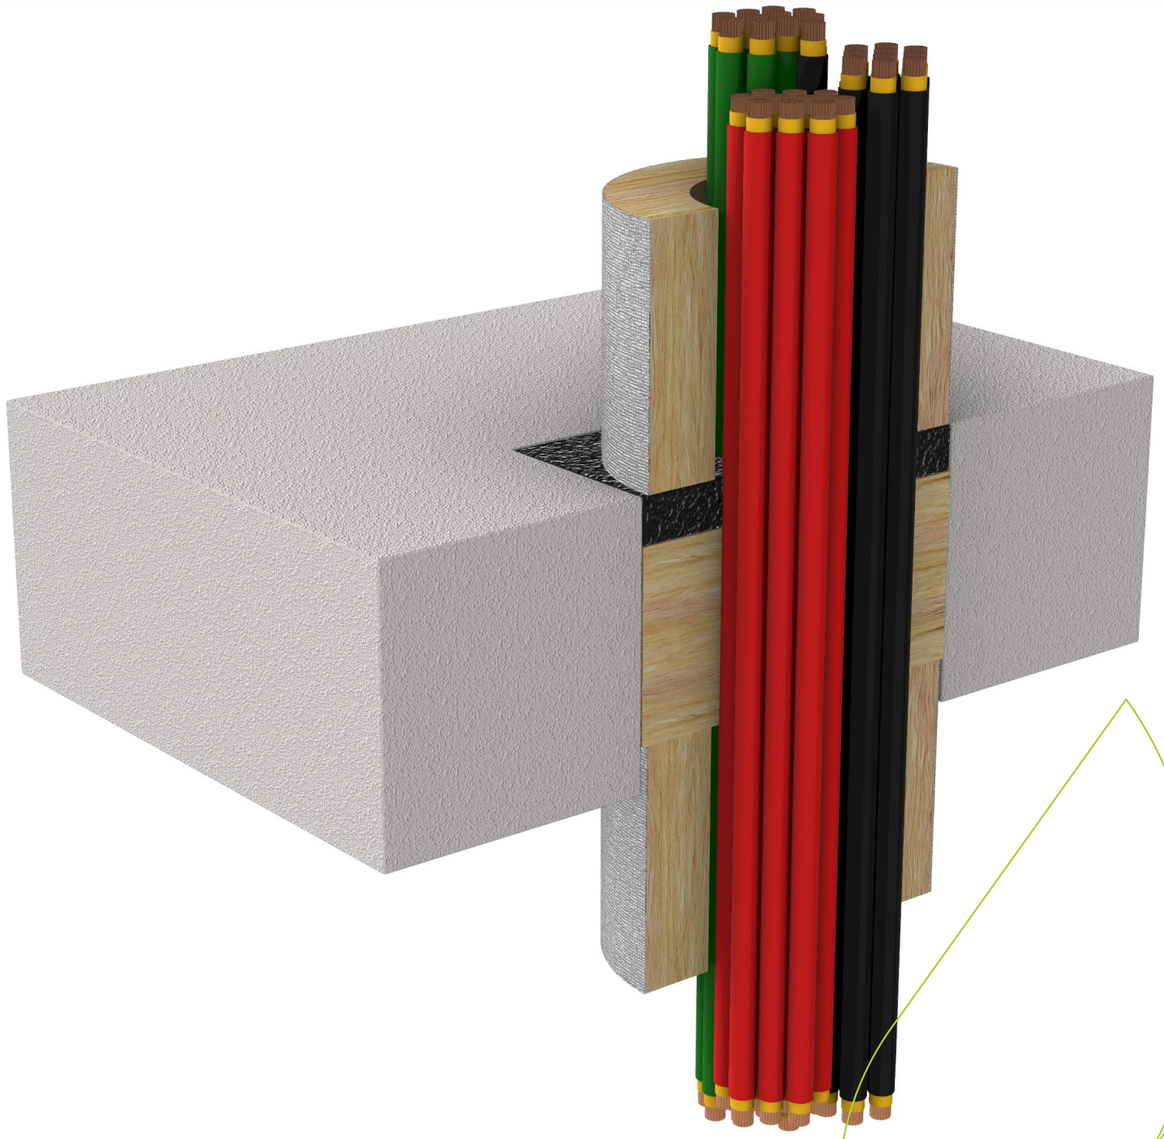

## SYSTEM DESCRIPTION

| | |
|---|---|
| **Orientation:** | Floor |
| **Trade / Type:** | Electrical |
| **Service:** | Multi Core / Orange Circular / Mains |
| **Substrate:** | AAC / Hebel Floor |
| **Min Substrate Thickness (mm):** | 150 |
| **Sealant Depth (mm):** | 25 |
| **Sealant Fillet (mm):** | 0 |
| **Wrap Length (mm):** | 600 |
| **FRL / FRR:** | -/180/120 |

## FIRE STOPPING INFORMATION

| | |
|---|---|
| BOSS FireMastic-HPE™ | - |
| BOSS P40-MAK Wrap™ | - |
| - | - |
| **APERTURE (mm)** | **ANNULAR GAP (mm)** |
| 200 x 200 | - |

## ADDITIONAL INFORMATION

-

## SERVICE SIZE & DETAILS

•10 × (A1) small sheathed (PVC/PVC) 5 x 1.5 mm2,
•10 × (A2) small sheathed (EPR/PO) 5 × 1.5 mm2,
•10 × (A3) small sheathed (XLPE/EVA) 5 × 1.5 mm2.
Sealant 25 mm deep finished flush with upper face of floor. The system also includes a 100 mm deep infill friction fitted stone wool insulation, centrally located in the annular gap through the floor system.
P40 MAK Wrap to be installed 600 mm on both sides.

## SUPPORTING INFORMATION

| | | | |
|---|---|---|---|
| **Reference Standard:** | AS 1530.4:2014 | | |
| **Supplementary Standard:** | AS 4072.1-2005 | | |
| **Report Reference:** | WF FAS 190335 | | |
| **Drawing Number:** | BF-2051.26 | | |
| **Date:** | 12/12/24 | **Rev:** | 01 |

**IMPORTANT:** This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.