
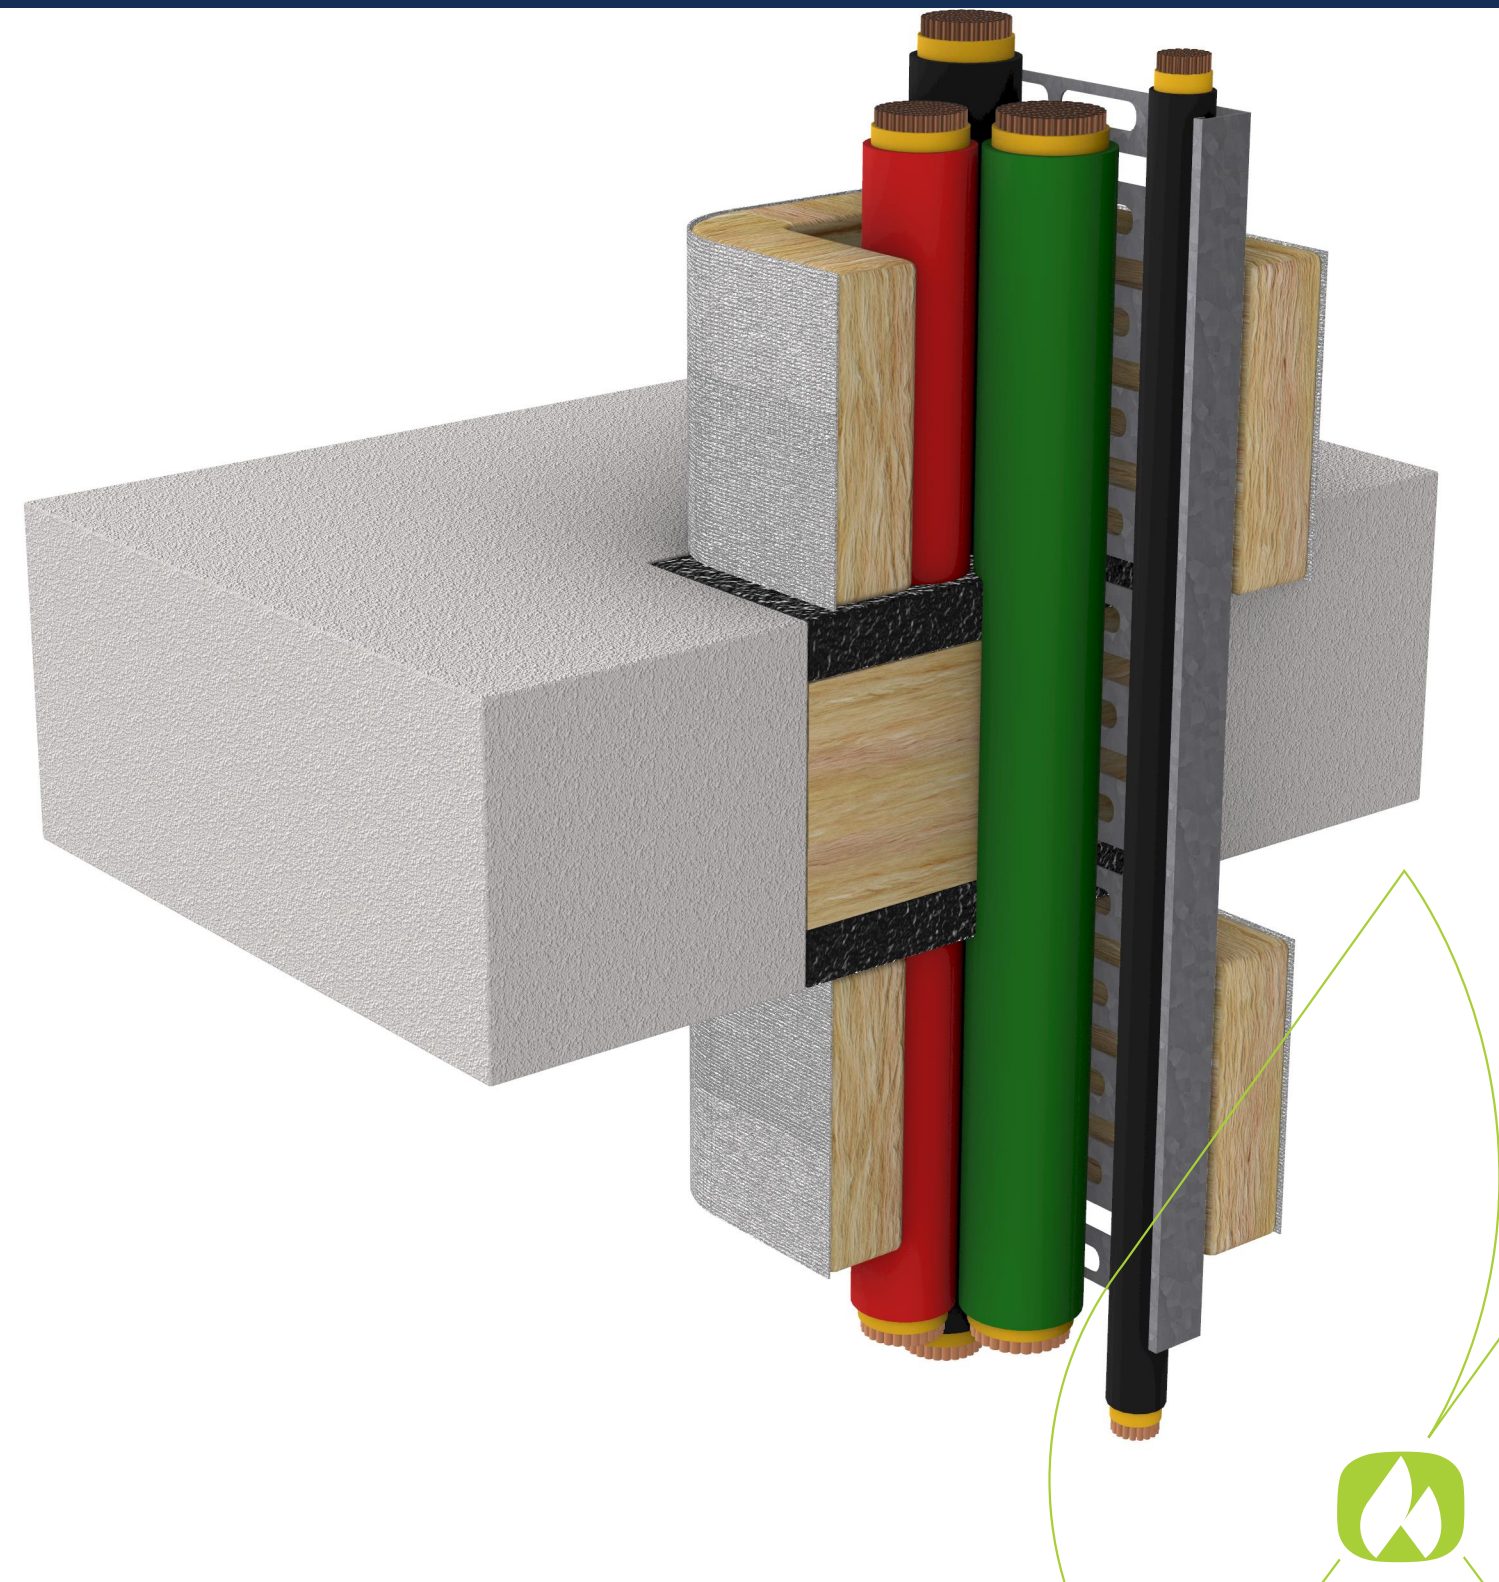


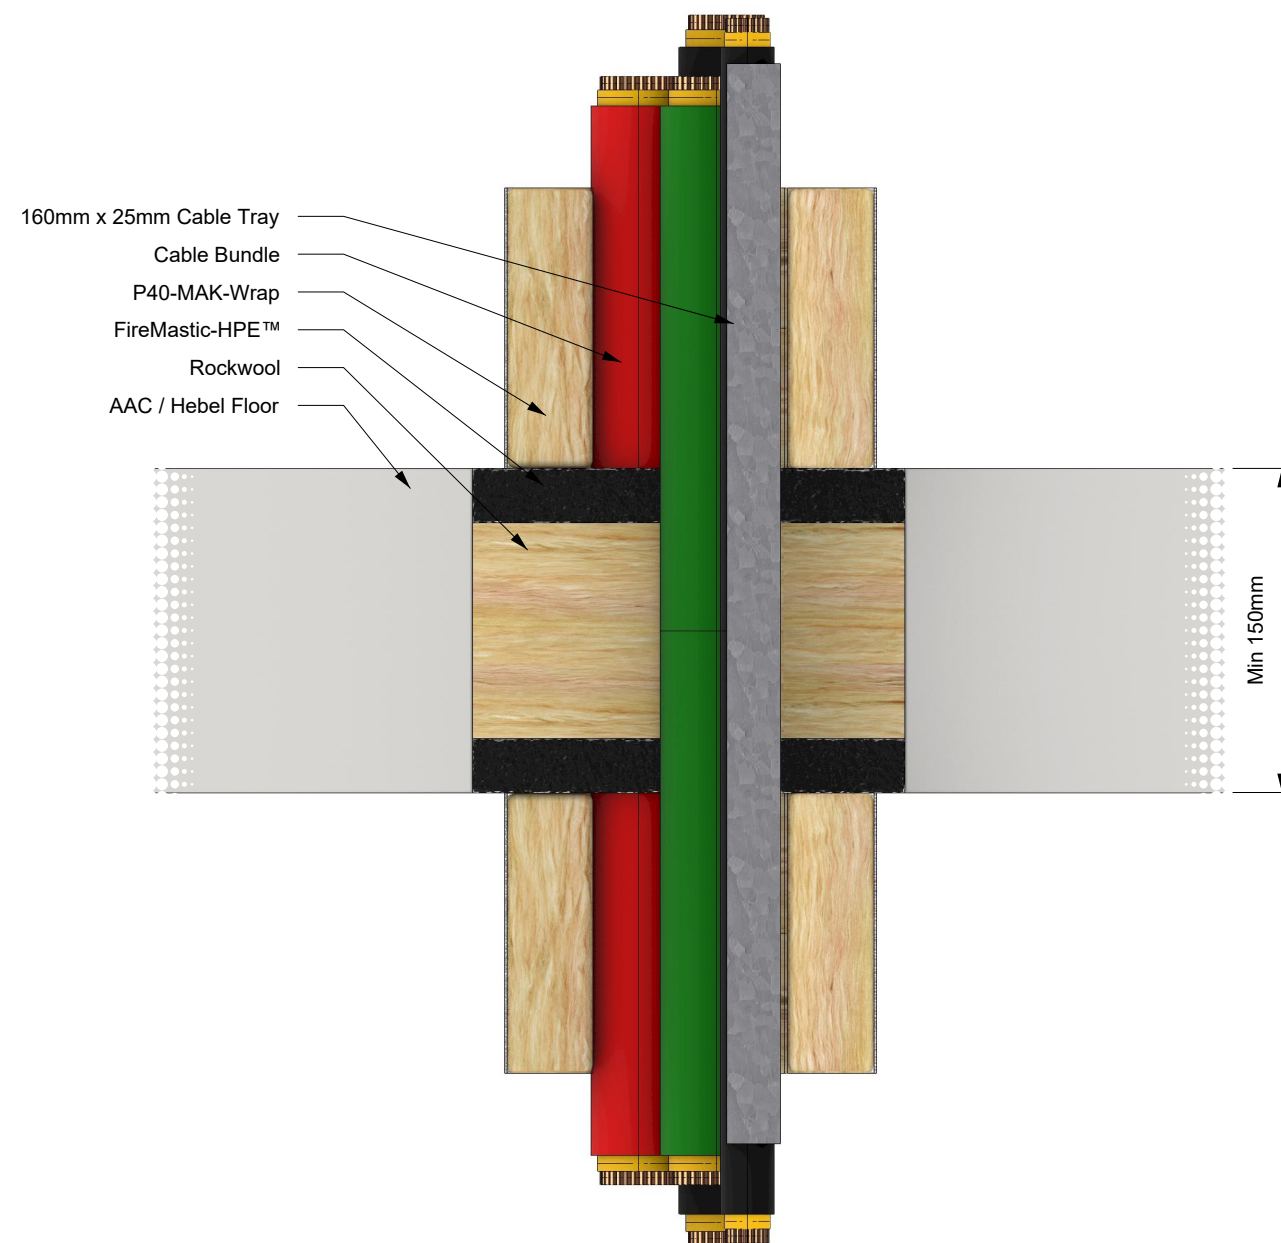

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS FireMastic-HPE™	-	160 mm wide x 25 mm high x 1.0 mm thick perforated steel cable tray supporting the following cables: •1 × (C1) large sheathed (PVC/PVC) 4 × 95 mm2, •1 × (C2) large sheathed (EPR/PO) 4 × 95 mm2, •1 × (C3) large sheathed (XLPE/EVA) 4 × 95 mm2, •1 × (E) large sheathed (PVC/PVC) 1 × 185 mm2. Sealant 25 mm deep in annular gap finished flush on both sides. The system also includes a 100 mm deep infill friction fitted stone wool insulation, centrally located in the annular gap through the floor system. P40 MAK Wrap to be installed 600 mm on both sides.	Reference Standard:	AS 1530.4:2014		
Trade / Type:	Electrical	BOSS P40-MAK Wrap™	-		Supplementary Standard:	AS 4072.1-2005		
Service:	Multi Core / Orange Circular / Mains	-	-		Report Reference:	WF FAS 190335		
Substrate:	AAC / Hebel Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:	BF-2054.26		
Min Substrate Thickness (mm):	150	200 x 200	-		Date:	12/12/24	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	600							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.