BOSS BF-2060-14

AU: 1300 502 677 | NZ: 0800 502 677 www.bossfire.com

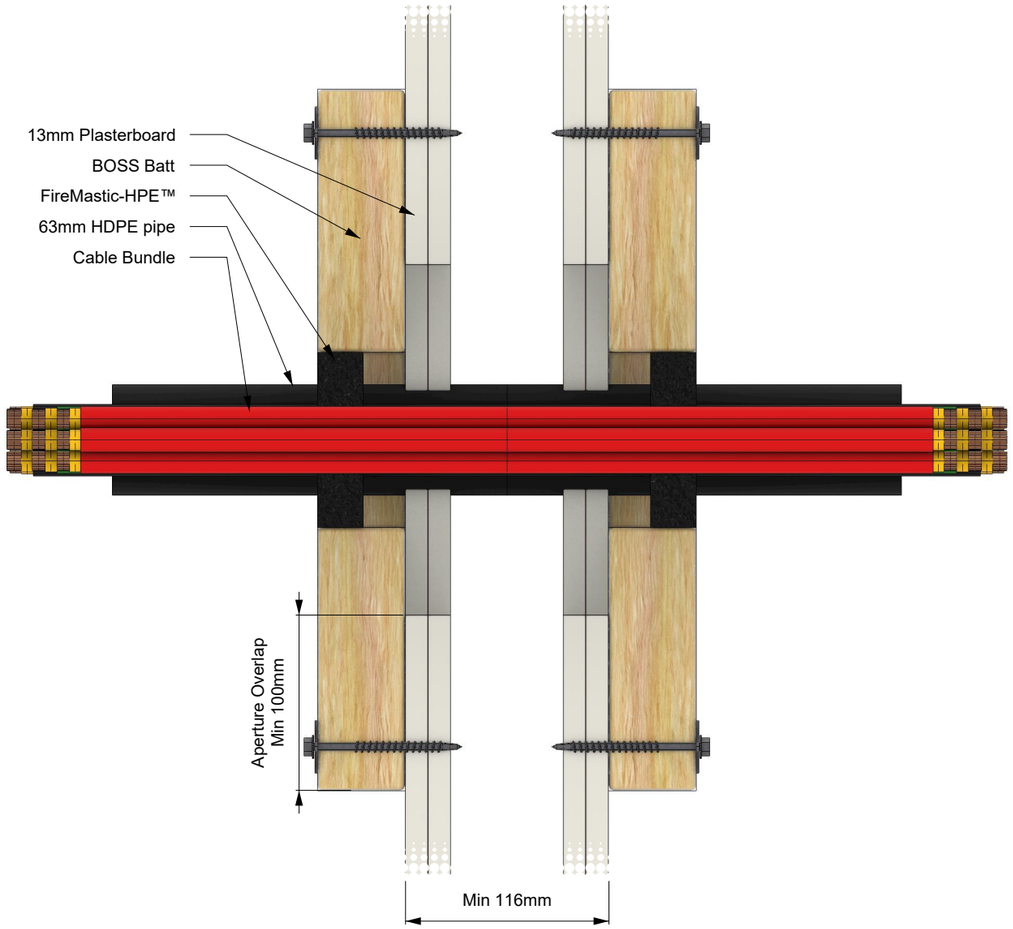

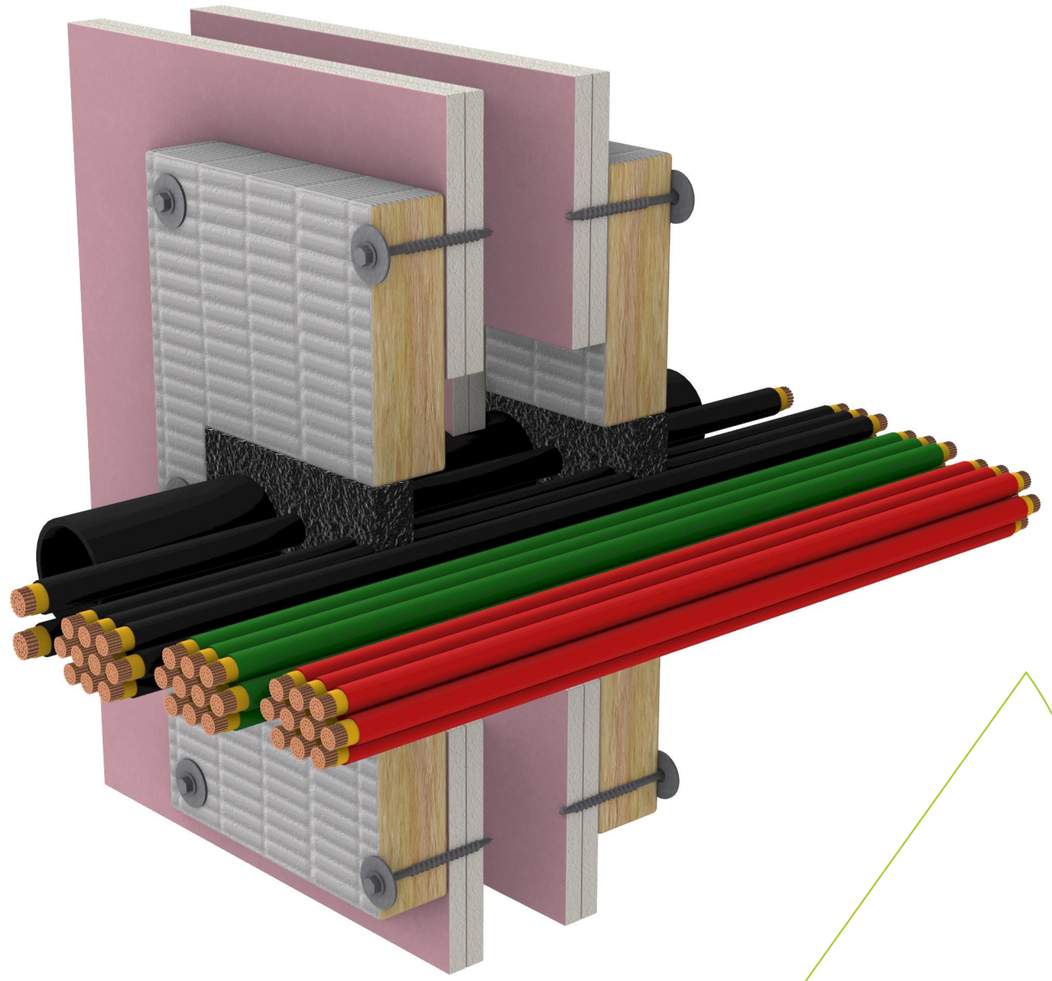

SYSTEM DESCRIPTION	
Orientation:	Wall
Trade / Type:	Electrical
Service:	Multi Core / Orange Circular / Mains
Substrate:	2 layers BOSS Batt - Pattress fitted either side
Min Substrate Thickness (mm):	116
Sealant Depth (mm):	25
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/120/120

FIRE STOPPING INFORMATION	
BOSS FireMastic-HPE™	-
-	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
300 x 100	-
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

- 10 × (A1) small sheathed (PVC/PVC) 5 x 1.5 mm2,
- 10 × (A2) small sheathed (EPR/PO) 5 × 1.5 mm2,
- 10 × (A3) small sheathed (XLPE/EVA) 5 × 1.5 mm2,
- 2 × (B) small sheathed (PVC/PVC) 1 × 95 mm2,
- Up to 63 mm HDPE pipe.

Sealant to depth of plasterboard in annular gap applied in the voids around the cables and pipe in a maximum aperture of 300 mm wide x 100 mm high.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2060.14		
Date:	12/12/24	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.