


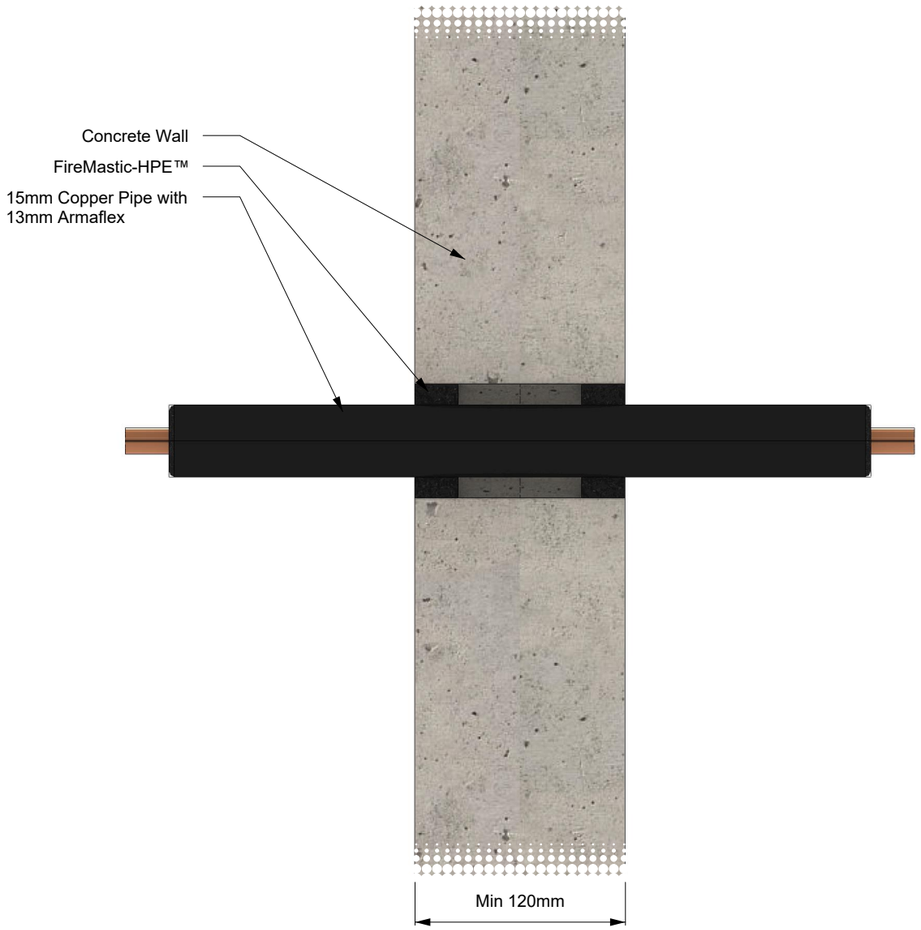


| SYSTEM DESCRIPTION | |
|---|---|
| **Orientation:** | Wall |
| **Trade / Type:** | Plumbing / Hydraulic / Active Fire |
| **Service:** | Insulated Copper Pipes |
| **Substrate:** | Concrete wall |
| **Min Substrate Thickness (mm):** | 120 |
| **Sealant Depth (mm):** | 25 |
| **Sealant Fillet (mm):** | 0 |
| **Wrap Length (mm):** | - |
| **FRL / FRR:** | -/120/120 |

| FIRE STOPPING INFORMATION | |
|---|---|
| BOSS FireMastic-HPE™ | - |
| - | - |
| - | - |
| **APERTURE (mm)** | **ANNULAR GAP (mm)** |
| 65 | - |
| **ADDITIONAL INFORMATION** | |
| - | |

**SERVICE SIZE & DETAILS**

Up to 15 mm copper pipe with 13 mm thick Armaflex insulation. Sealant 25 mm deep in annular gap finished flush both sides.

| SUPPORTING INFORMATION | | | |
|---|---|---|---|
| **Reference Standard:** | AS 1530.4:2014 | | |
| **Supplementary Standard:** | AS 4072.1-2005 | | |
| **Report Reference:** | WF FAS 190335 | | |
| **Drawing Number:** | BF-2062.4 | | |
| **Date:** | 12/12/24 | **Rev:** | 01 |

**IMPORTANT:** This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.