
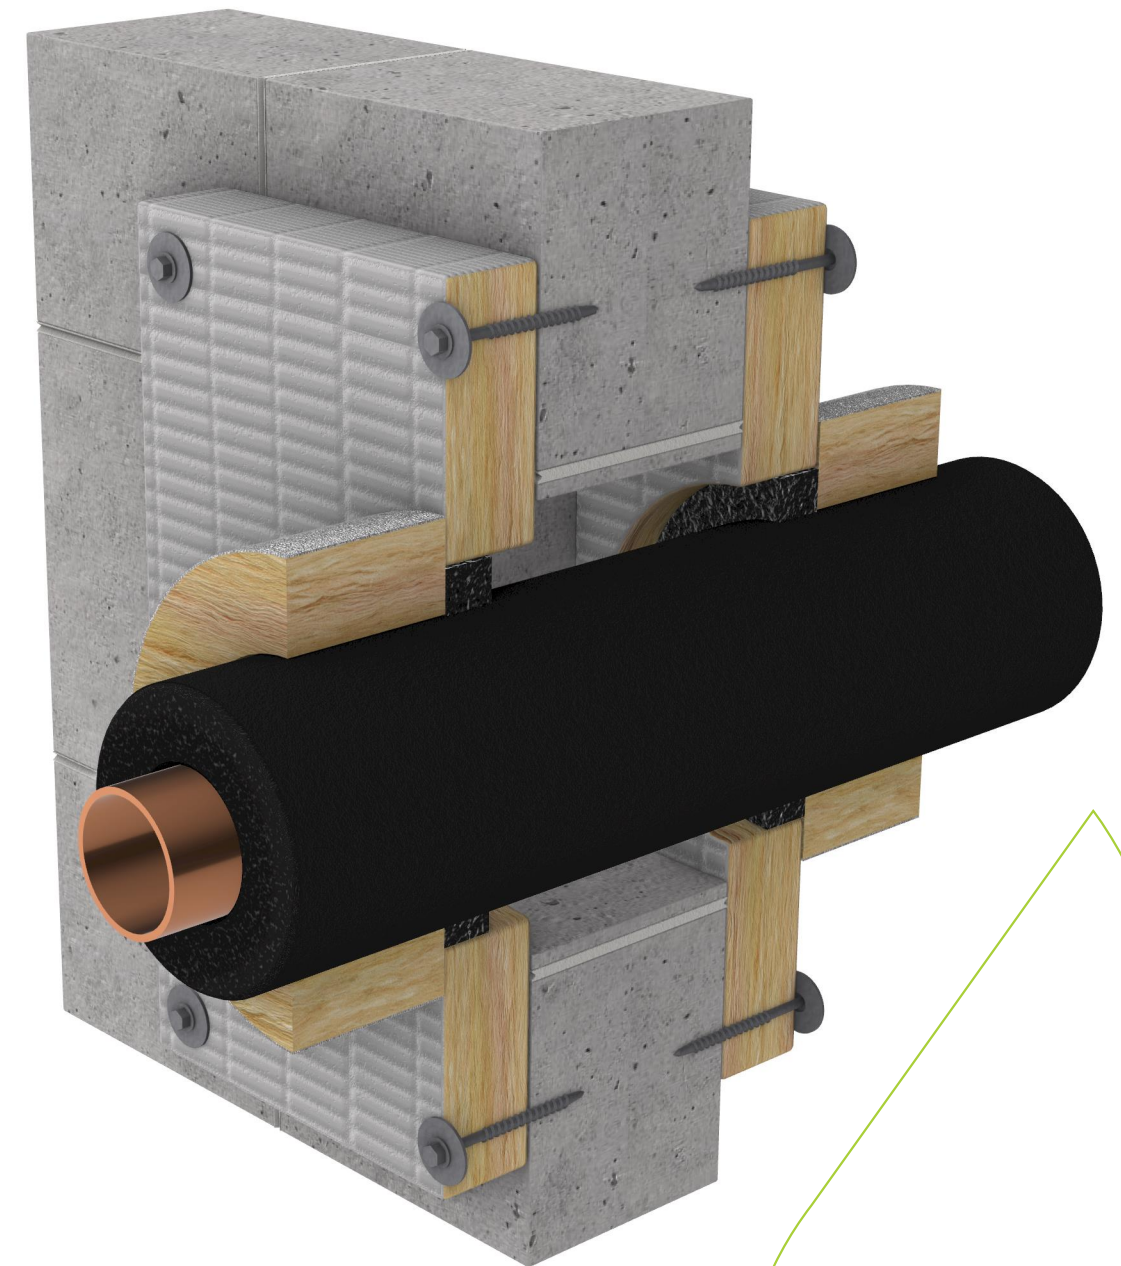


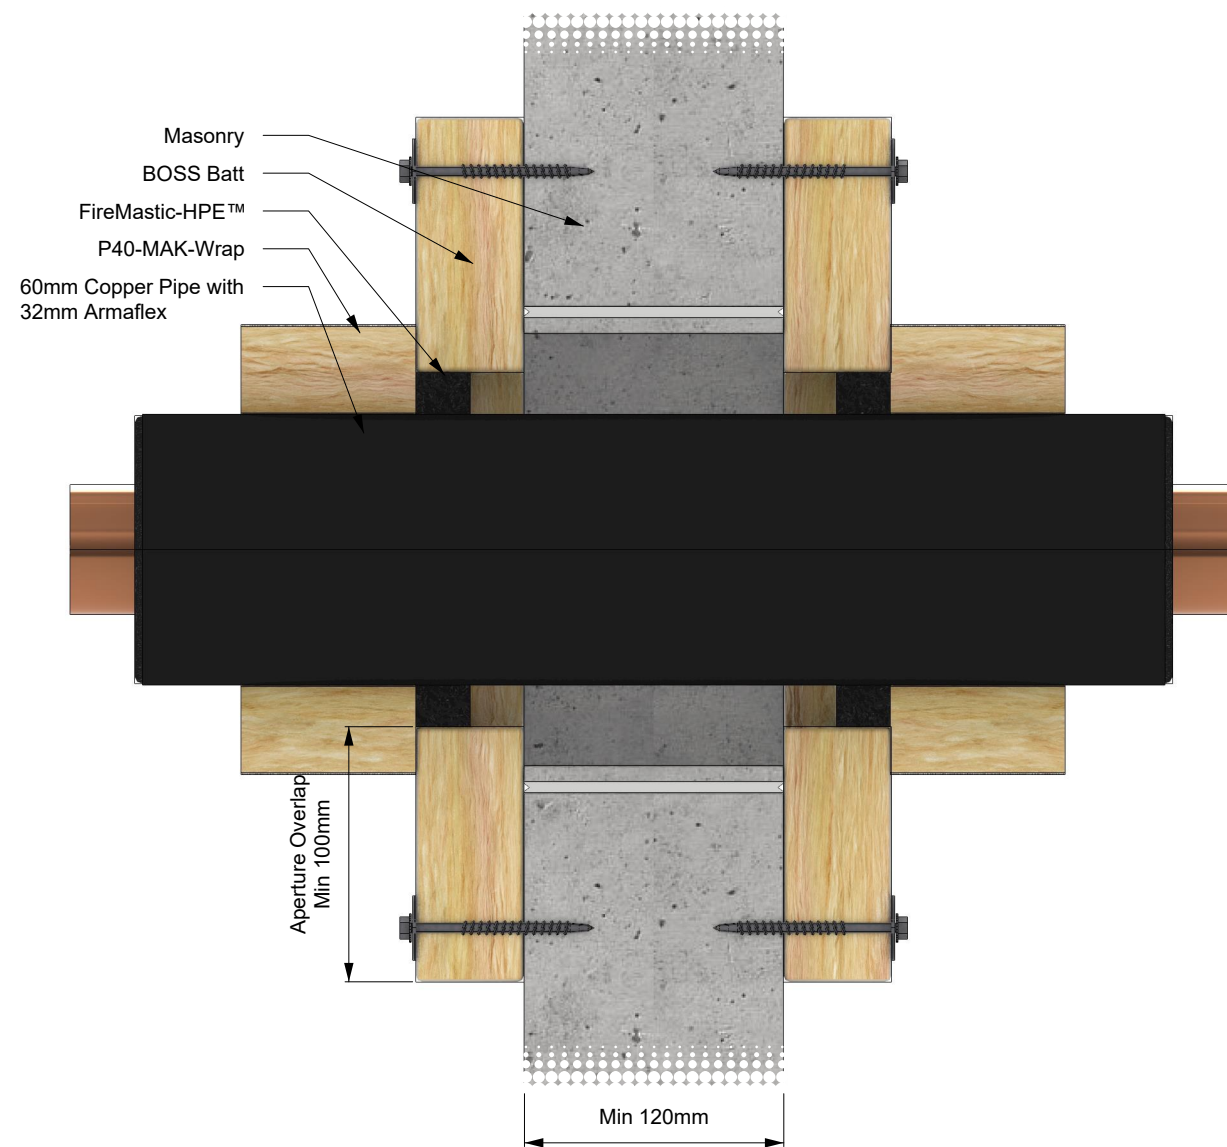

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 60 mm copper pipe with 32 mm thick Armaflex insulation. Service is further wrapped with P40 MAK Wrap insulation to 600 mm on both sides. Sealant 25mm deep in annular gap and finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS P40-MAK Wrap™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Copper Pipes	-	-		Report Reference:		WF FAS 190335	
Substrate:	2 layers BOSS Batt - Pattress fitted either side	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2067.14	
Min Substrate Thickness (mm):	120	164	-		Date:		12/12/24	Rev: 01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	600							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.