
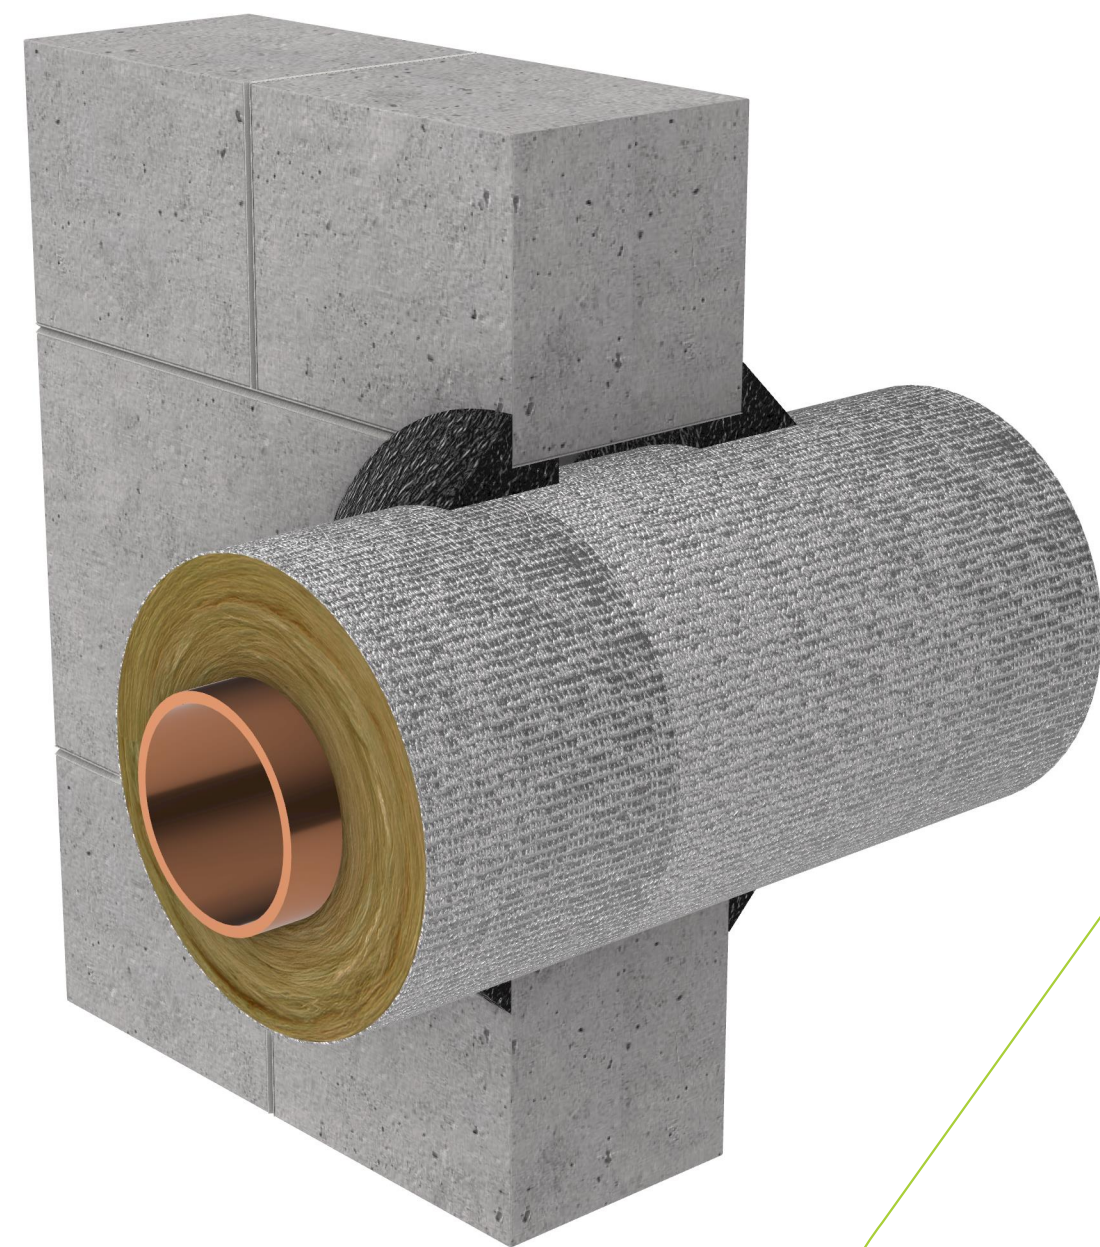


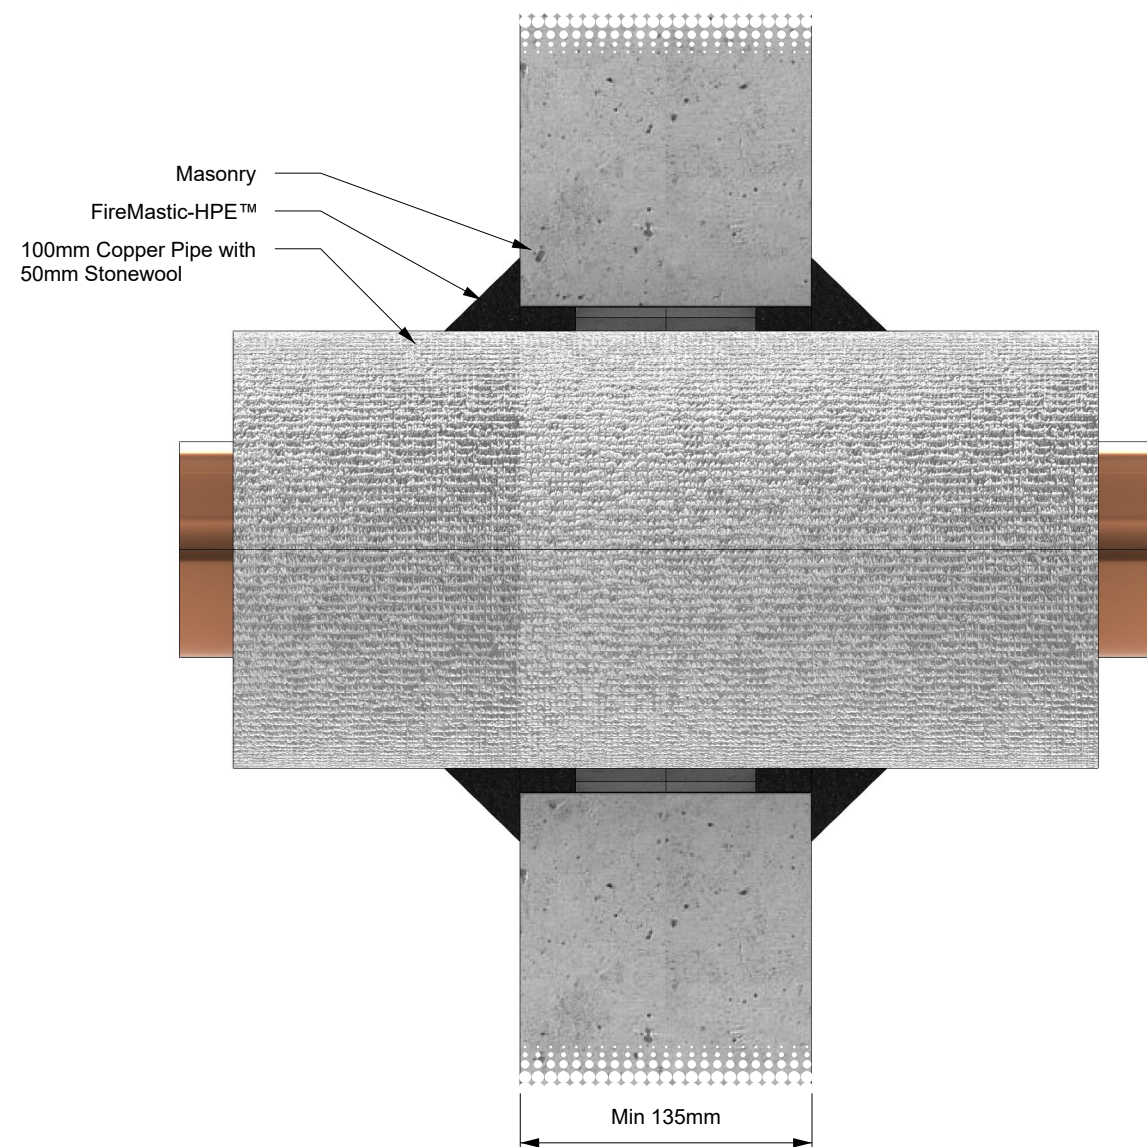

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 100 mm copper pipe with 50 mm thick stonewool insulation. Insulation wrapping is extended 600 mm on both sides. Sealant 26 mm deep in annular gap and finished with 35 mm x 35 mm fillet on both sides.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Plumbing / Hydraulic / Active Fire	Stonewool insulation	-		Supplementary Standard:		AS 4072.1-2005		
Service:	Insulated Copper Pipes	-	-		Report Reference:		WF FAS 190335		
Substrate:	Masonry	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2069.5		
Min Substrate Thickness (mm):	135	224	-		Date:	12/12/24	Rev:	01	
Sealant Depth (mm):	16	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	35	-							
Wrap Length (mm):	600								
FRL / FRR:	-/120/120								

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.