
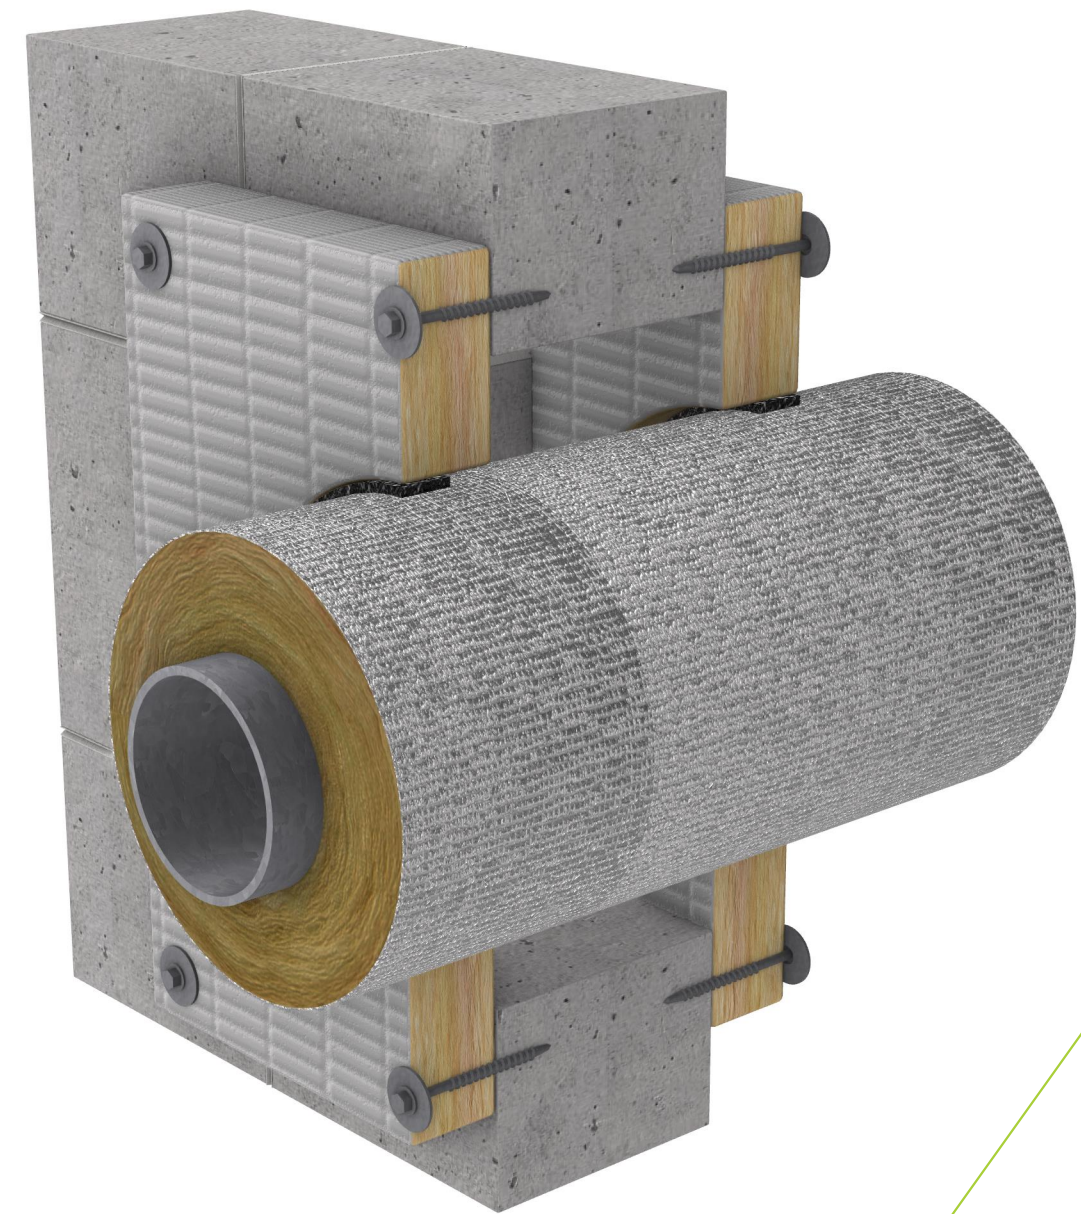


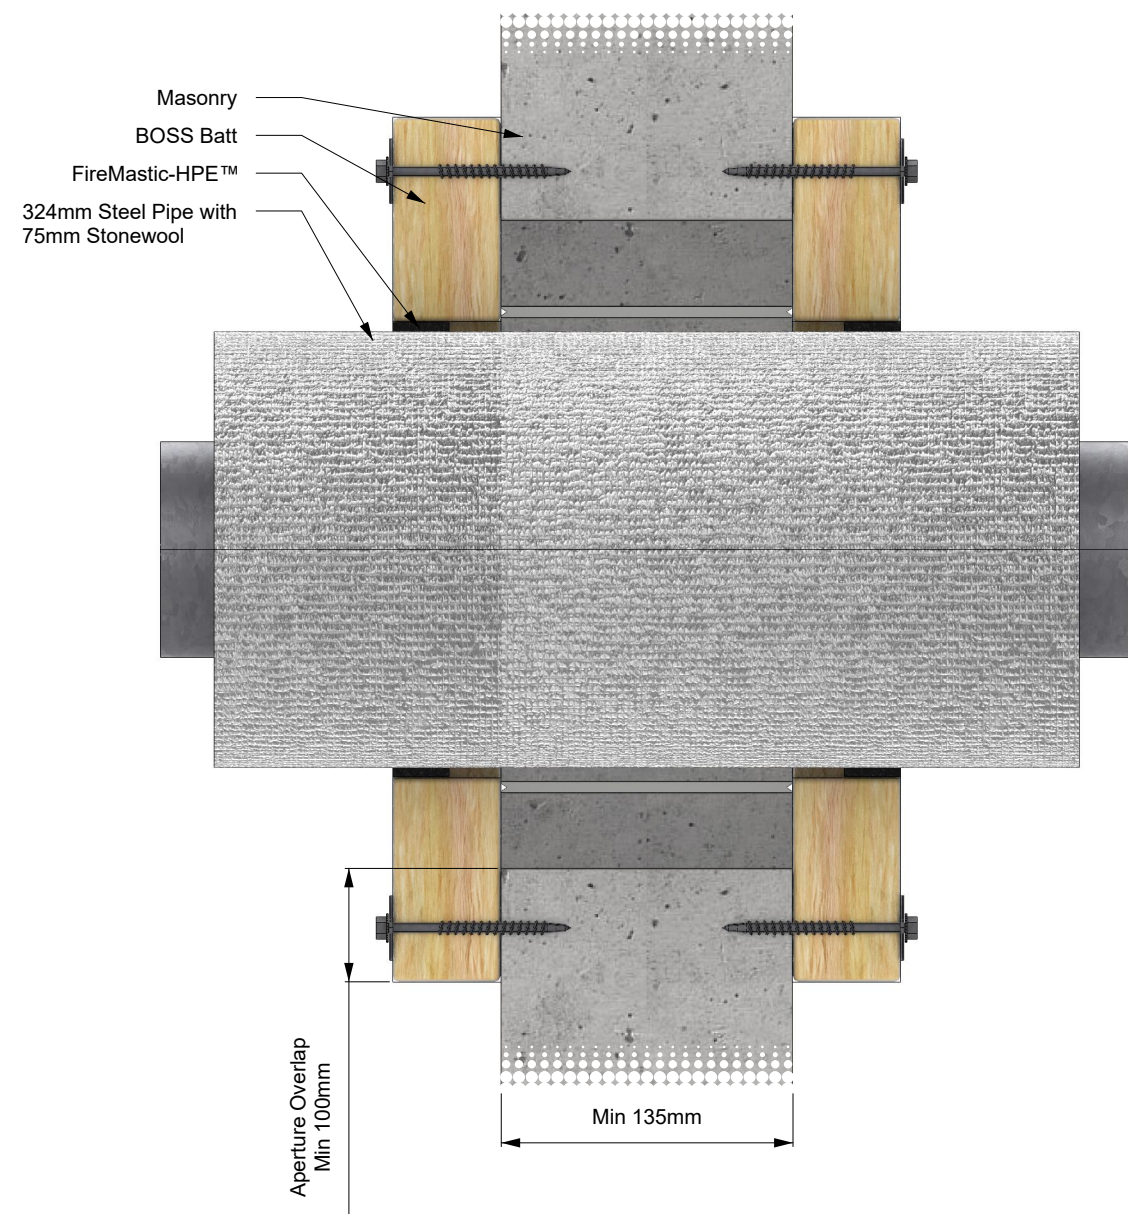

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 324 mm Steel Schedule 40 pipe with 75 mm thick stonewool insulation. Insulation wrapping is extended 400 mm on both sides. 5 mm annular gap sealed on both sides to 26 mm deep.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	Stonewool insulation	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Steel Pipes	-	-		Report Reference:		WF FAS 190335	
Substrate:	2 layers BOSS Batt - Pattress fitted either side	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2075.14	
Min Substrate Thickness (mm):	135	486	5		Date:		12/12/24	Rev: 01
Sealant Depth (mm):	26	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	400							
FRL / FRR:	-/90/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.