
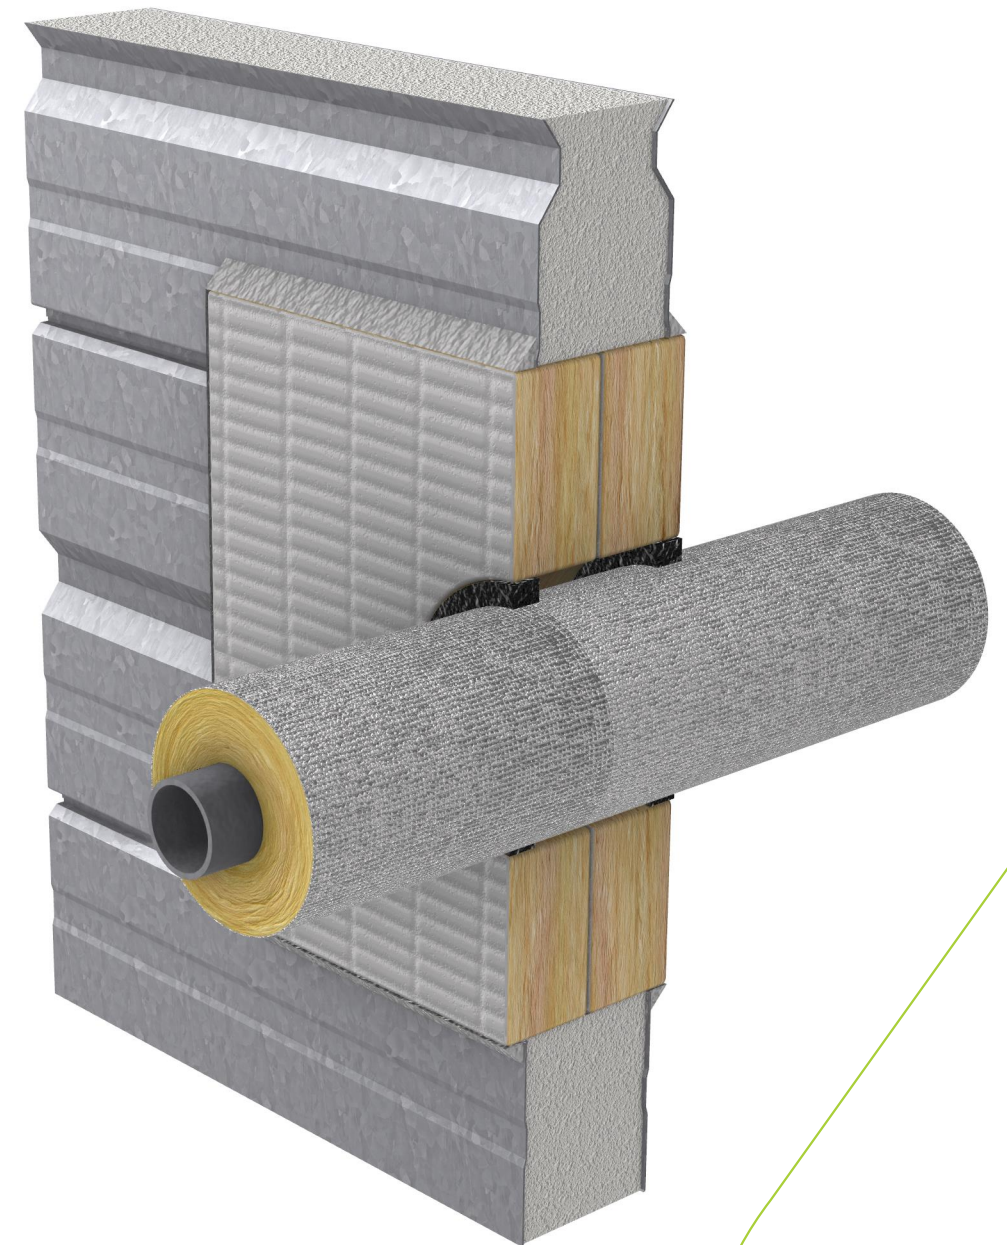


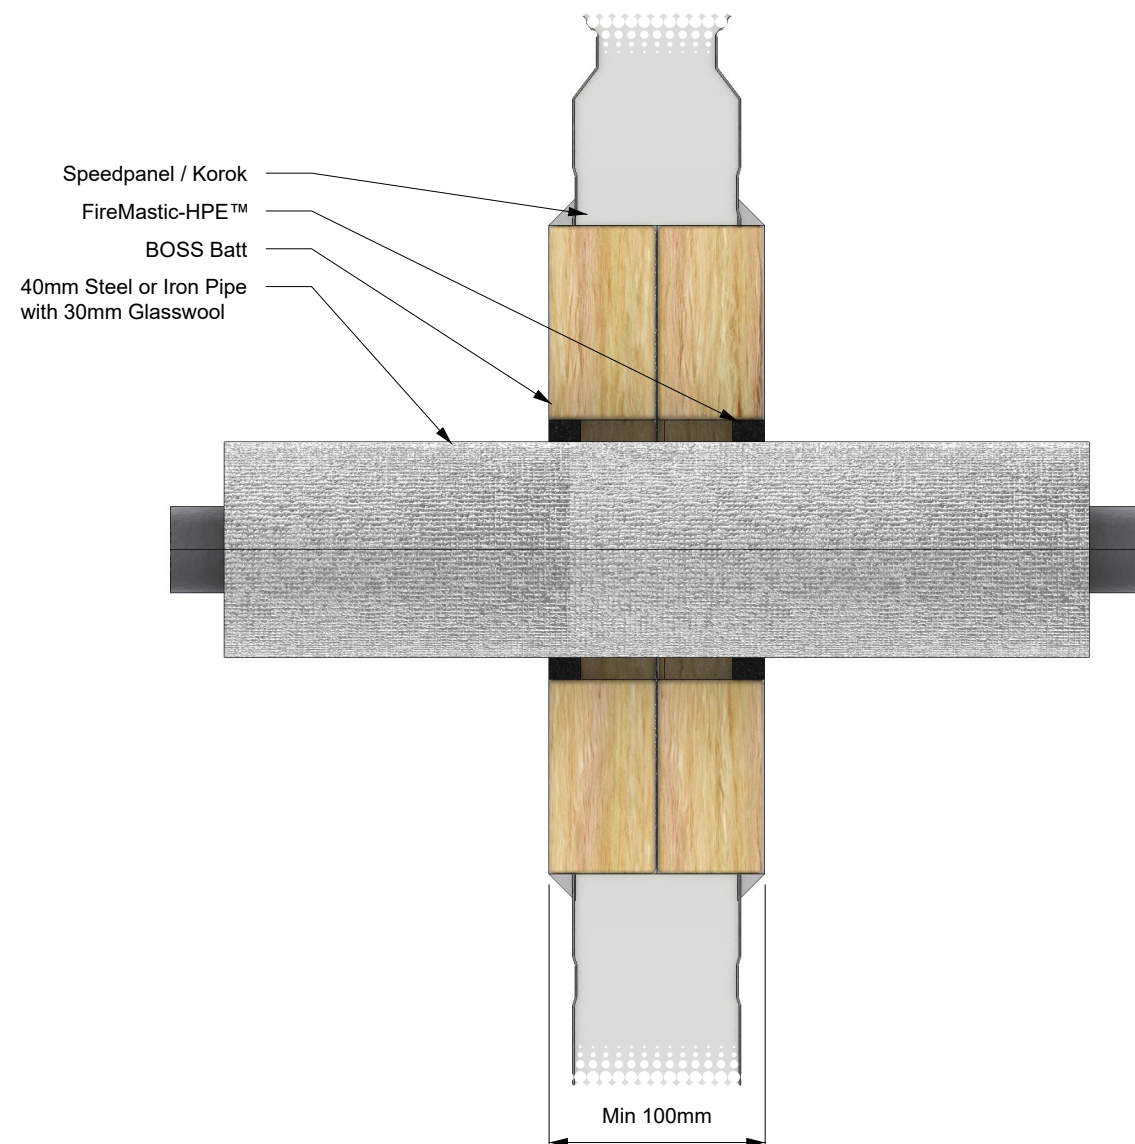

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 40 mm steel or iron pipe with 30 mm thick foil faced glass wool insulation, installed through 100 mm thick double layer of BossBatt in maximum aperture 600 mm x 600 mm. Insulation wrapping is extended 600 mm on both sides. Sealant 15 mm deep in annular gap and finished flush on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	Glasswool insulation	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Steel Pipes	-	-		Report Reference:		WF FAS 190335	
Substrate:	Speedpanel / Korok	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2081.6	
Min Substrate Thickness (mm):	100	115	7.5		Date:		20/12/24	Rev: 01
Sealant Depth (mm):	15	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	600							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.