
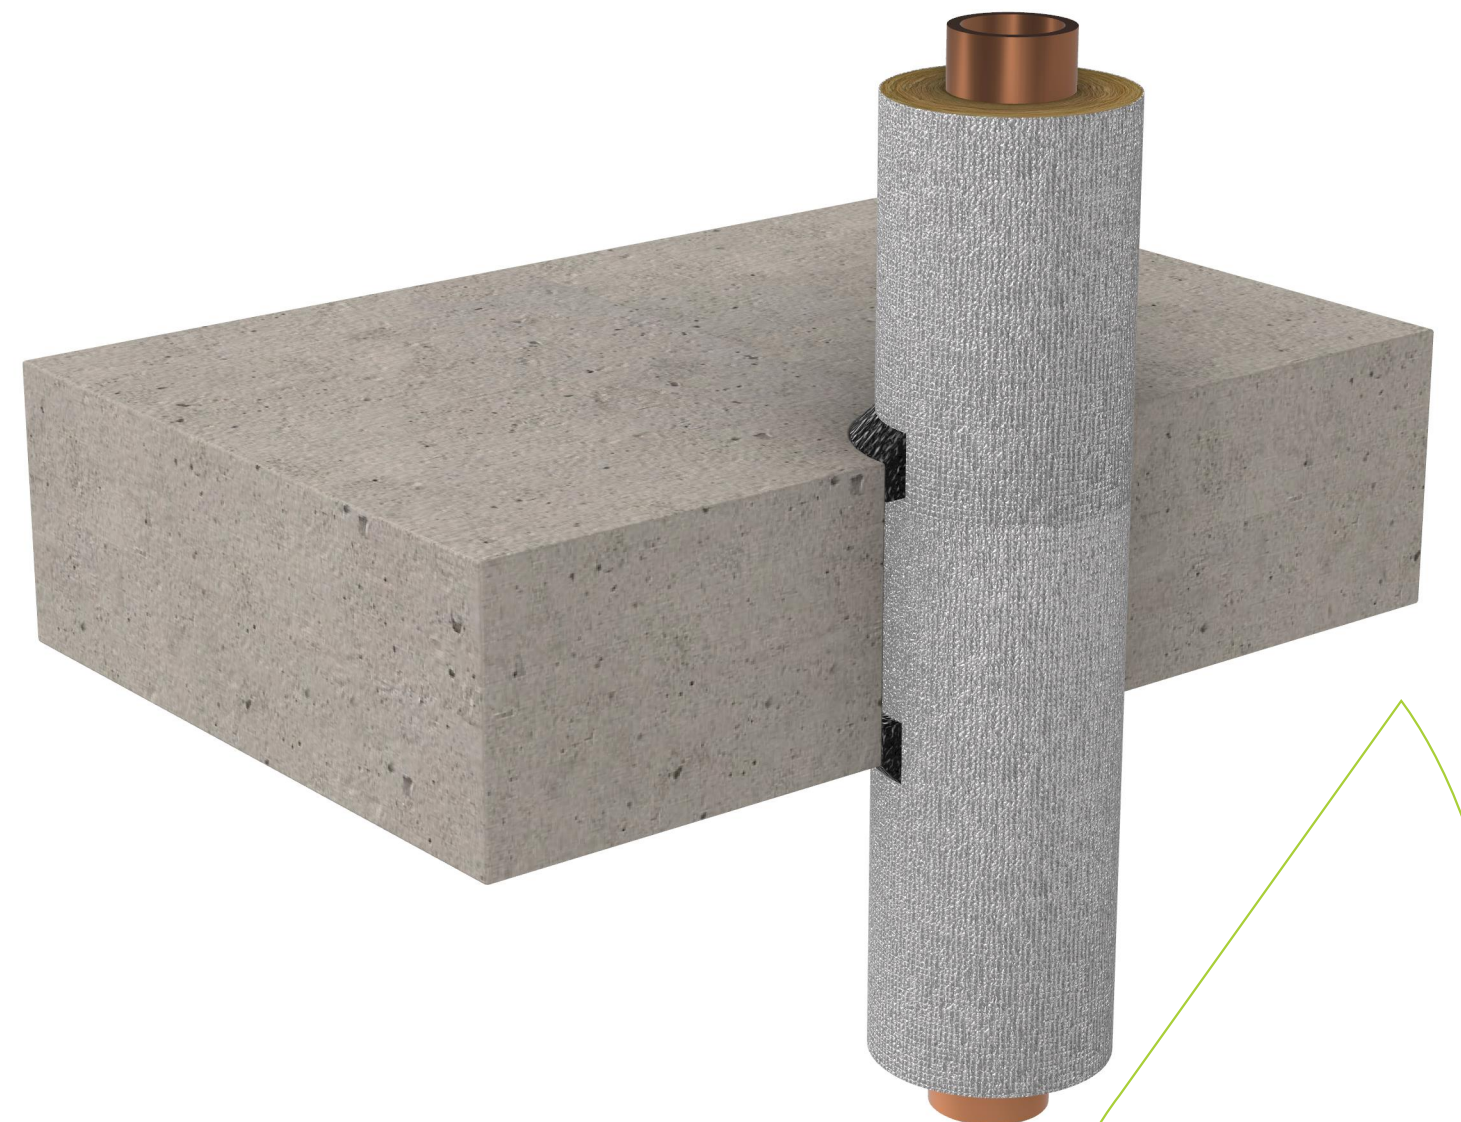


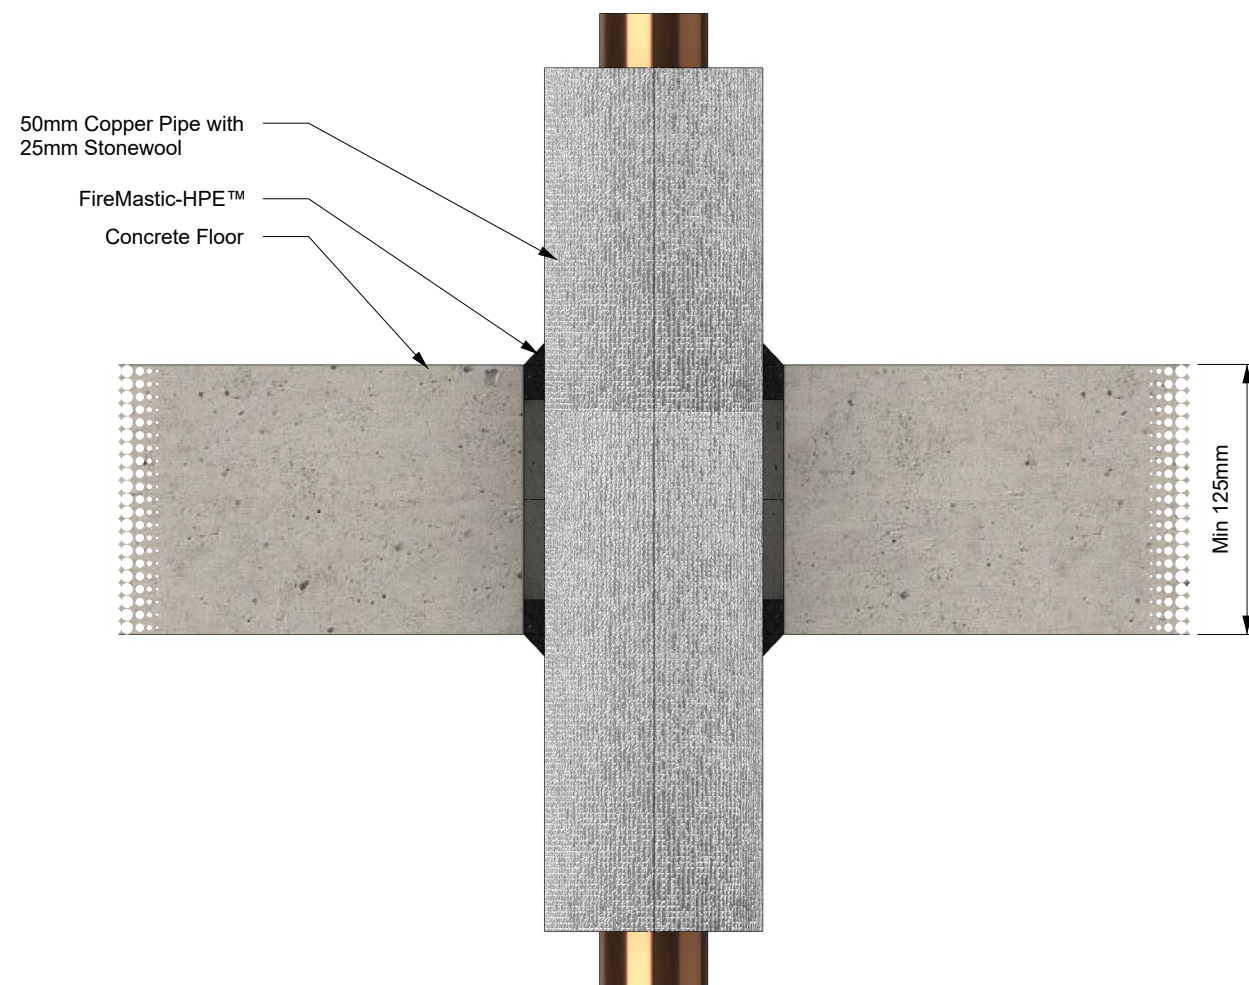

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS FireMastic-HPE™	-	25 mm - 100 mm copper pipe with 25 mm - 50 mm thick stonewool insulation. Sealant 16 mm deep in annular gap with a 10 mm x 10 mm fillet both sides. Insulation wrapping is extended 600 mm on both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	Stonewool insulation	-		Supplementary Standard:		AS 4072.1-2005	
Service:	Insulated Copper Pipes	-	-		Report Reference:		WF FAS 190335	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2084.25	
Min Substrate Thickness (mm):	125	Up to 120	10		Date:		20/12/24	Rev:
Sealant Depth (mm):	16	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	10							
Wrap Length (mm):	600							
FRL / FRR:	-/120/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.