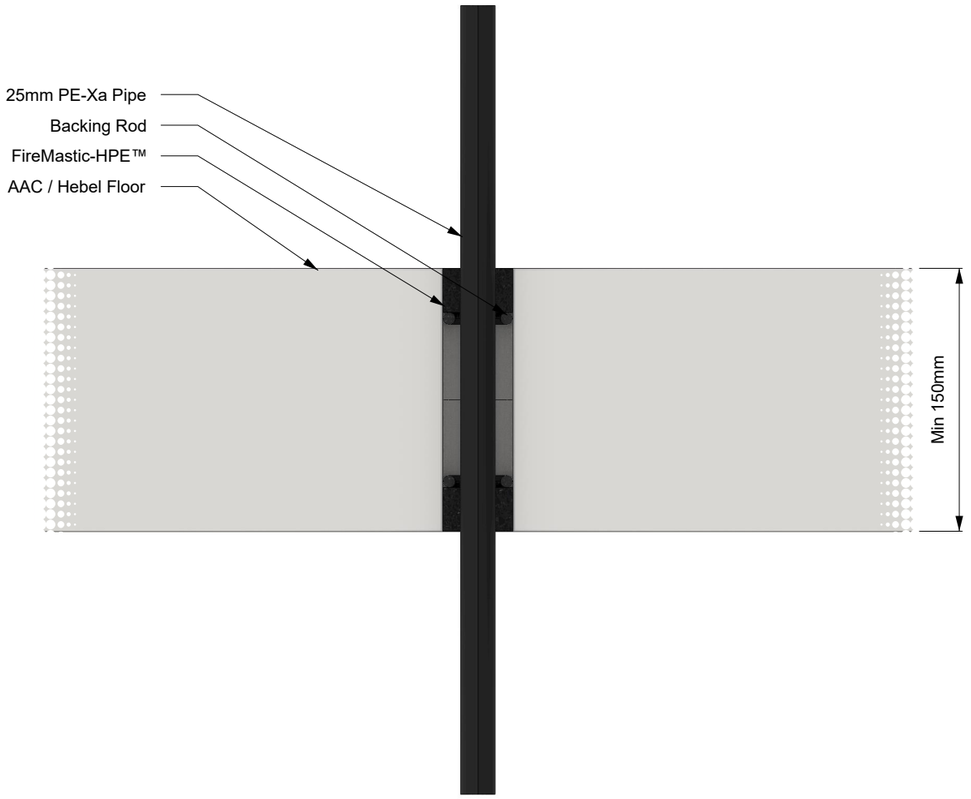

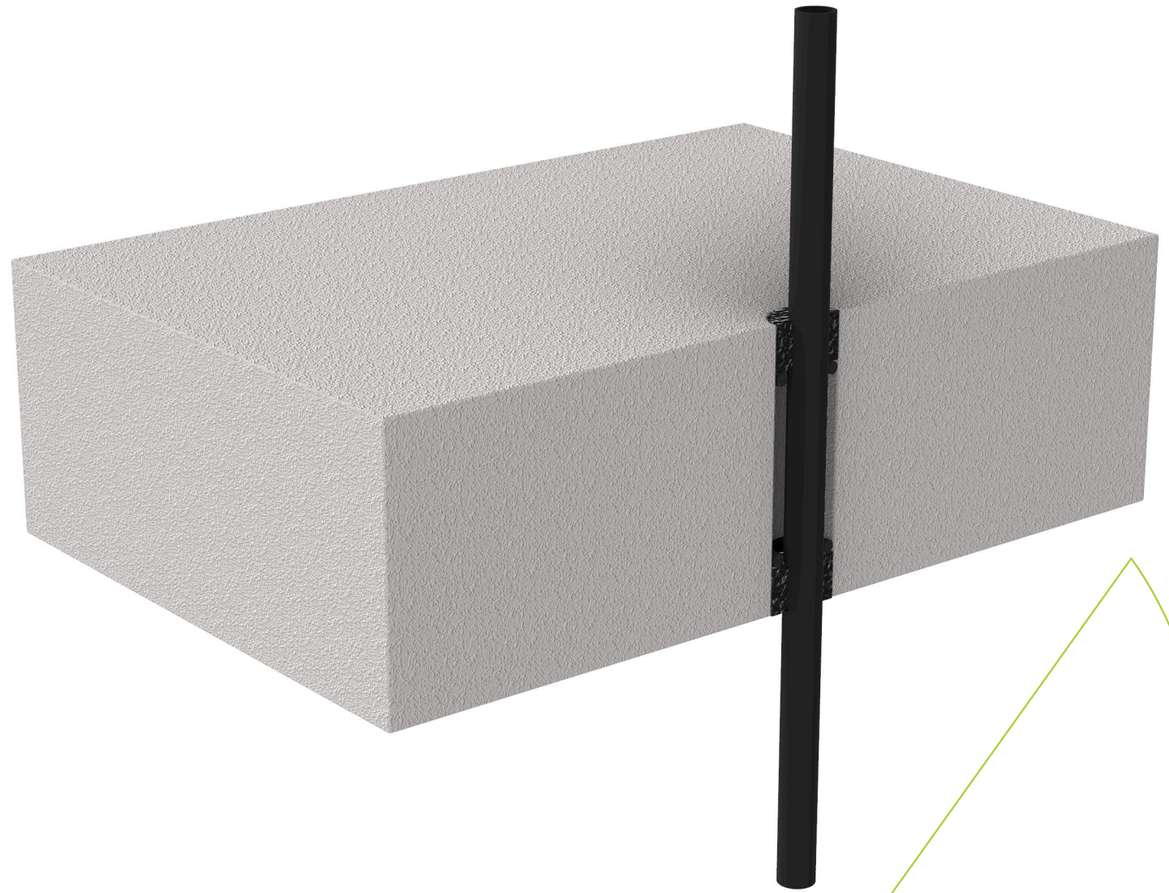

SYSTEM DESCRIPTION	
Orientation:	Floor
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	PEX
Substrate:	AAC / Hebel Floor
Min Substrate Thickness (mm):	150
Sealant Depth (mm):	25
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/240/240

FIRE STOPPING INFORMATION	
BOSS FireMastic-HPE™	-
-	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
40	-
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Up to 20 mm PEX-Xa pipe. Sealant 25 mm deep in annular gap finished flush both sides. The sealant was supported by 10 mm diam. polyethylene backing rods.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2088.26		
Date:	20/12/24	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.