
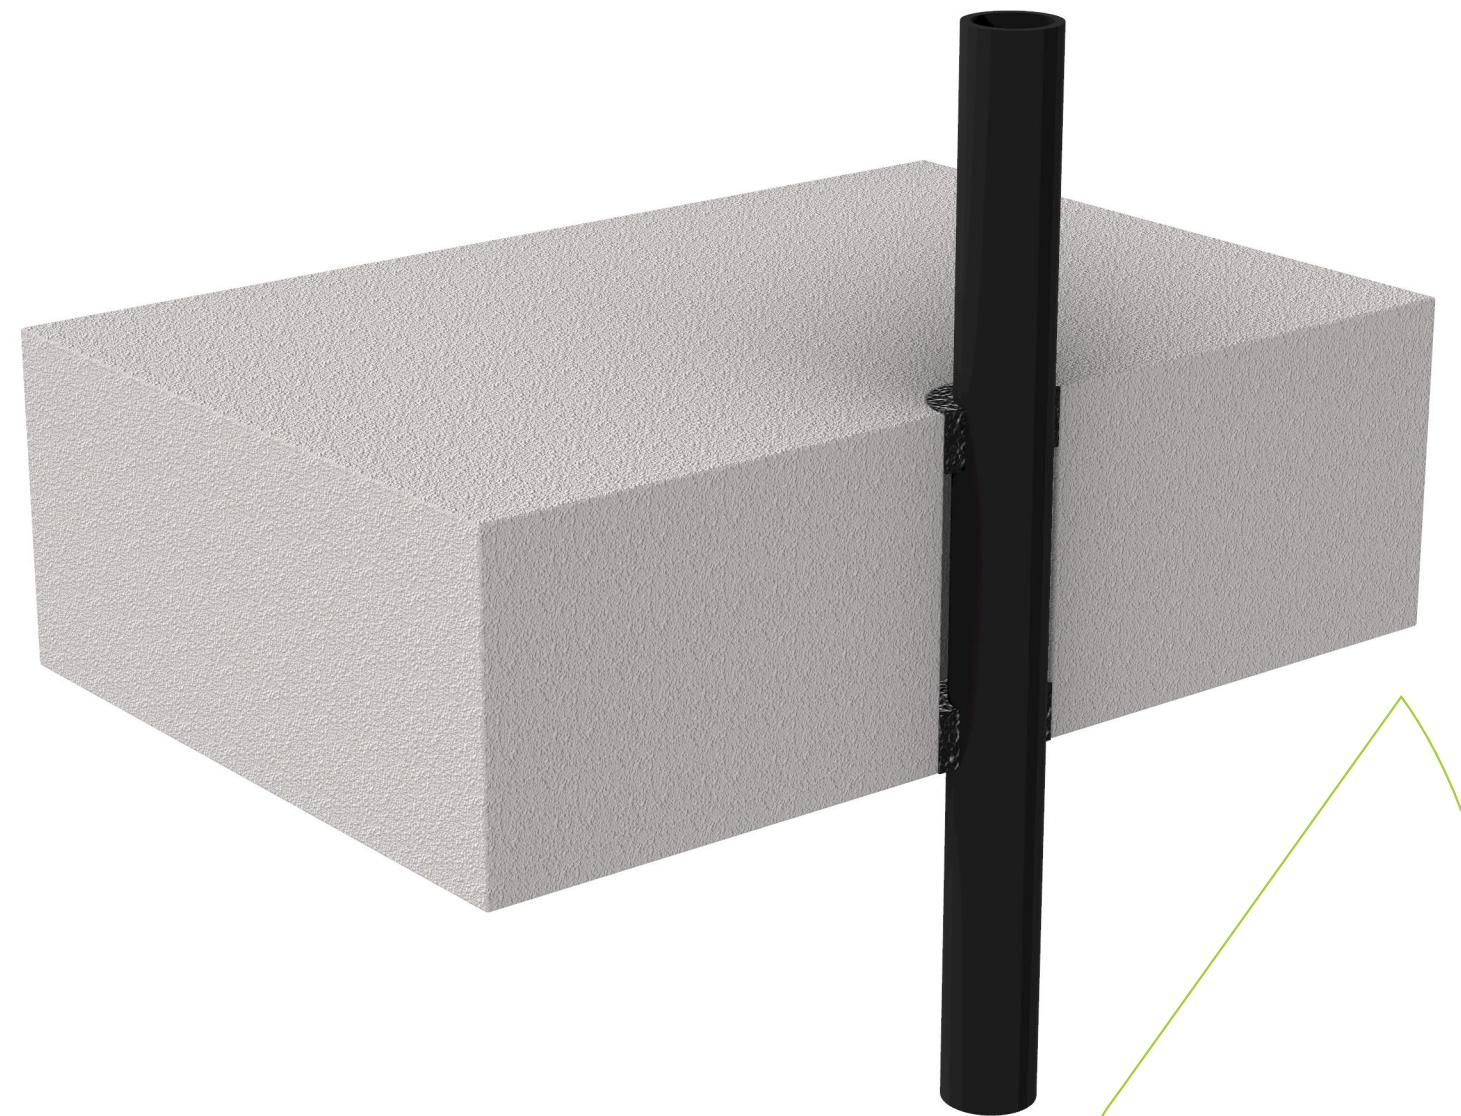


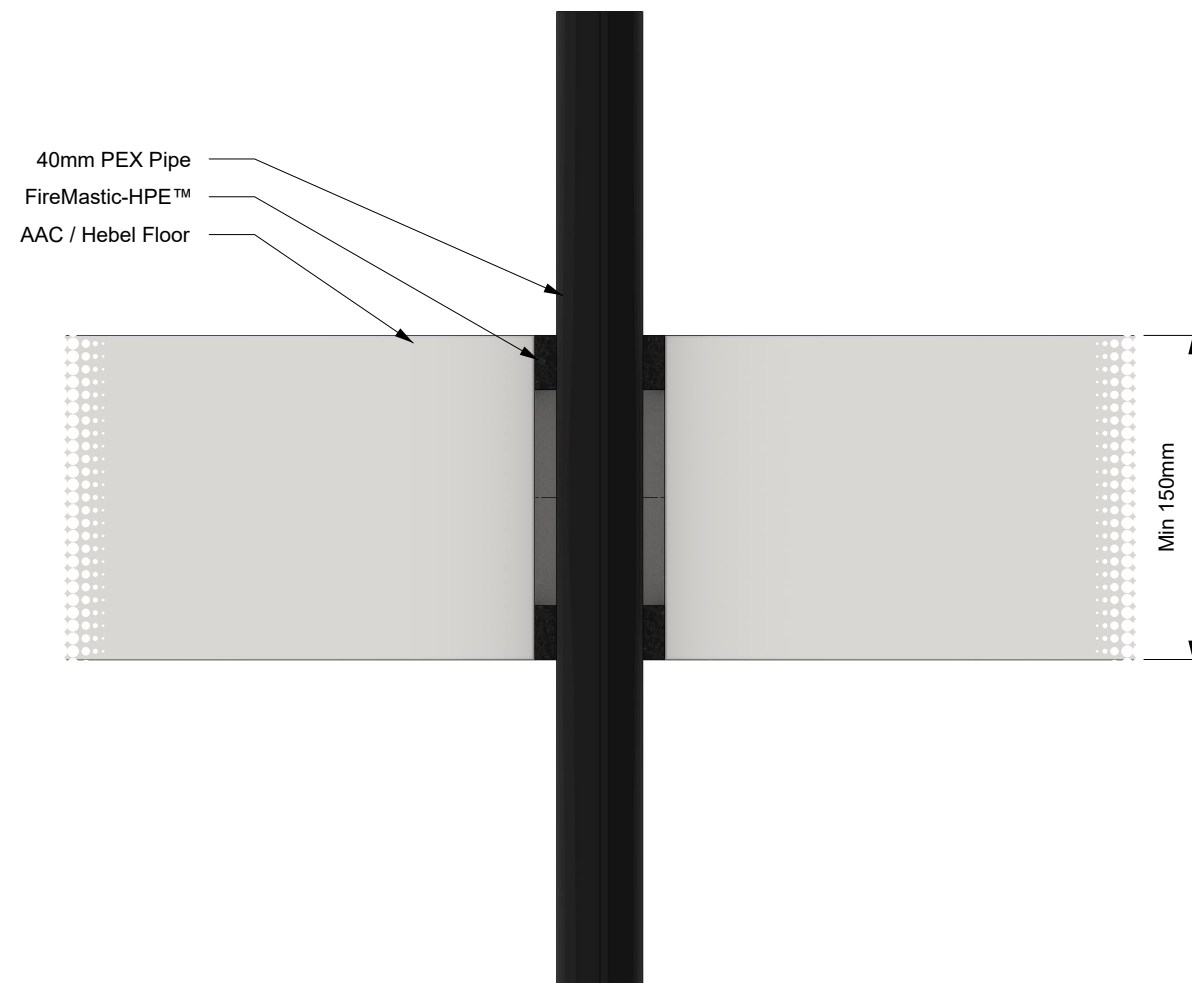

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION								
Orientation:	Floor	BOSS FireMastic-HPE™	-	40 mm x 4 mm wall thickness PEX pipe. Sealant 25 mm deep in annular gap finished flush both sides.	Reference Standard:		AS 1530.4:2014						
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005						
Service:	PEX	-	-		Report Reference:		WF FAS 190335						
Substrate:	AAC / Hebel Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2090.26						
Min Substrate Thickness (mm):	150	-	20		Date:	20/12/24	Rev:	01					
Sealant Depth (mm):	25	ADDITIONAL INFORMATION											
Sealant Fillet (mm):	0	-											
Wrap Length (mm):	-												
FRL / FRR:	-/120/120												

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.