
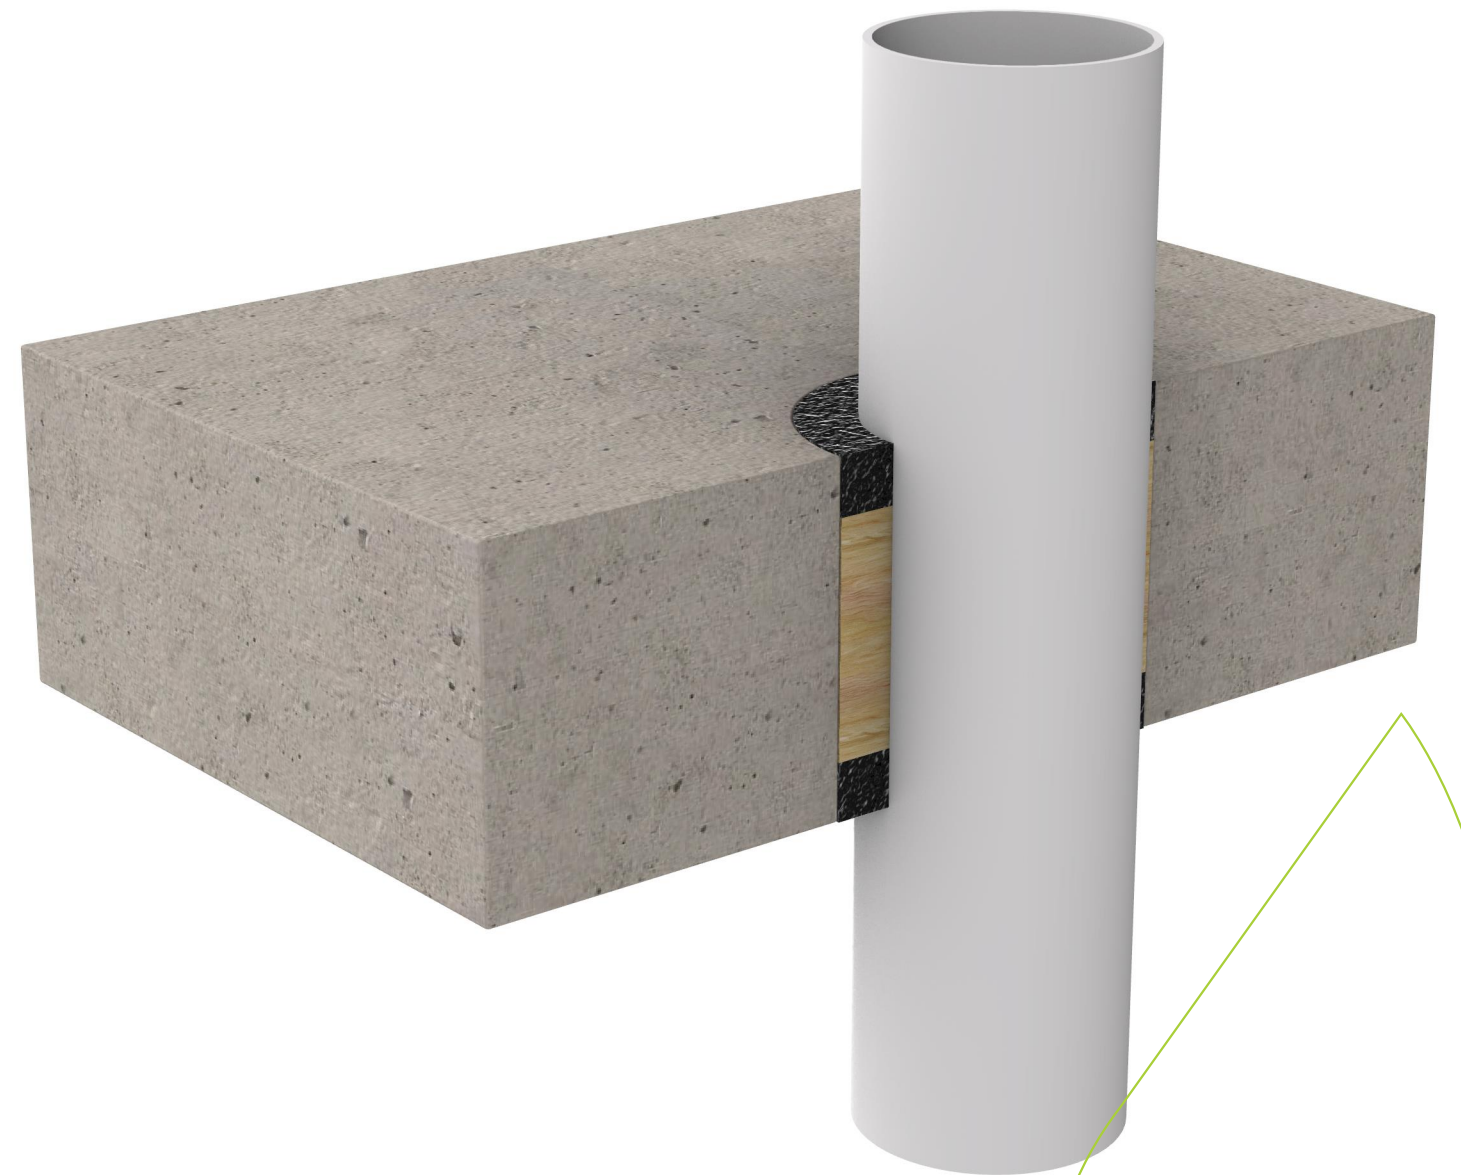


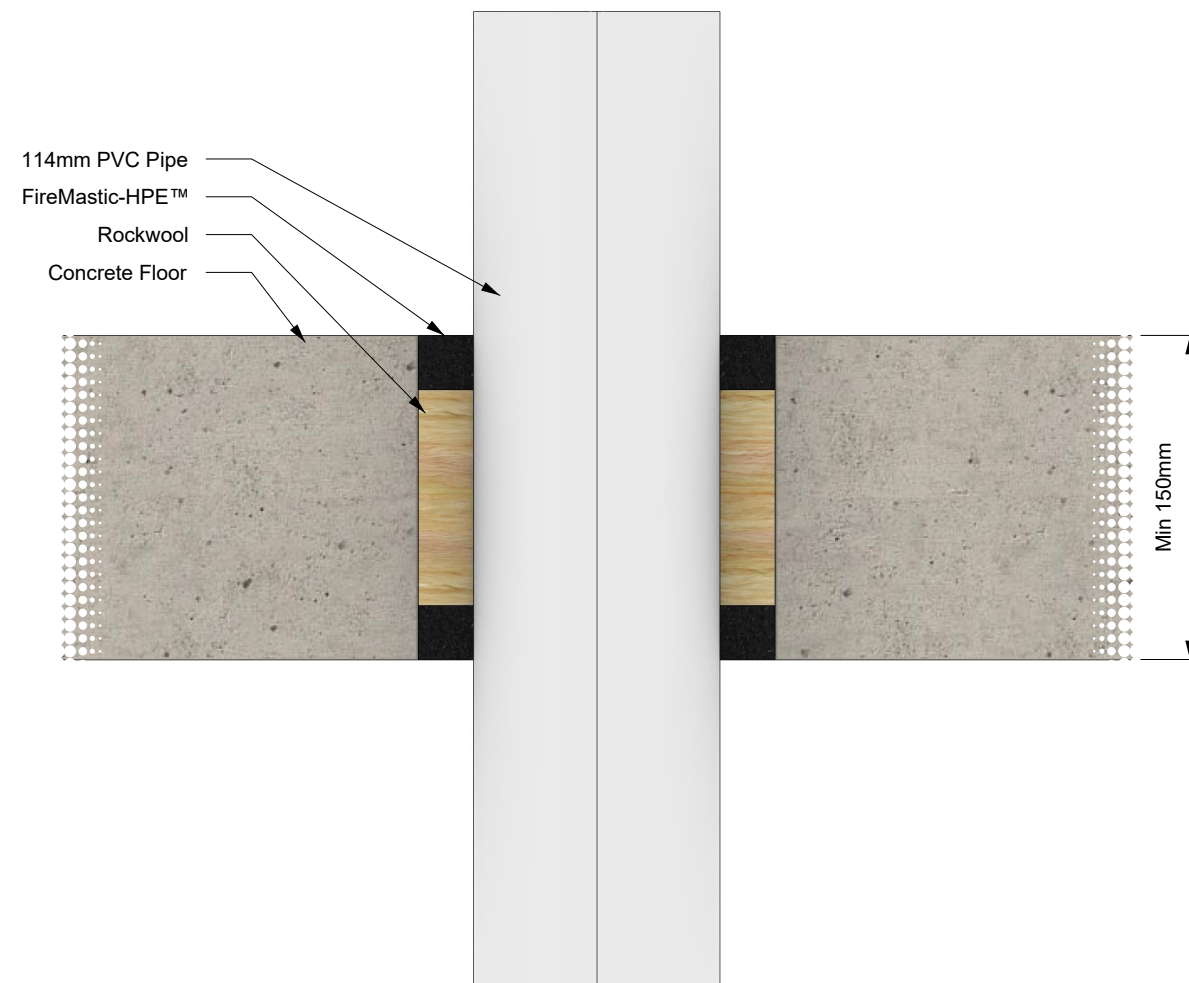

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Floor	BOSS FireMastic-HPE™	-	114 mm x 8.1 mm wall thickness PVC pipe. Sealant 25 mm deep in annular gap finished flush both sides. The system also includes a 100 mm deep infill friction fitted stone wool insulation, centrally located in the annular gap through the floor system.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005		
Service:	UPVC	-	-		Report Reference:		WF FAS 190335		
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2100.25		
Min Substrate Thickness (mm):	150	-	25.5		Date:	20/12/24	Rev:	01	
Sealant Depth (mm):	25	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	0	-							
Wrap Length (mm):	-								
FRL / FRR:	-/120/30								