
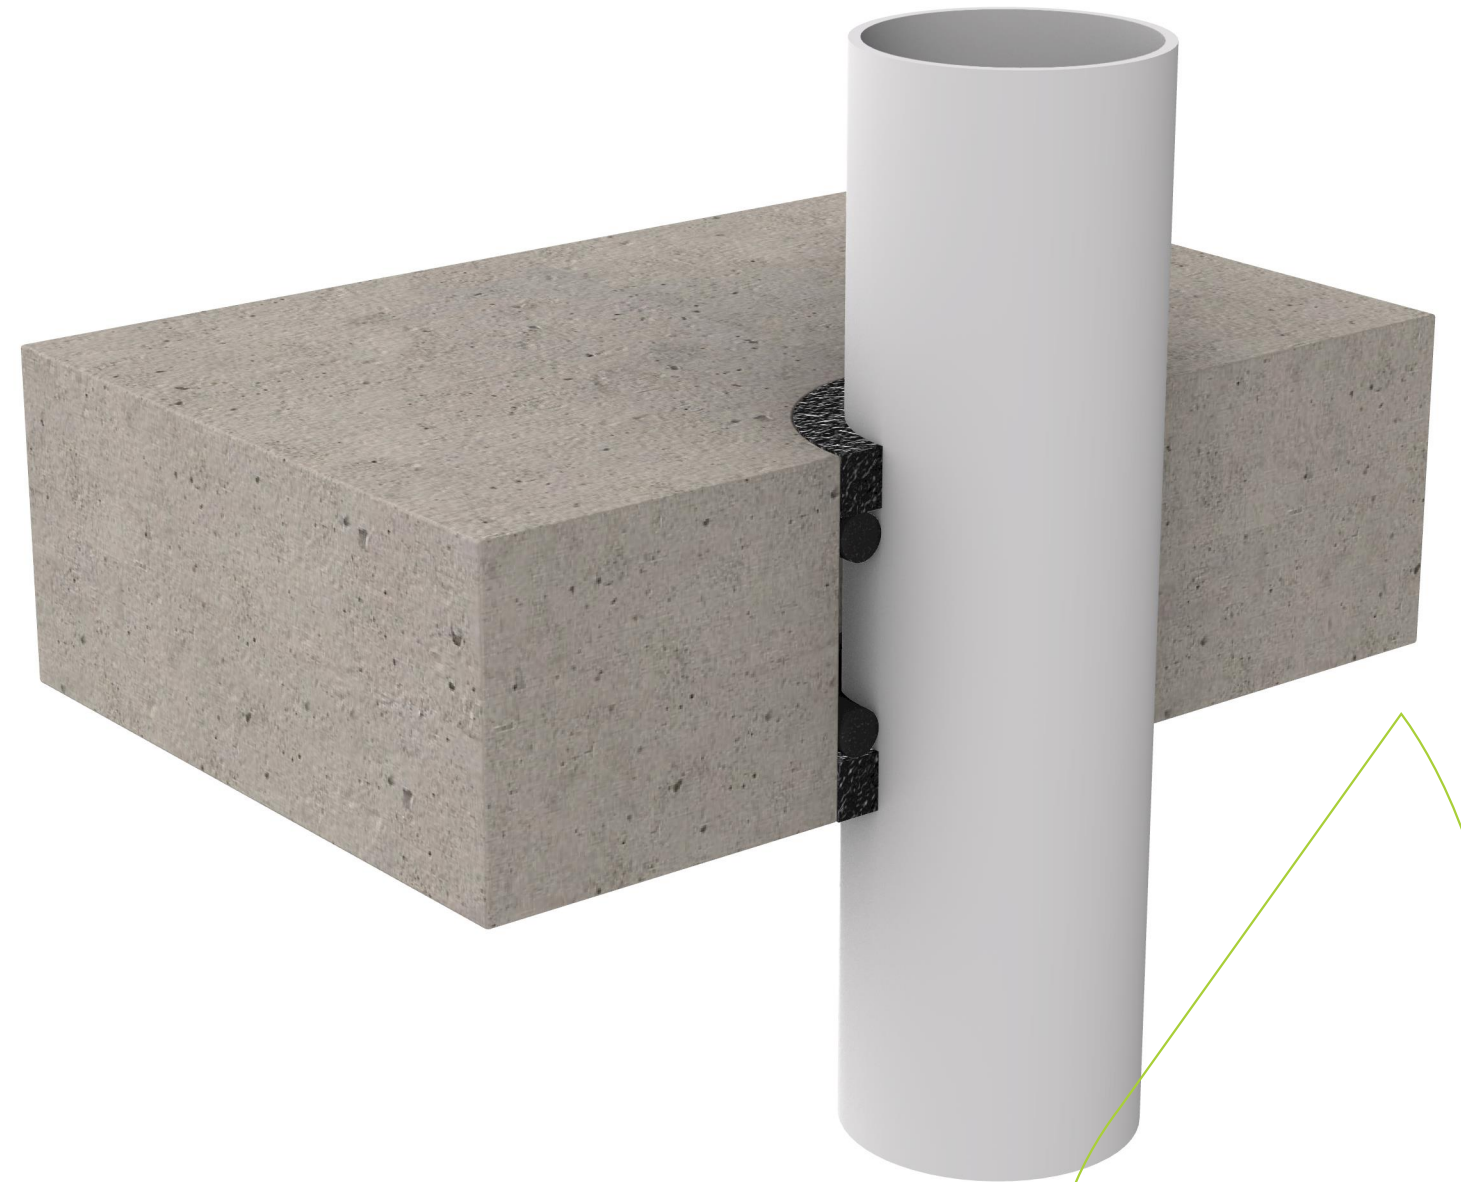


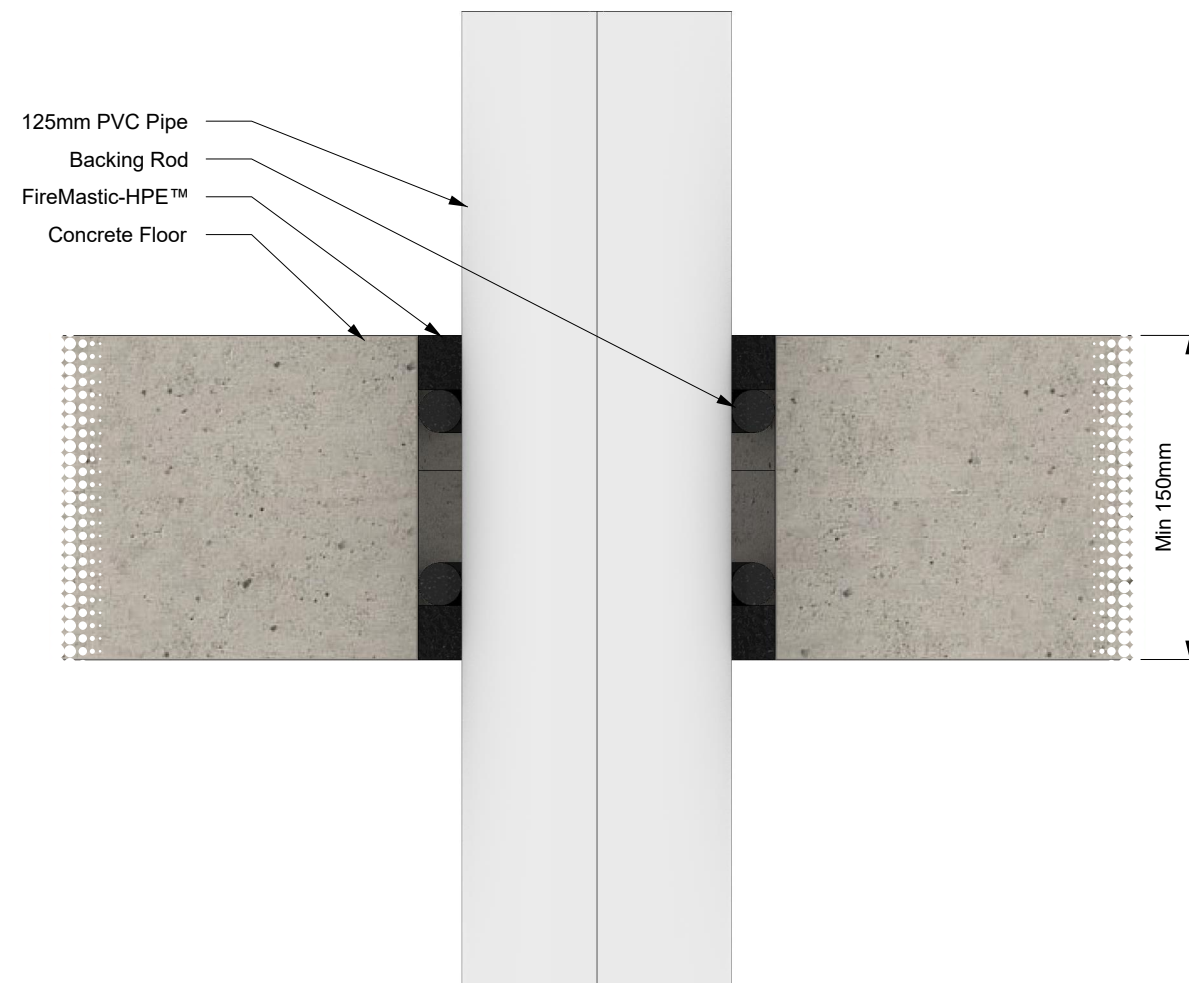

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Floor	BOSS FireMastic-HPE™	-	125 mm x 4.8 mm wall thickness PVC pipe. Sealant 25 mm deep in annular gapfinished flush both sides. The sealant was supported by 10 mm diam. Polyethylene back rods.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		WF FAS 190335	
Substrate:	Concrete Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2103.25	
Min Substrate Thickness (mm):	150	-	20		Date:		20/12/24	Rev:
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/120/90							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.