
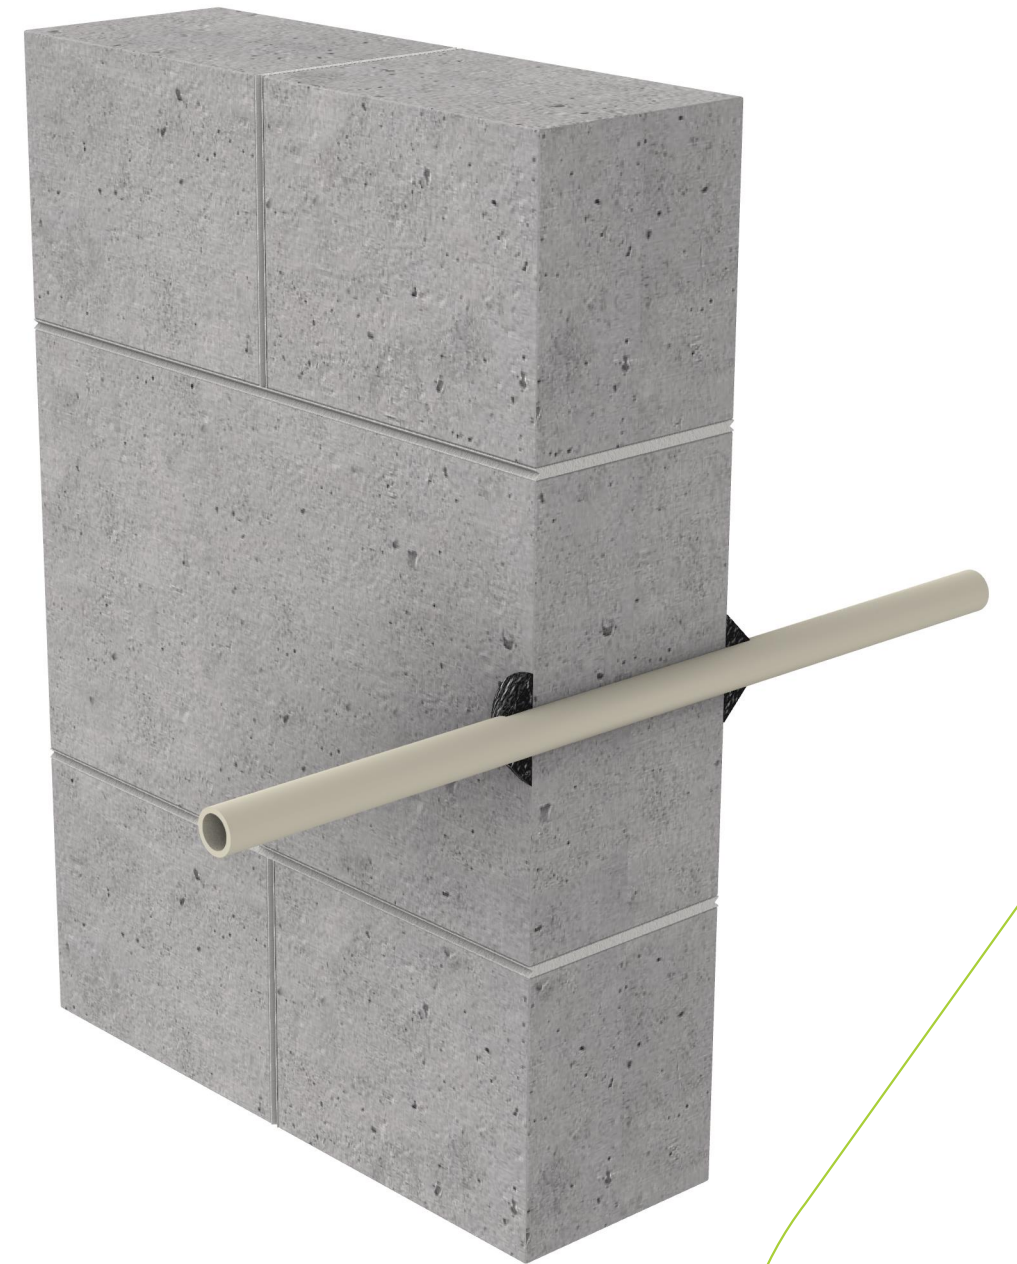


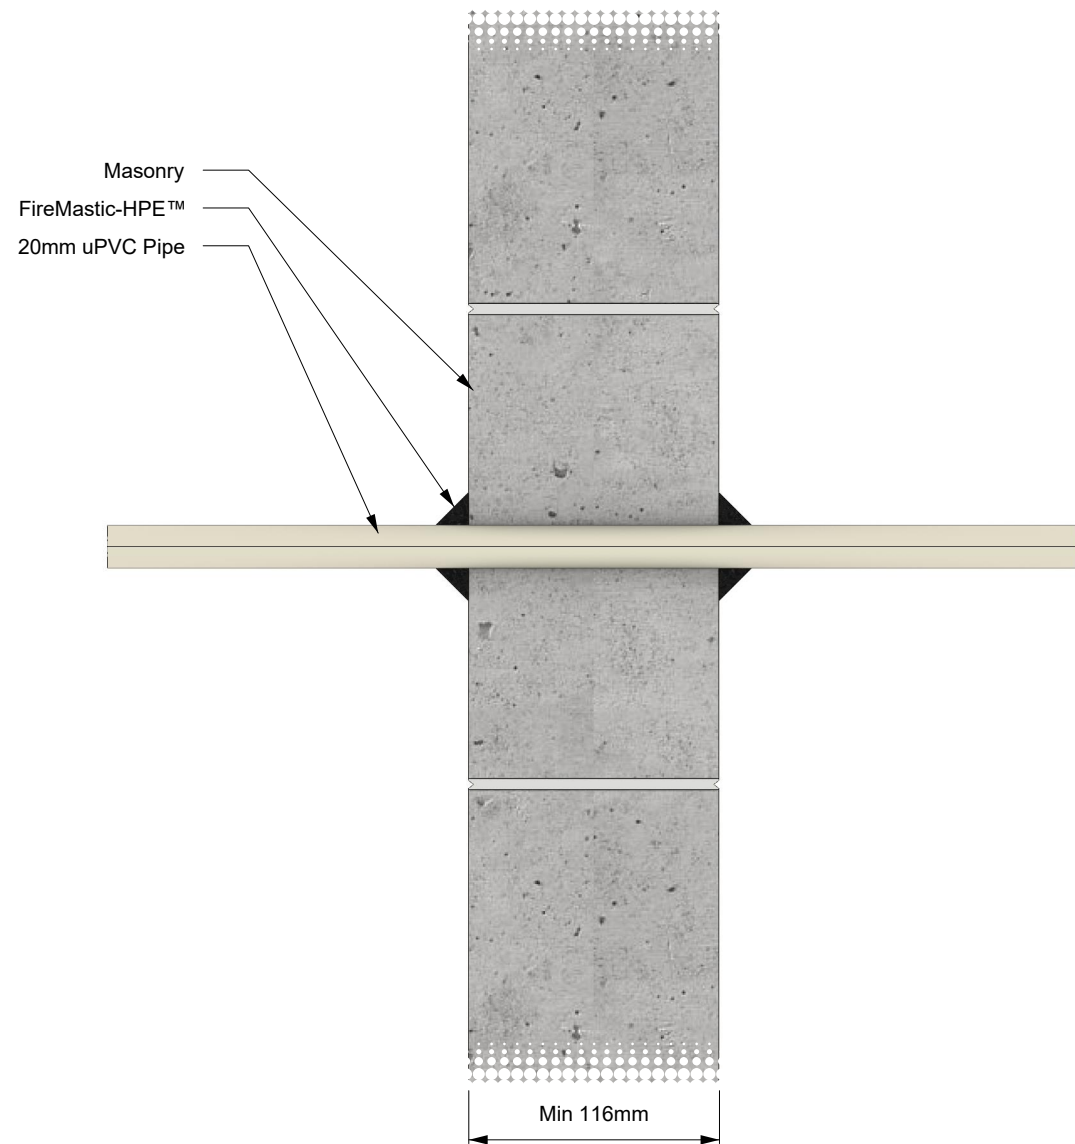

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS		SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 20 mm uPVC pipe. Sealant 15 mm fillet both sides of the wall.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005		
Service:	UPVC	-	-		Report Reference:		WF FAS 190335		
Substrate:	Masonry	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2107.5		
Min Substrate Thickness (mm):	116	-	0		Date:	20/12/24	Rev:	01	
Sealant Depth (mm):	0	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	15								
Wrap Length (mm):	-								
FRL / FRR:	-/120/120								