


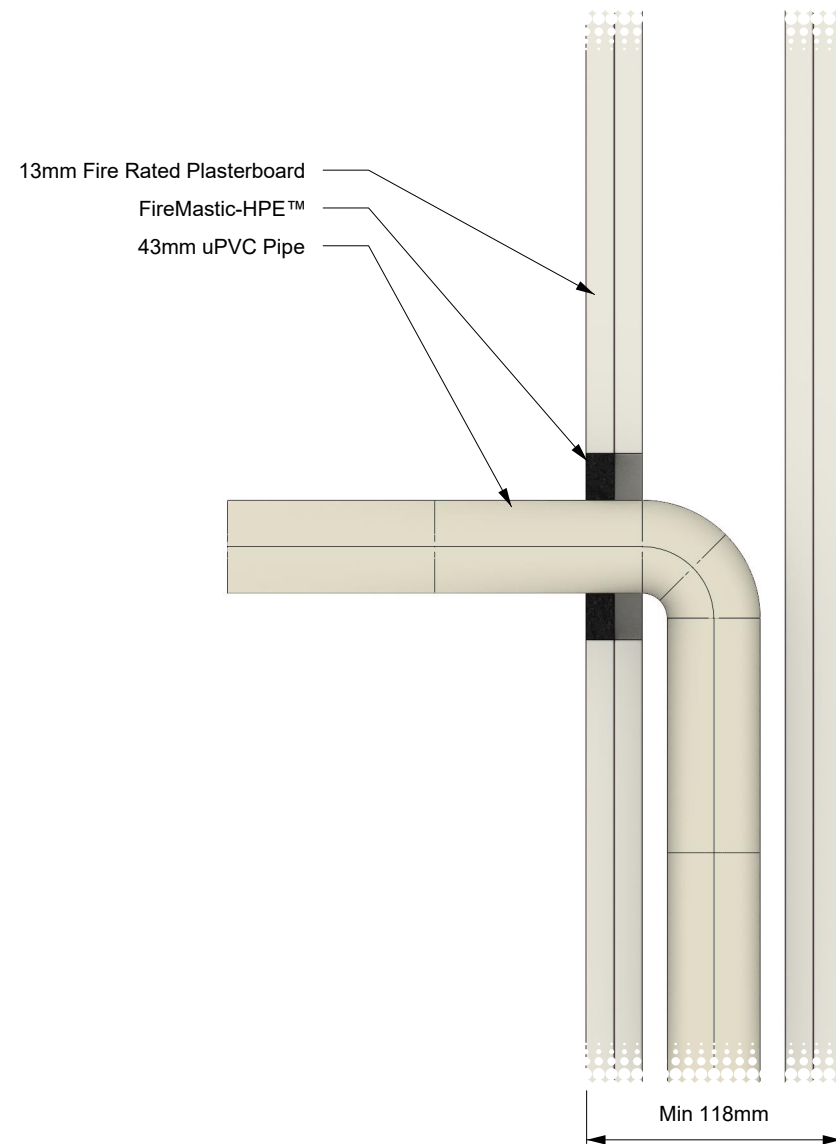

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	1-sided installation . System is approved for installation in both directions. Up to 43 mm uPVC pipe. Sealant depth of plasterboard in annular gap finished flush.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		WF FAS 190335	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2114.2	
Min Substrate Thickness (mm):	118.0	-	21.5		Date:		06/11/25	Rev: 01
Sealant Depth (mm):	13.0	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0.0							
Wrap Length (mm):	-							
FRL / FRR:	-/90/90							