
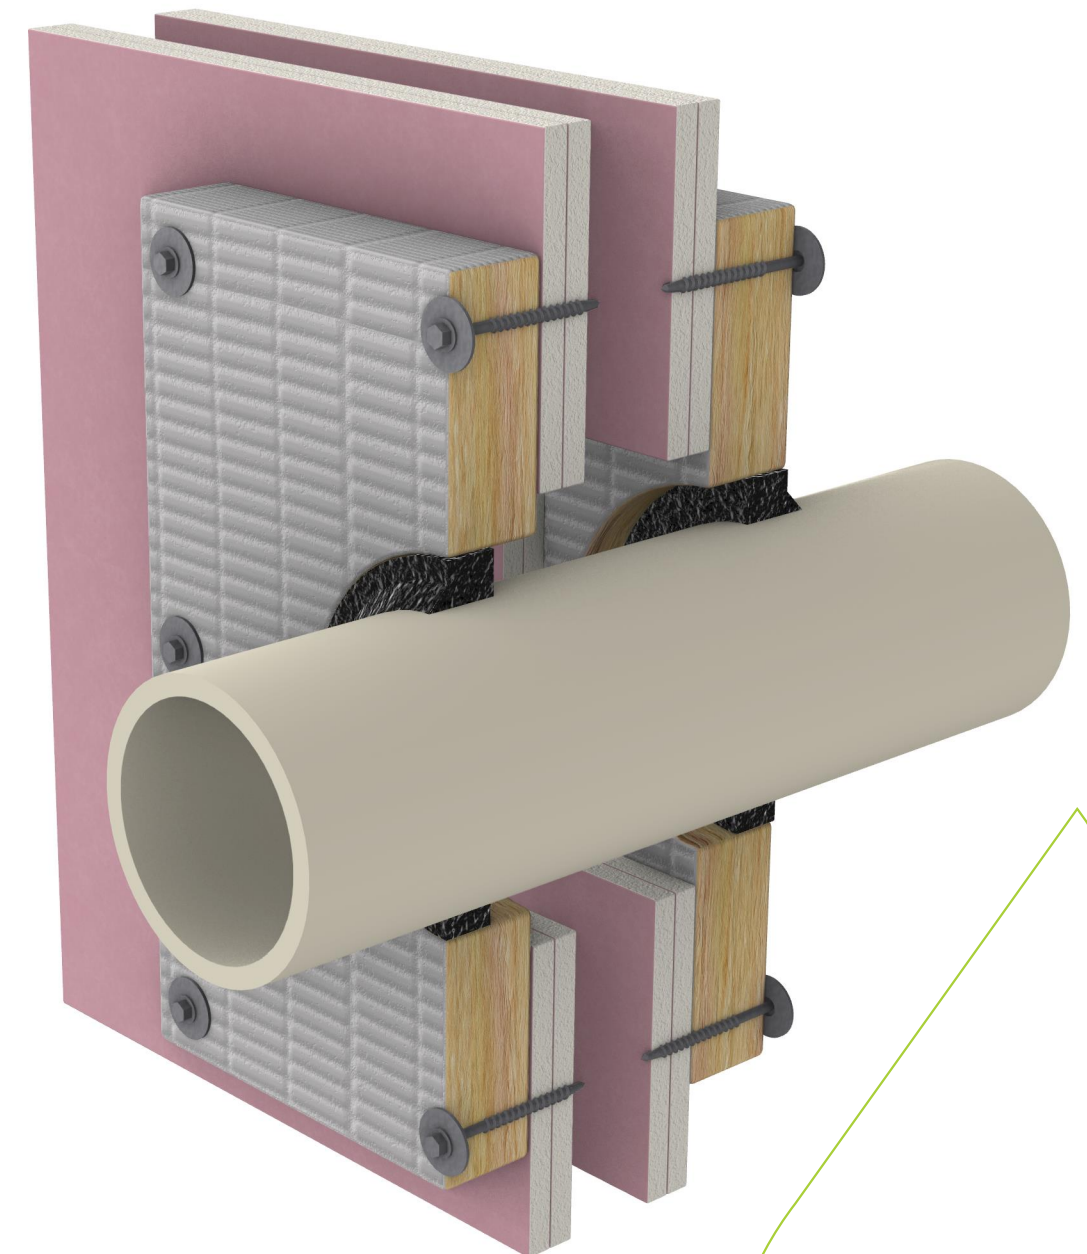


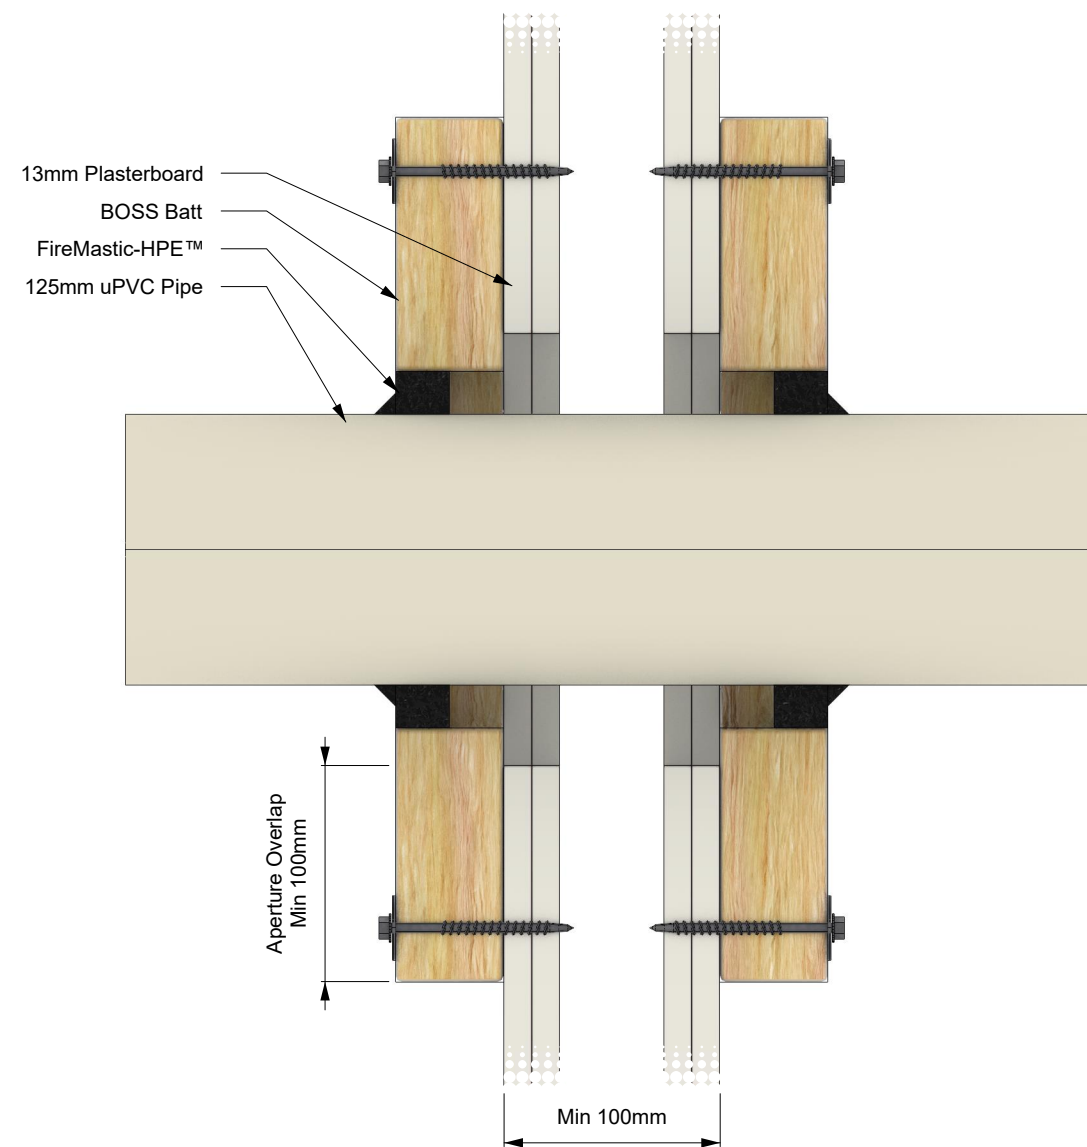

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 125 x 9.2 mm wall thickness uPVC pipe. Sealant to depth of plaster-board in 20 mm annular gap with additional 10 mm × 10 mm fillet both sides.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005		
Service:	UPVC	-	-		Report Reference:		WF FAS 190335		
Substrate:	2 layers BOSS Batt - Pattress fitted either side	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2116.14		
Min Substrate Thickness (mm):	100.0	165	20		Date:	06/11/25	Rev:	01	
Sealant Depth (mm):	25.0	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	10.0	-							
Wrap Length (mm):	-								
FRL / FRR:	-/60/60								

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.