
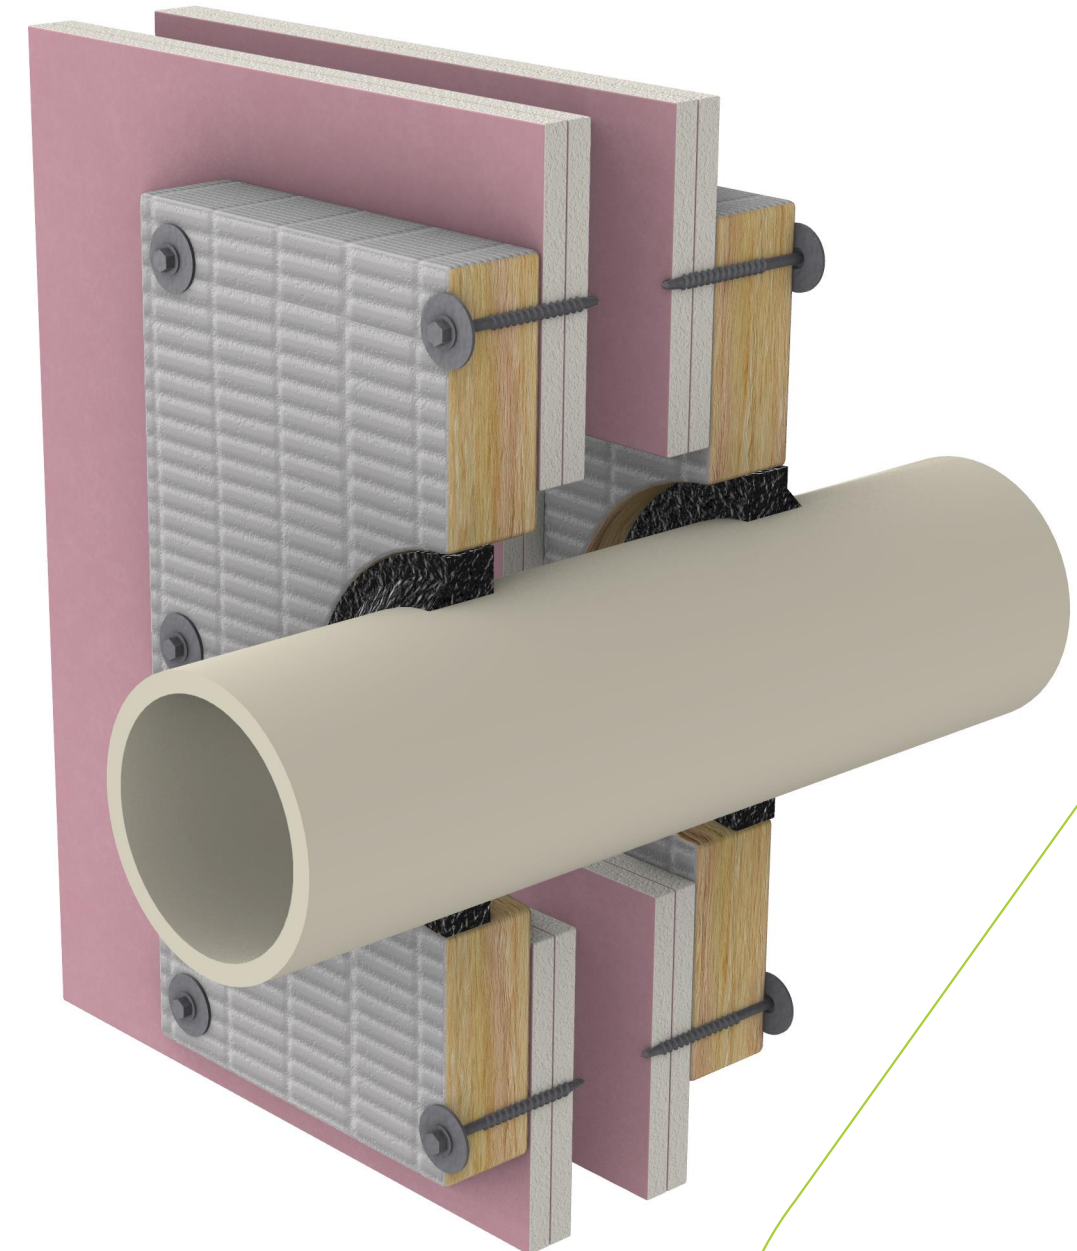


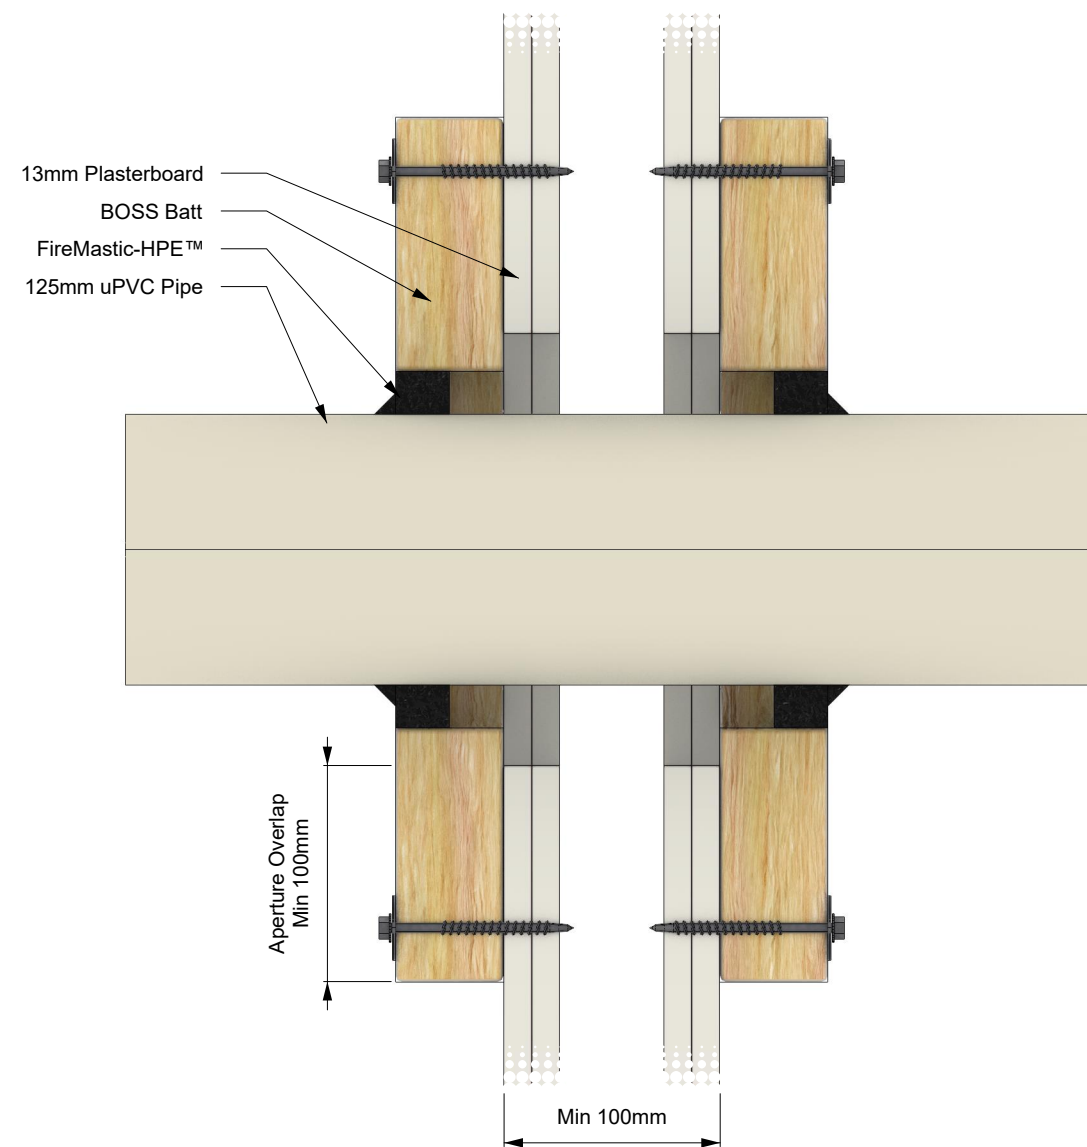

SYSTEM DESCRIPTION

Orientation:	Wall
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	UPVC
Substrate:	2 layers BOSS Batt - Pattress fitted either side
Min Substrate Thickness (mm):	100.0
Sealant Depth (mm):	25.0
Sealant Fillet (mm):	10.0
Wrap Length (mm):	-
FRL / FRR:	-/30/30

FIRE STOPPING INFORMATION

BOSS FireMastic-HPE™	-
-	-
-	-
APERTURE (mm)	ANNULAR GAP (mm)
165	20
ADDITIONAL INFORMATION	
-	-

SERVICE SIZE & DETAILS

Up to 125 x 1.8 mm wall thickness uPVC pipe. Sealant to depth of plaster-board in 20 mm annular gap with additional 10 mm x 10 mm fillet both sides.	
--	--

SUPPORTING INFORMATION

Reference Standard:		AS 1530.4:2014	
Supplementary Standard:		AS 4072.1-2005	
Report Reference:		WF FAS 190335	
Drawing Number:		BF-2117.14	
Date:	06/11/25	Rev:	01