
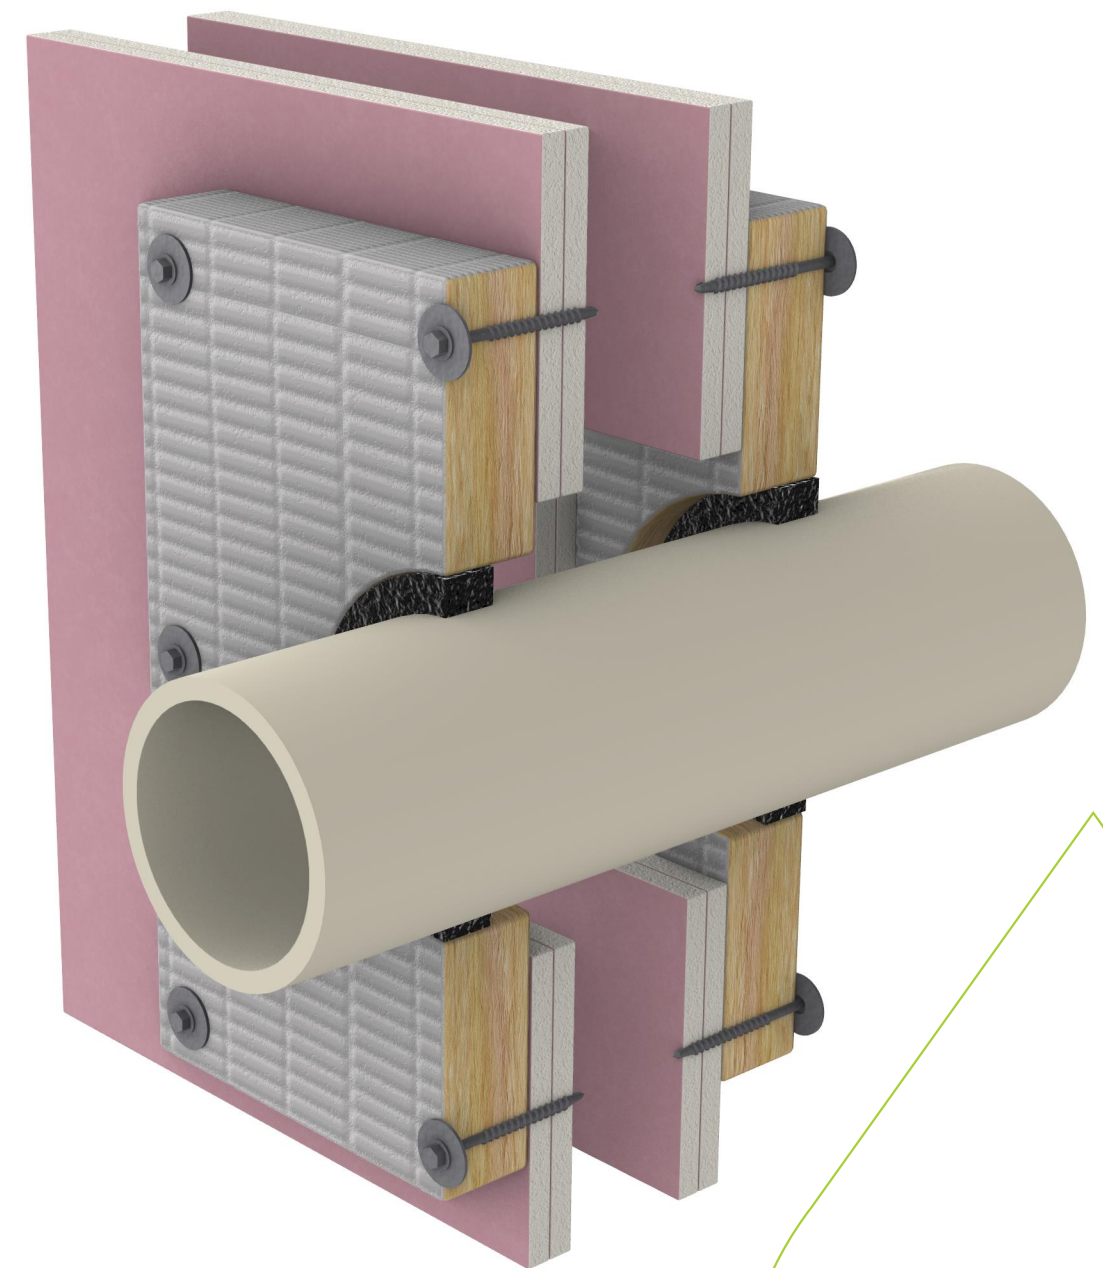


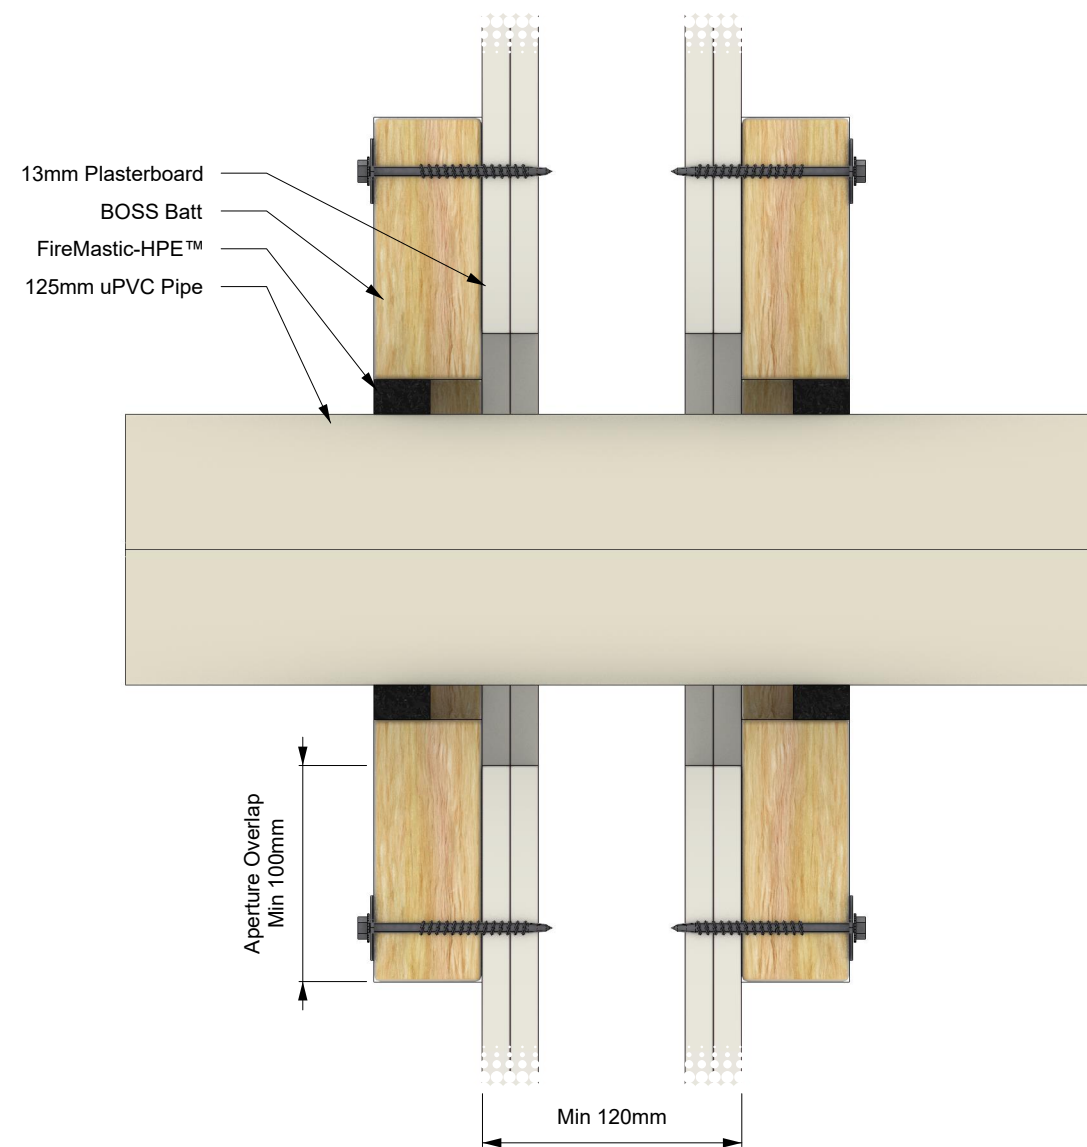

SYSTEM DESCRIPTION

Orientation:	Wall
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	UPVC
Substrate:	2 layers BOSS Batt - Pattress fitted either side
Min Substrate Thickness (mm):	120.0
Sealant Depth (mm):	25.0
Sealant Fillet (mm):	0.0
Wrap Length (mm):	-
FRL / FRR:	-/120/120

FIRE STOPPING INFORMATION

BOSS FireMastic-HPE™	-
-	-
-	-
APERTURE (mm)	ANNULAR GAP (mm)
157	16
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Tested Uncapped/Capped - Up to 125 x 4.8 mm wall thickness uPVC pipe. Sealant to depth of plasterboard in 16 mm annular gap finished flush both sides.	
--	--

SUPPORTING INFORMATION

Reference Standard:		AS 1530.4:2014	
Supplementary Standard:		AS 4072.1-2005	
Report Reference:		WF FAS 190335	
Drawing Number:		BF-2119.14	
Date:	06/11/25	Rev:	01

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.