
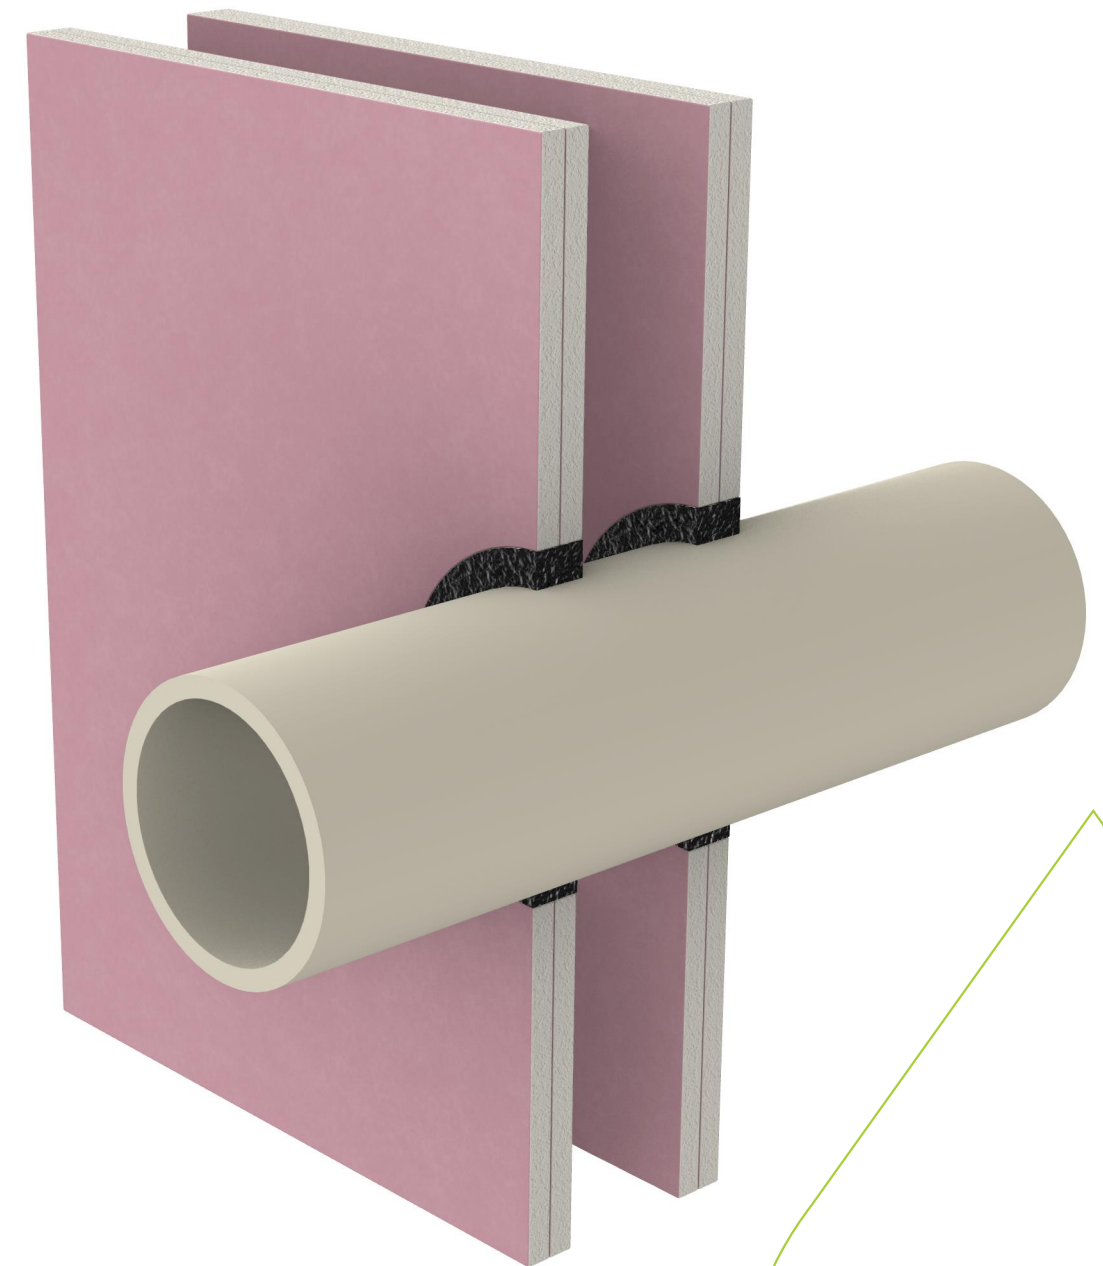


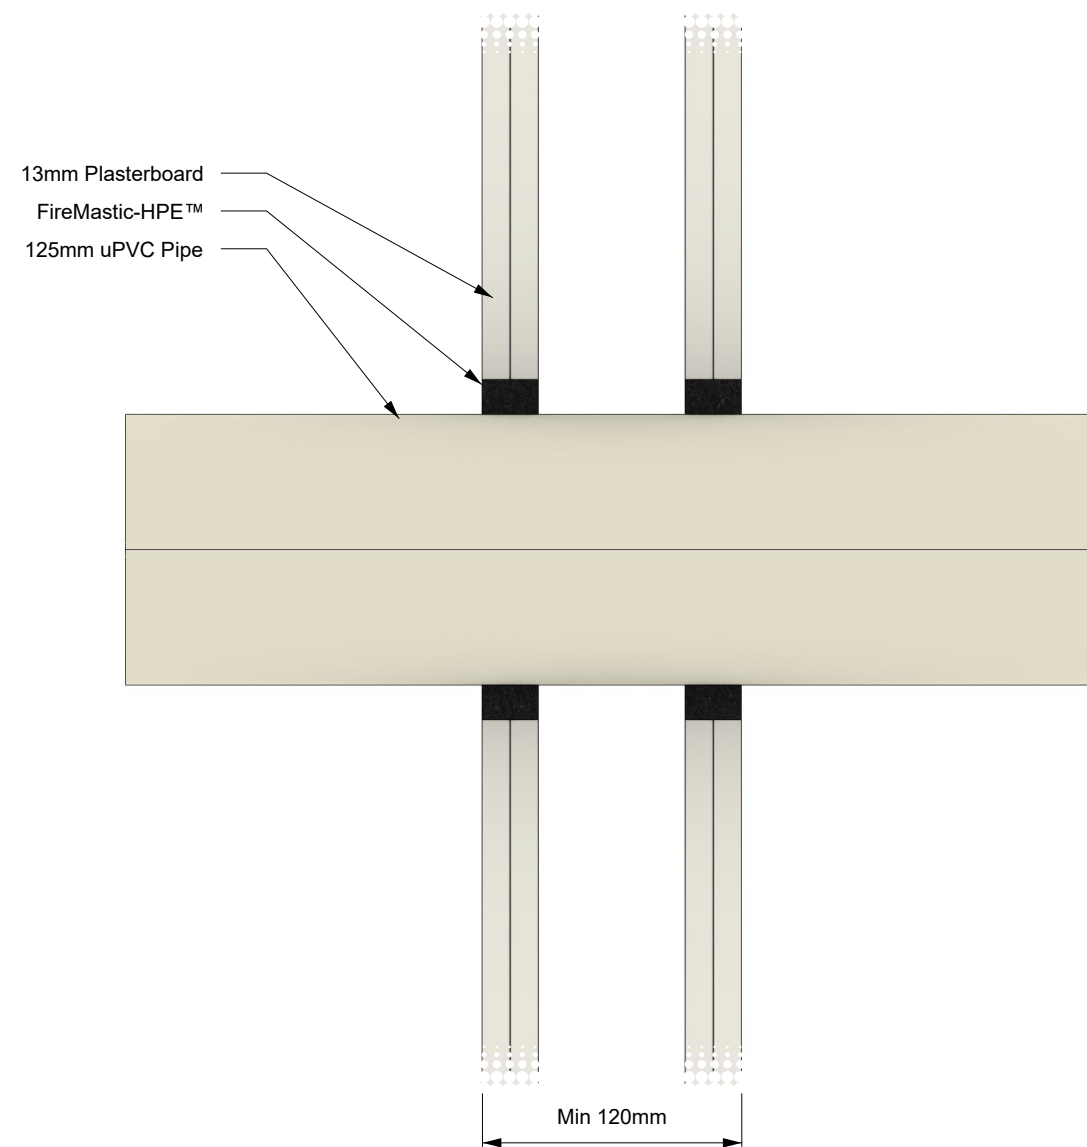

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Wall	BOSS FireMastic-HPE™	-	Tested Uncapped/Capped - Up to 125 x 4.8 mm wall thickness uPVC pipe. Sealant to depth of plasterboard in 16 mm annular gap finished flush both sides.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005		
Service:	UPVC	-	-		Report Reference:		WF FAS 190335		
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2119.2		
Min Substrate Thickness (mm):	120.0	157	16		Date:	06/11/25	Rev:	01	
Sealant Depth (mm):	25.0	ADDITIONAL INFORMATION							
Sealant Fillet (mm):	0.0	-							
Wrap Length (mm):	-								
FRL / FRR:	-/120/120								