


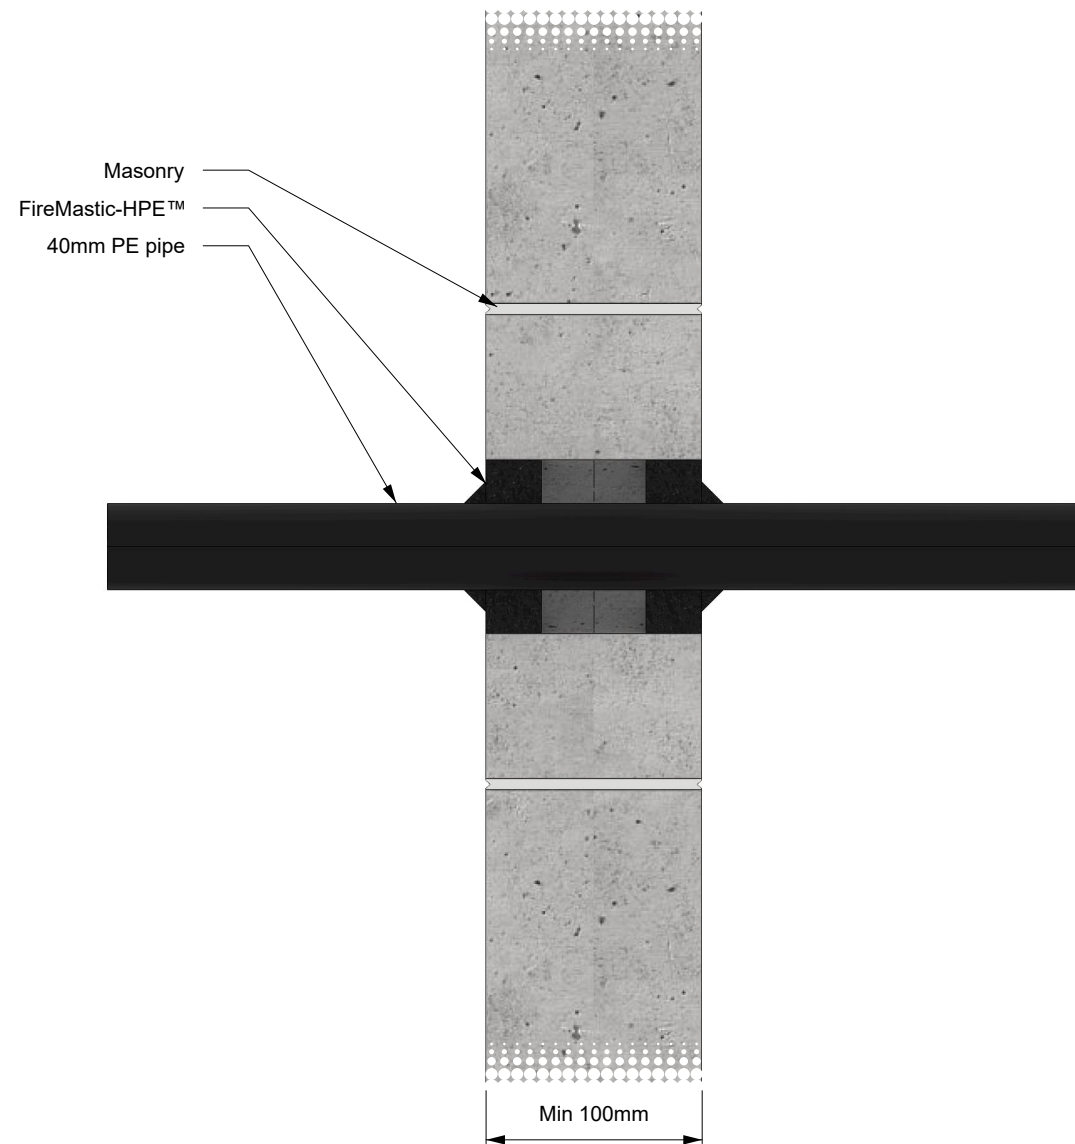

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION					
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 40 mm x 3.7 mm wall thickness PE pipe. Sealant to depth of plaster-board in 20 mm annular gap with 10 mm x 10 mm fillet both sides.	Reference Standard:		AS 1530.4:2014			
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005			
Service:	PE	-	-		Report Reference:		WF FAS 190335			
Substrate:	Masonry	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2125.5			
Min Substrate Thickness (mm):	100.0	80	20			Date:		06/11/25	Rev:	01
Sealant Depth (mm):	25.0	ADDITIONAL INFORMATION								
Sealant Fillet (mm):	10.0	-								
Wrap Length (mm):	-									
FRL / FRR:	-/30/30									

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.