
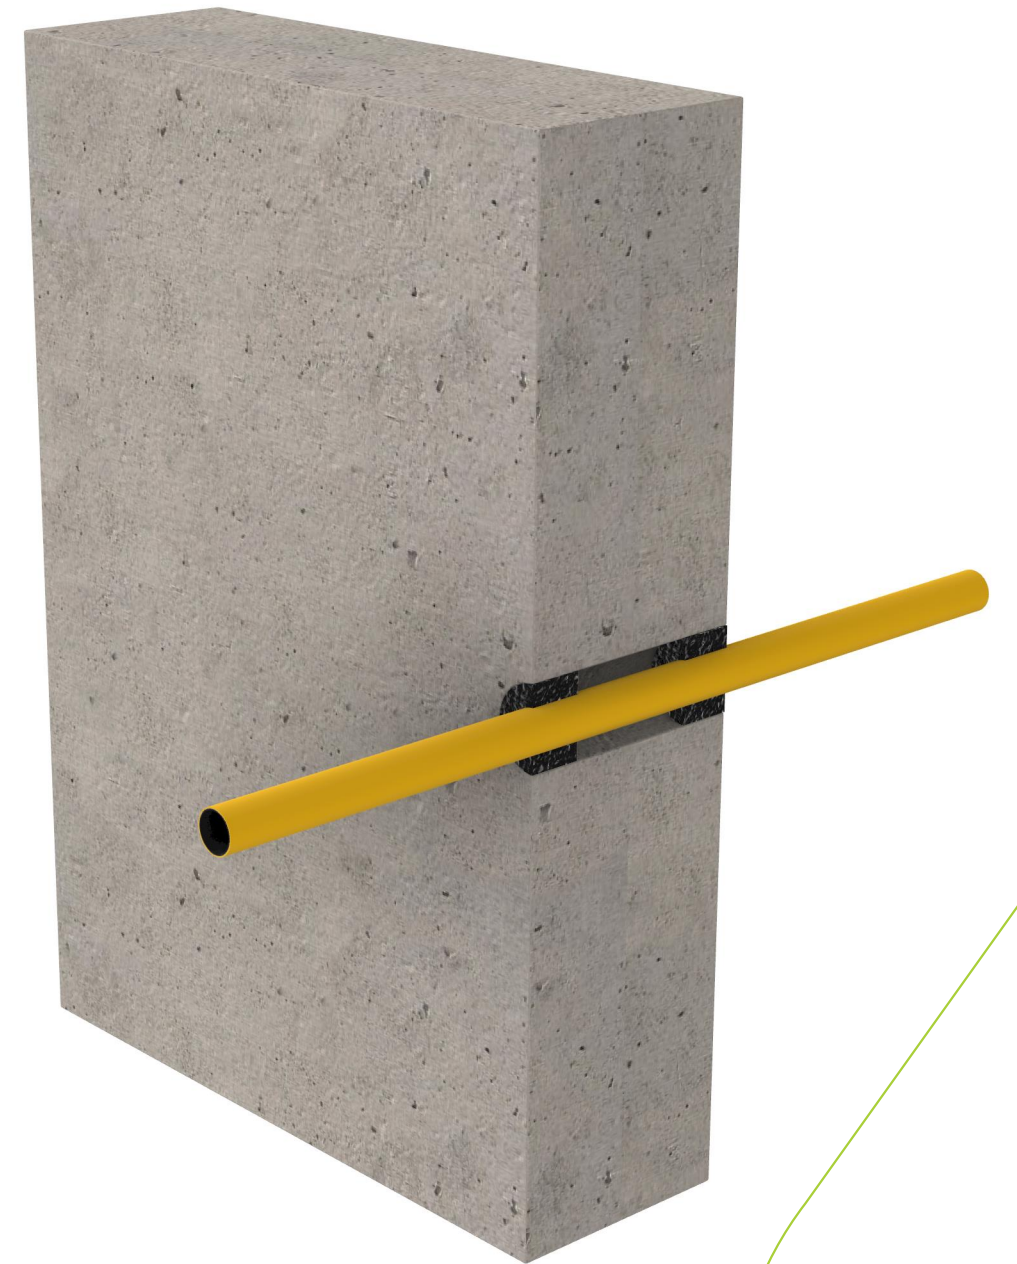


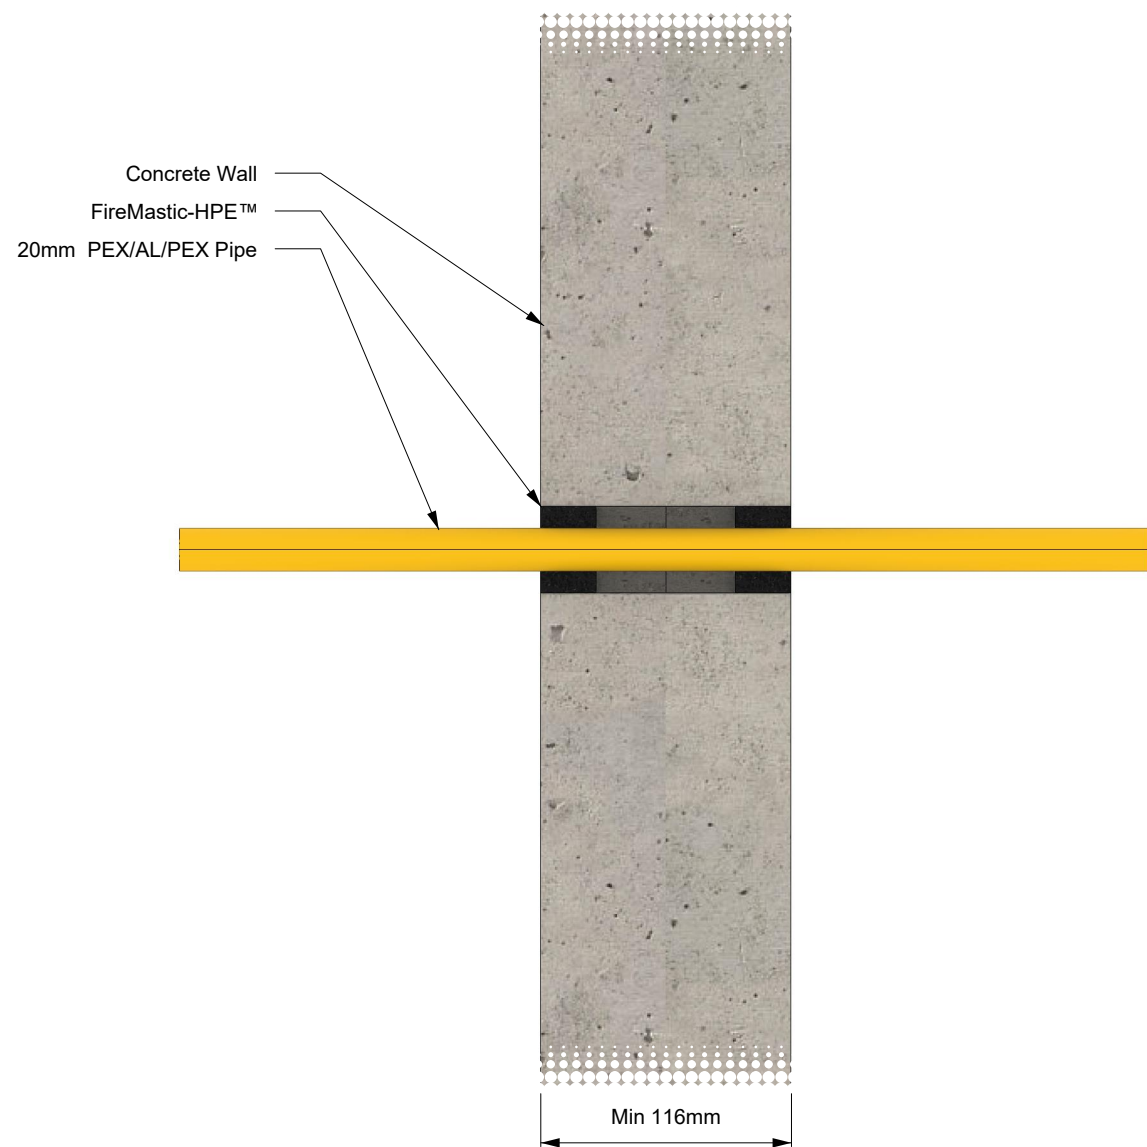

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 20 mm PEX/AL/PEX pipe. Sealant to depth of plasterboard in 5 mm - 20 mm annular gap finished flush both sides. Pipe can be installed off centre)	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PEX-AL	-	-		Report Reference:		WF FAS 190335	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2128.4	
Min Substrate Thickness (mm):	116.0	40	5 - 20 mm		Date:	06/11/25	Rev:	01
Sealant Depth (mm):	25.0	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0.0	-						
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							