




NOTE
Inside the wall cavity on the unexposed side a 13mm Fire Rated Plasterboard baffle laminated to Shaftliner using 10 x 38mm screws at 300mm max centres and 100mm max from ends.

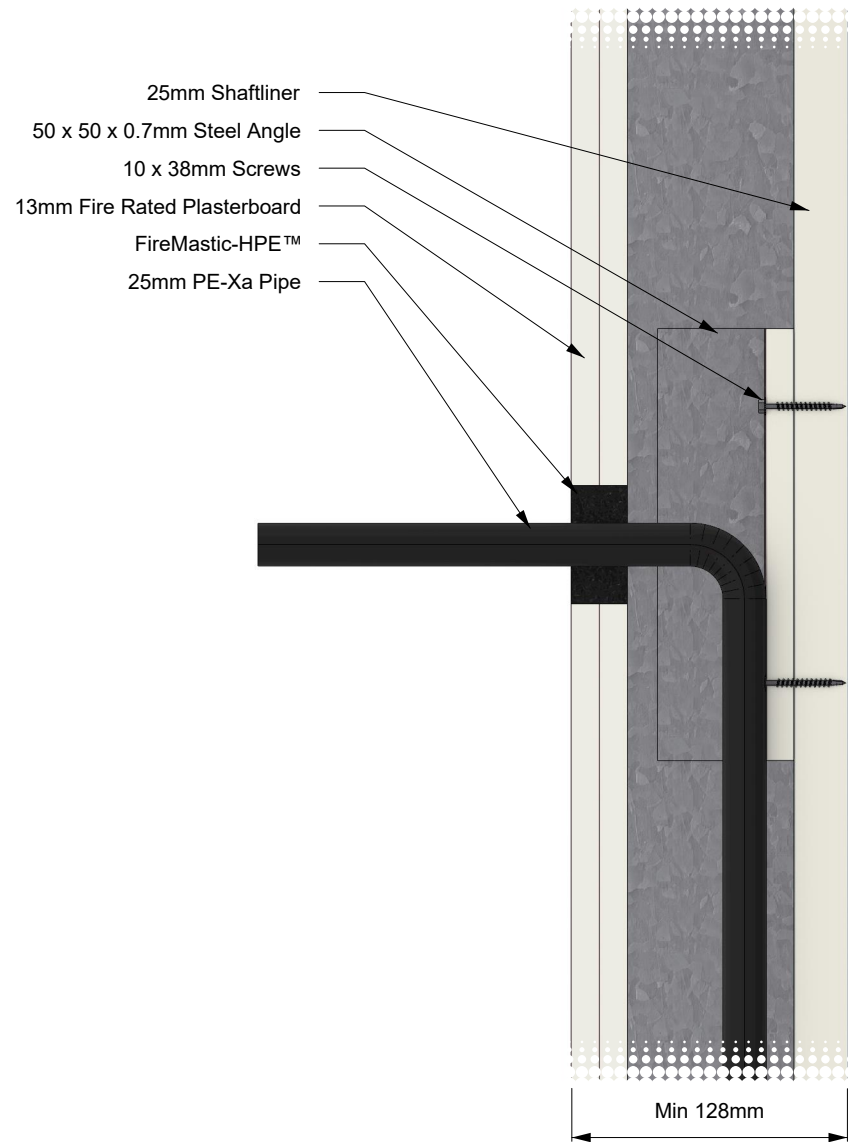

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	1-sided installation. System is approved for installation in both directions through the double layer plasterboard. Up to 20 mm PE-Xa pipe. Sealant to depth of plasterboard in 17.5 mm annular gap finished flush.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PEX	-	-		Report Reference:		WF FAS 190335	
Substrate:	Shaftliner	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2141.12	
Min Substrate Thickness (mm):	128	55	17.5		Date:	13/01/25	Rev:	01
Sealant Depth (mm):	26	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.