


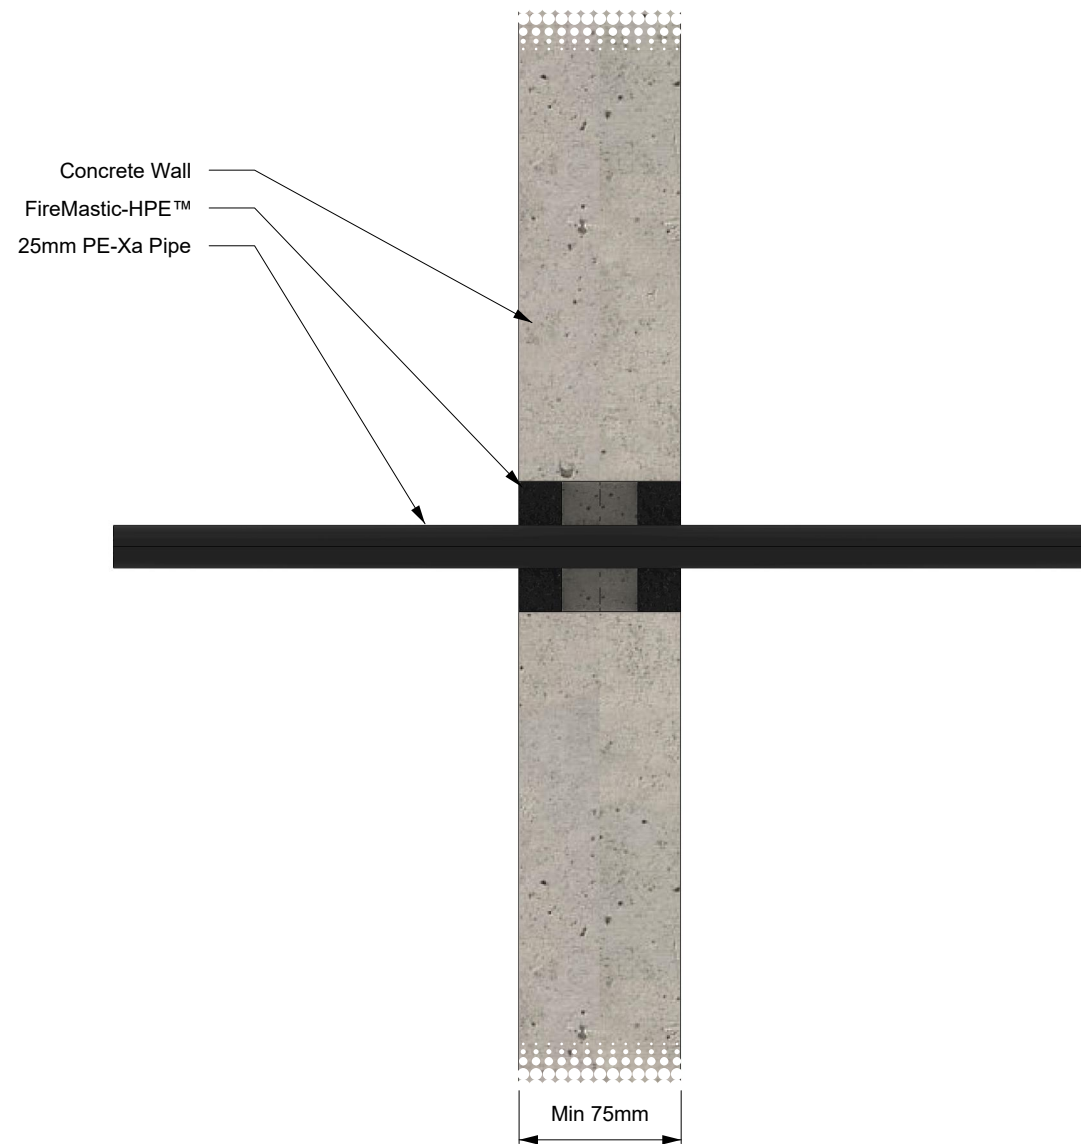

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Up to 20 mm PE-Xa pipe. Sealant to depth of 20 mm in annular gap both sides, finished flush.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	PEX	-	-		Report Reference:		WF FAS 190335	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2149.4	
Min Substrate Thickness (mm):	75	60	20		Date:		13/01/25	Rev:
Sealant Depth (mm):	20	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							