


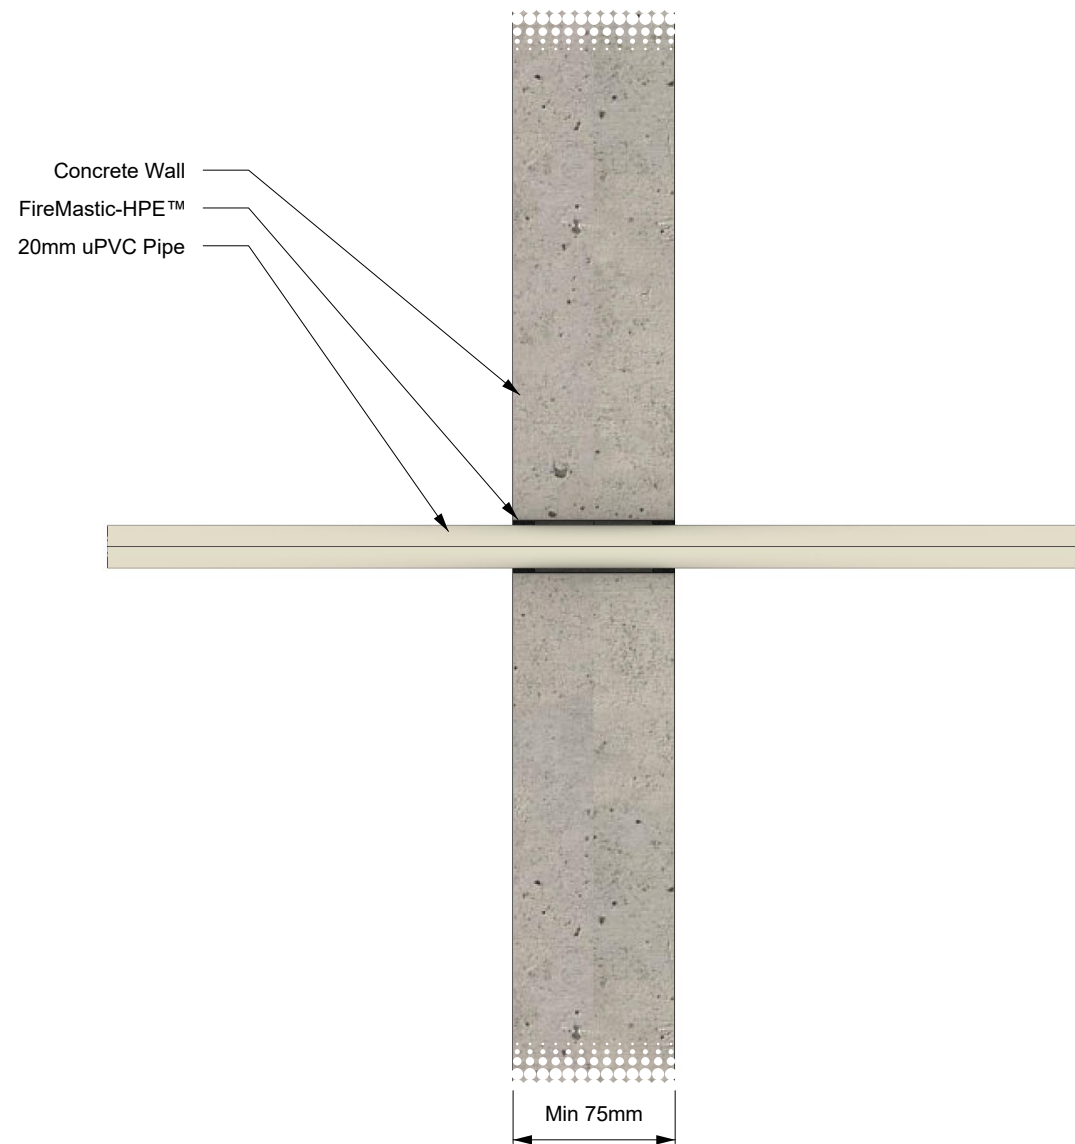

| SYSTEM DESCRIPTION            |                                    | FIRE STOPPING INFORMATION |                  | SERVICE SIZE & DETAILS                                  | SUPPORTING INFORMATION  |  |                |         |
|-------------------------------|------------------------------------|---------------------------|------------------|---------------------------------------------------------|-------------------------|--|----------------|---------|
| Orientation:                  | Wall                               | BOSS FireMastic-HPE™      | -                | Up to 20 mm uPVC pipe. Surface seal only on both sides. | Reference Standard:     |  | AS 1530.4:2014 |         |
| Trade / Type:                 | Plumbing / Hydraulic / Active Fire | -                         | -                |                                                         | Supplementary Standard: |  | AS 4072.1-2005 |         |
| Service:                      | UPVC                               | -                         | -                |                                                         | Report Reference:       |  | WF FAS 190335  |         |
| Substrate:                    | Concrete wall                      | APERTURE (mm)             | ANNULAR GAP (mm) |                                                         | Drawing Number:         |  | BF-2159.4      |         |
| Min Substrate Thickness (mm): | 75                                 | 24                        | 2                |                                                         | Date:                   |  | 13/01/25       | Rev: 01 |
| Sealant Depth (mm):           | Surface only                       | ADDITIONAL INFORMATION    |                  |                                                         |                         |  |                |         |
| Sealant Fillet (mm):          | 0                                  |                           |                  |                                                         |                         |  |                |         |
| Wrap Length (mm):             | -                                  |                           |                  |                                                         |                         |  |                |         |
| FRL / FRR:                    | -/120/120                          |                           |                  |                                                         |                         |  |                |         |

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.