
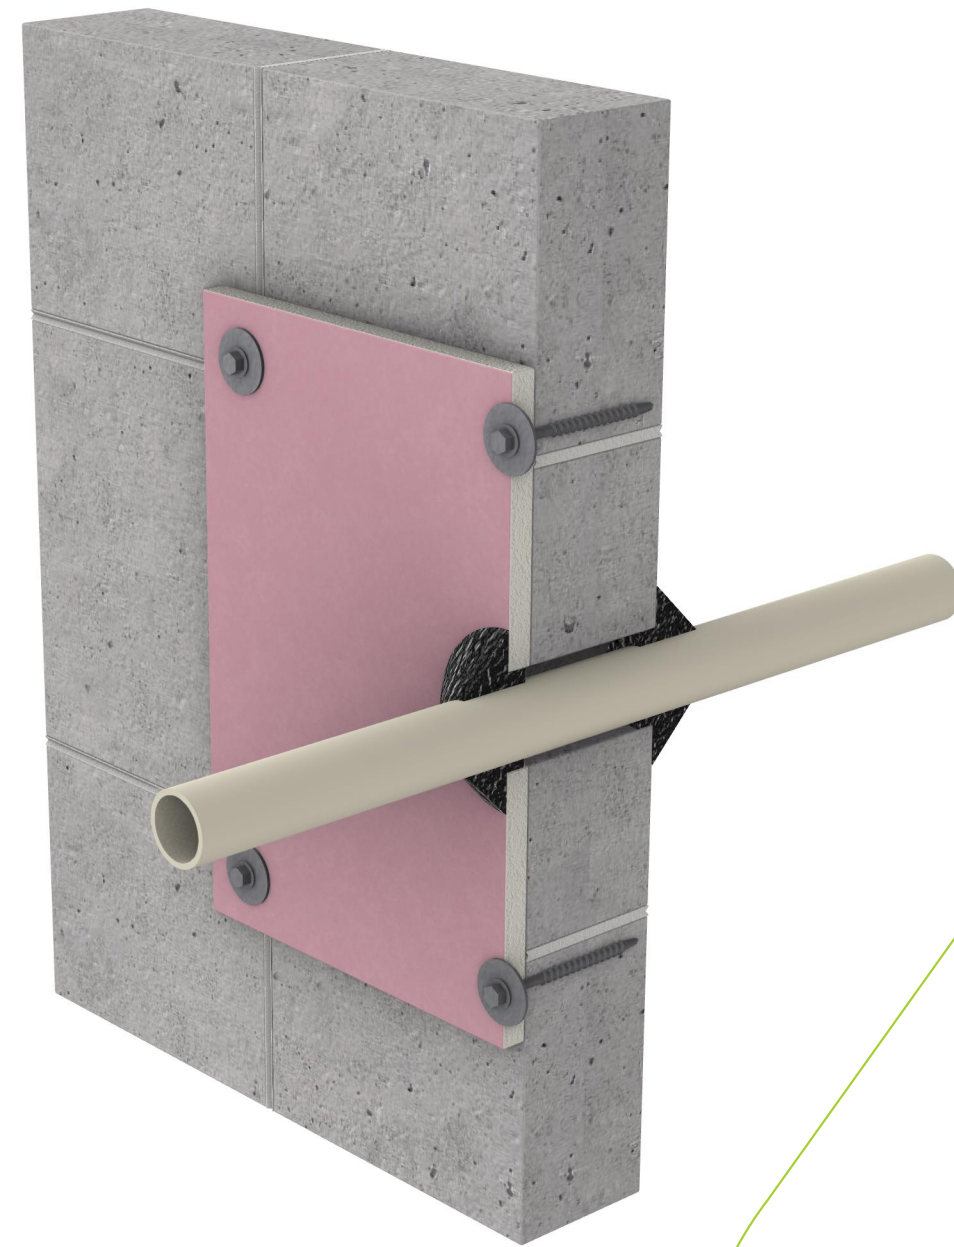


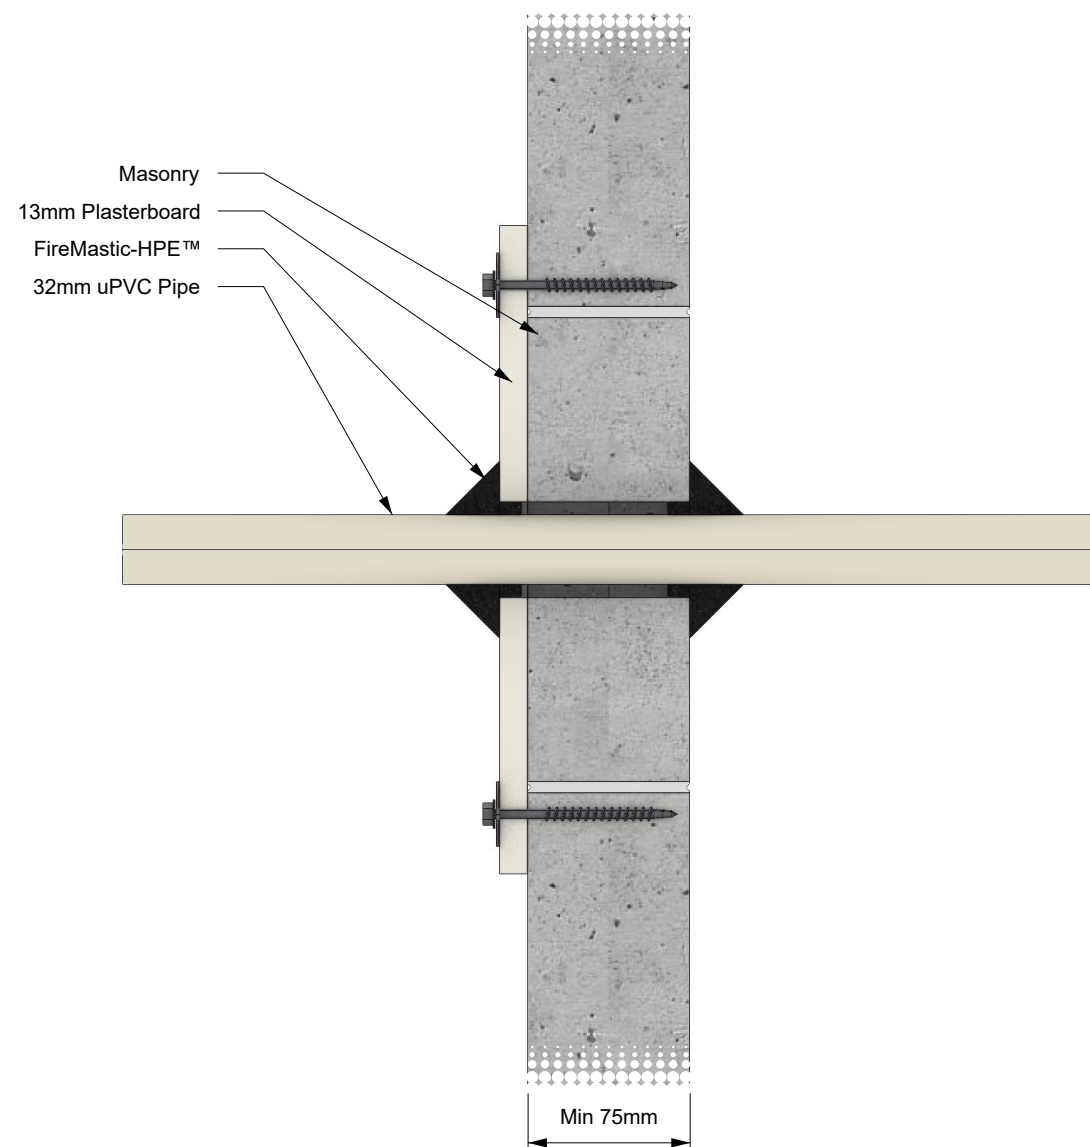

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	30 mm - 40 mm uPVC pipe. Sealant to depth of 10 mm in annular gap both sides, with 25 mm x 25 mm fillet both sides. The wall is to be built up with minimum 13 mm thick fire rated plasterboard on one side.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		WF FAS 190335	
Substrate:	Masonry	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2162.5	
Min Substrate Thickness (mm):	75	44	7 - 2 mm		Date:	13/01/25	Rev:	01
Sealant Depth (mm):	10	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	25							
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.