BOSS BF-2167-24

AU: 1300 502 677 | NZ: 0800 502 677 www.bossfire.com

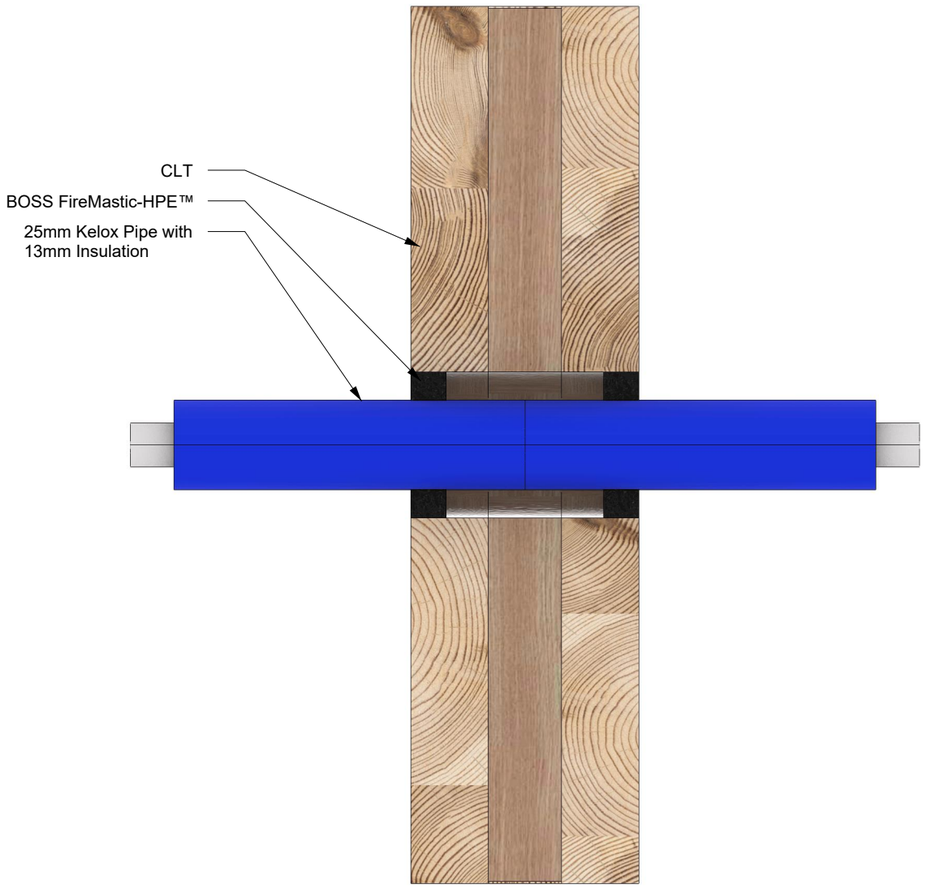

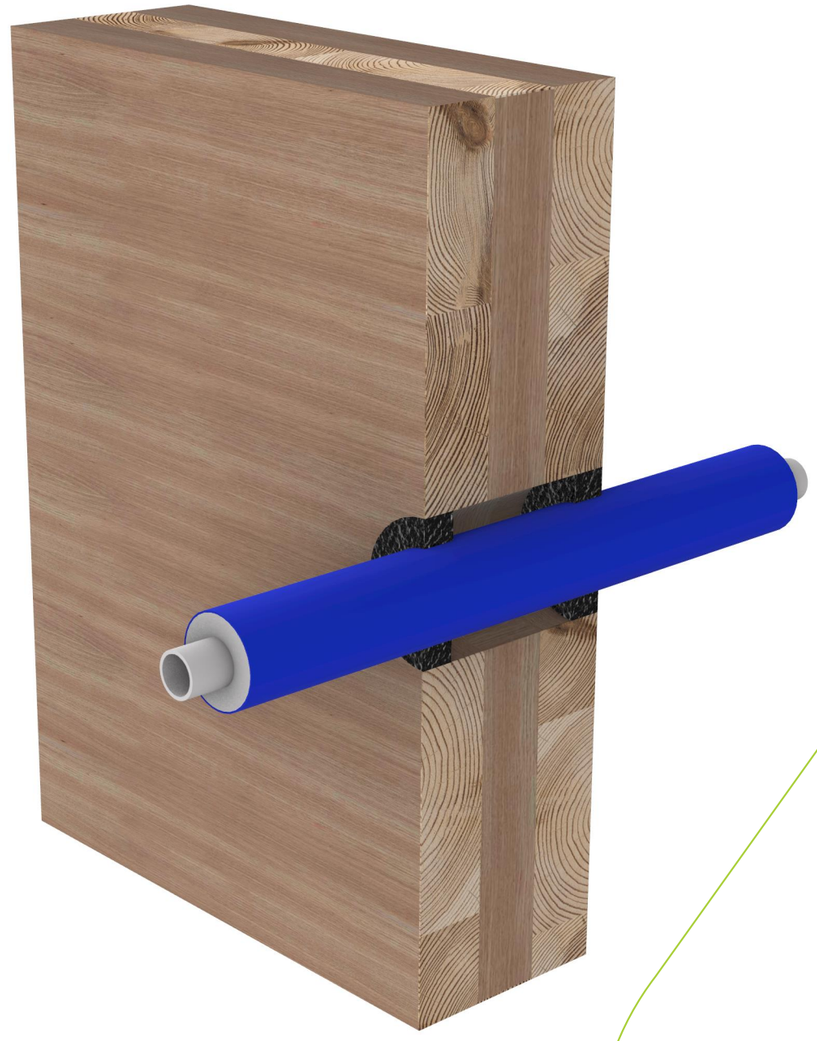

SYSTEM DESCRIPTION	
Orientation:	Wall
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	Kelox / KeKilit
Substrate:	CLT - Cross Laminated Timber
Min Substrate Thickness (mm):	130
Sealant Depth (mm):	20
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/90/90

FIRE STOPPING INFORMATION	
BOSS FireMastic-HPE™	-
-	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
83	16.5
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Up to 50 mm OD - Up to 25 mm Kelox plus pipe with 13 mm thick insulation.
Sealant to depth of 20 mm in annular gap both sides, finished flush.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2167.24		
Date:	13/01/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.