
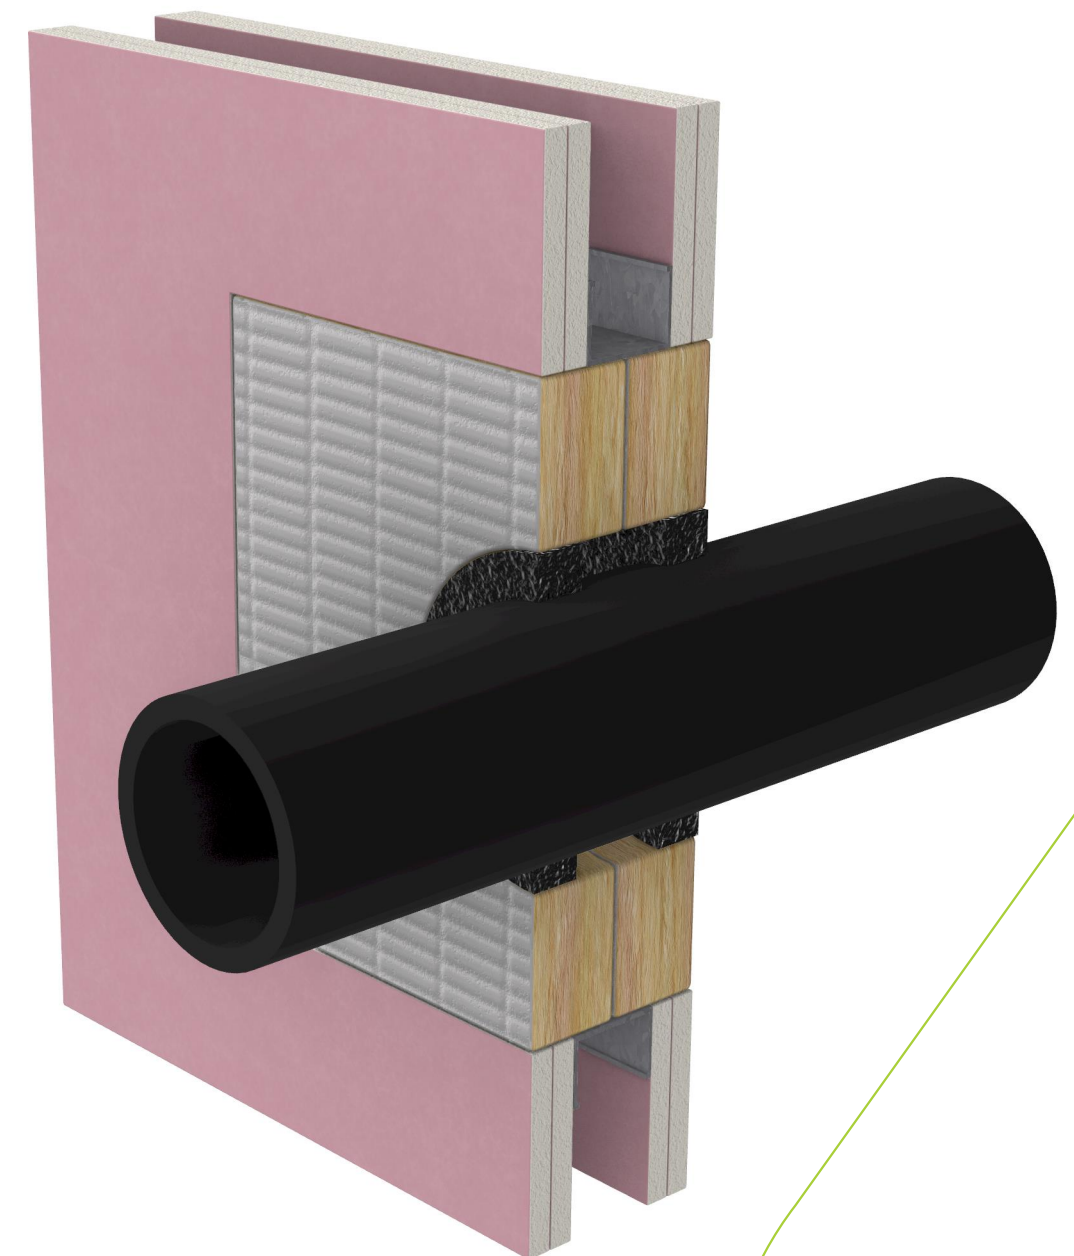


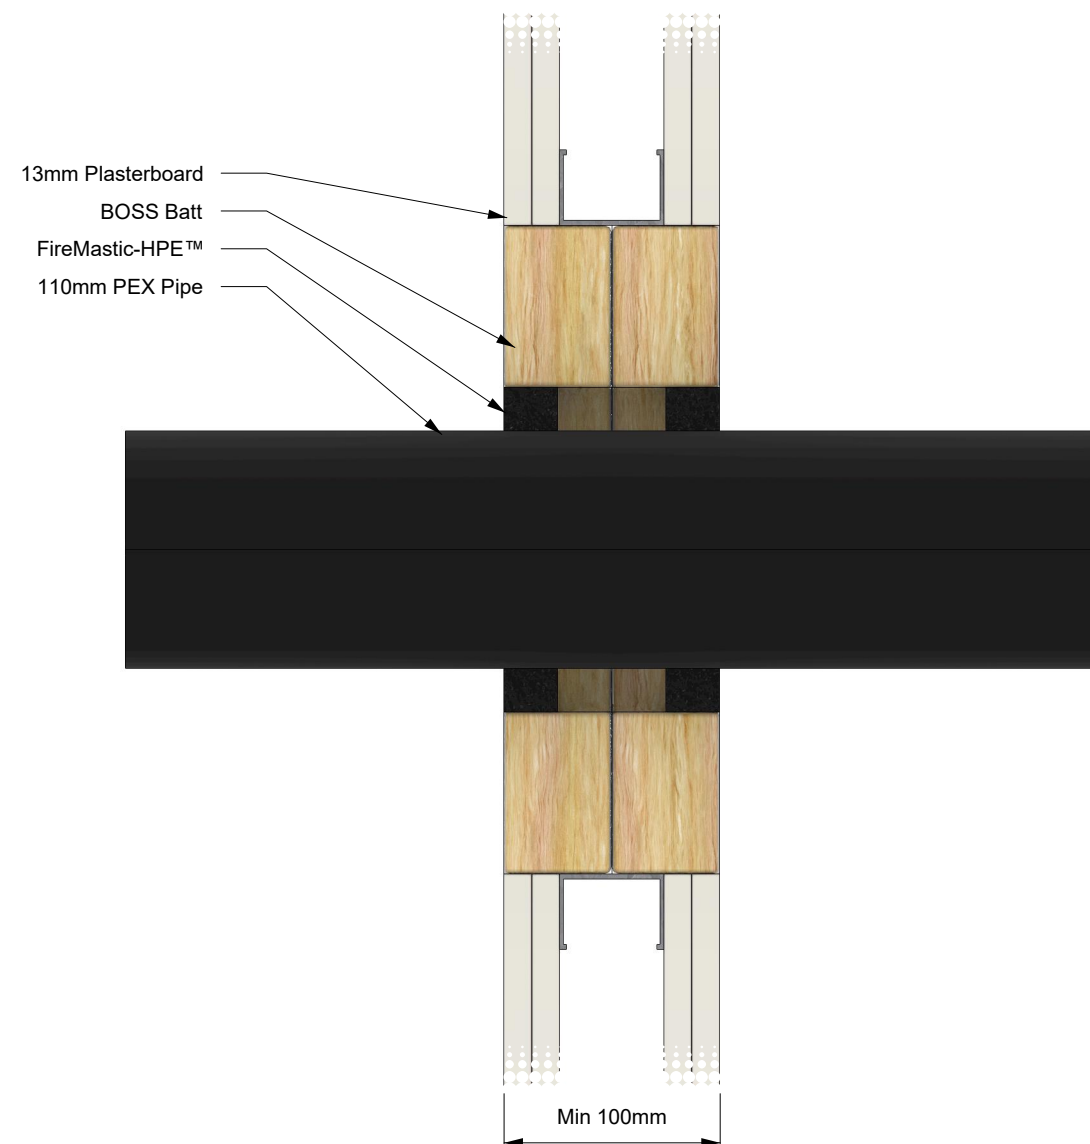

| SYSTEM DESCRIPTION            |                                             | FIRE STOPPING INFORMATION |                  | SERVICE SIZE & DETAILS                                                                                                                                                                                                                                                                                                       | SUPPORTING INFORMATION  |  |                |         |
|-------------------------------|---------------------------------------------|---------------------------|------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------|--|----------------|---------|
| Orientation:                  | Wall                                        | BOSS FireMastic-HPE™      | -                | Approved for Uncapped/Capped - Up to 110 mm PEX pipe installed through 100 mm thick double layer of BossBatt aperture in separating element, with factory applied BOSS Ablative coating to both faces and PS coating to exposed face. Sealant depth of 25mm in annular gap finished flush. Maximum aperture 600 mm x 600 mm. | Reference Standard:     |  | AS 1530.4:2014 |         |
| Trade / Type:                 | Plumbing / Hydraulic / Active Fire          | BOSS Batt™                | -                |                                                                                                                                                                                                                                                                                                                              | Supplementary Standard: |  | AS 4072.1-2005 |         |
| Service:                      | PEX                                         | -                         | -                |                                                                                                                                                                                                                                                                                                                              | Report Reference:       |  | WF FAS 190335  |         |
| Substrate:                    | Double Layer Fire Rated Plasterboard System | APERTURE (mm)             | ANNULAR GAP (mm) |                                                                                                                                                                                                                                                                                                                              | Drawing Number:         |  | BF-2169.2      |         |
| Min Substrate Thickness (mm): | 100                                         | 150                       | 20               |                                                                                                                                                                                                                                                                                                                              | Date:                   |  | 13/01/25       | Rev: 01 |
| Sealant Depth (mm):           | 25                                          | ADDITIONAL INFORMATION    |                  |                                                                                                                                                                                                                                                                                                                              |                         |  |                |         |
| Sealant Fillet (mm):          | 0                                           |                           |                  |                                                                                                                                                                                                                                                                                                                              |                         |  |                |         |
| Wrap Length (mm):             | -                                           |                           |                  |                                                                                                                                                                                                                                                                                                                              |                         |  |                |         |
| FRL / FRR:                    | -/120/120                                   |                           |                  |                                                                                                                                                                                                                                                                                                                              |                         |  |                |         |

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.