BOSS BF-2170-4

AU: 1300 502 677 | NZ: 0800 502 677 www.bossfire.com

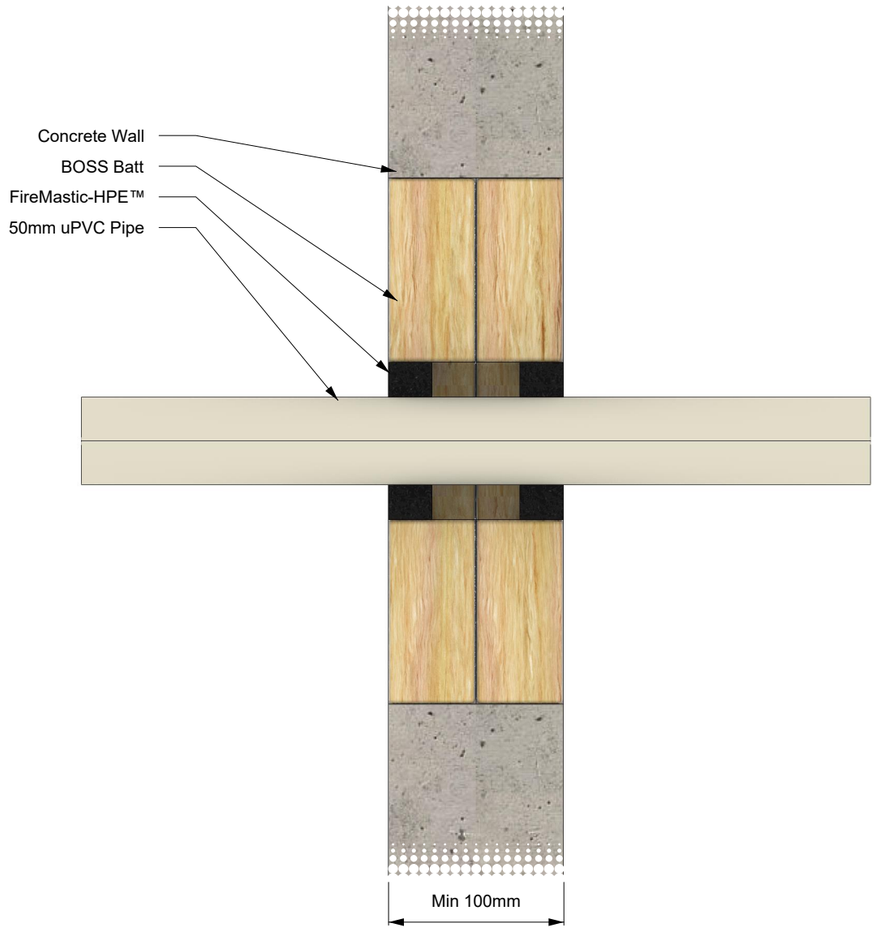

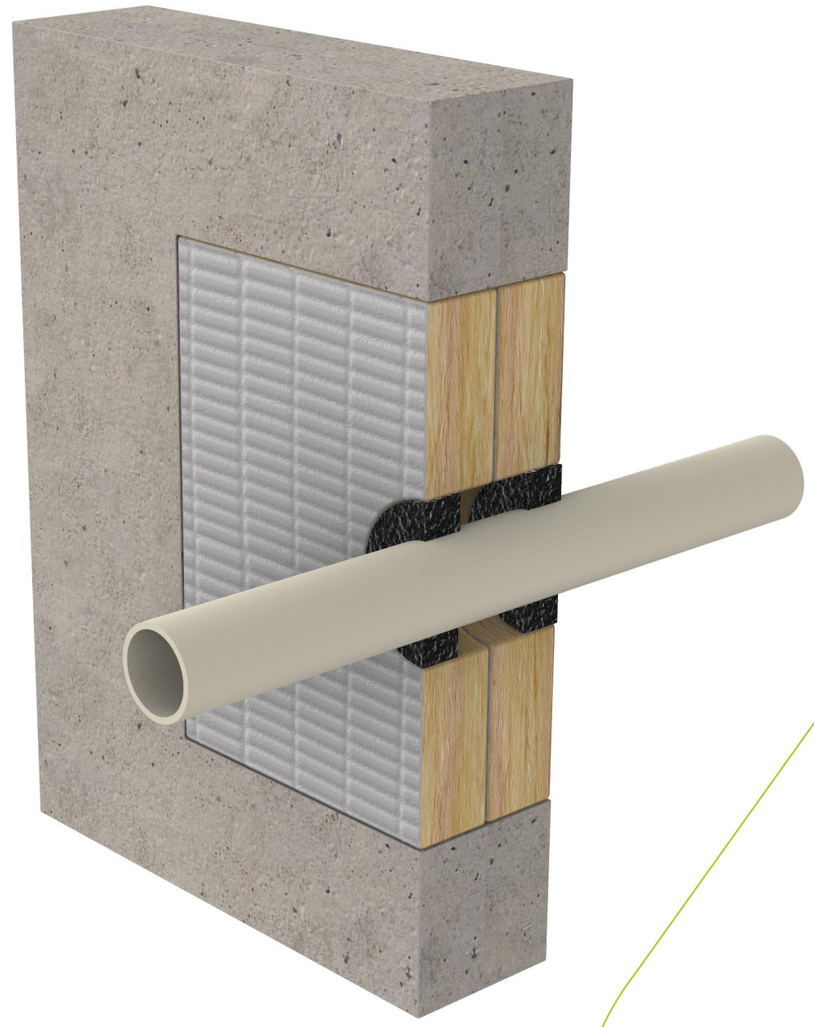

SYSTEM DESCRIPTION	
Orientation:	Wall
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	UPVC
Substrate:	Concrete wall
Min Substrate Thickness (mm):	100
Sealant Depth (mm):	25
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/120/120

FIRE STOPPING INFORMATION	
BOSS FireMastic-HPE™	-
BOSS Batt™	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
90	20
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Approved for Uncapped/Capped - 50 mm x 2.4 mm wall thickness uPVC pipe installed through 100 mm thick double layer of BossBatt aperture in separating element, with factory applied BOSS Ablative coating to both faces and PS coating to exposed face. Sealant depth of 25mm in annular gap finished flush. Maximum aperture 600 mm x 600 mm.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2170.4		
Date:	13/01/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.