
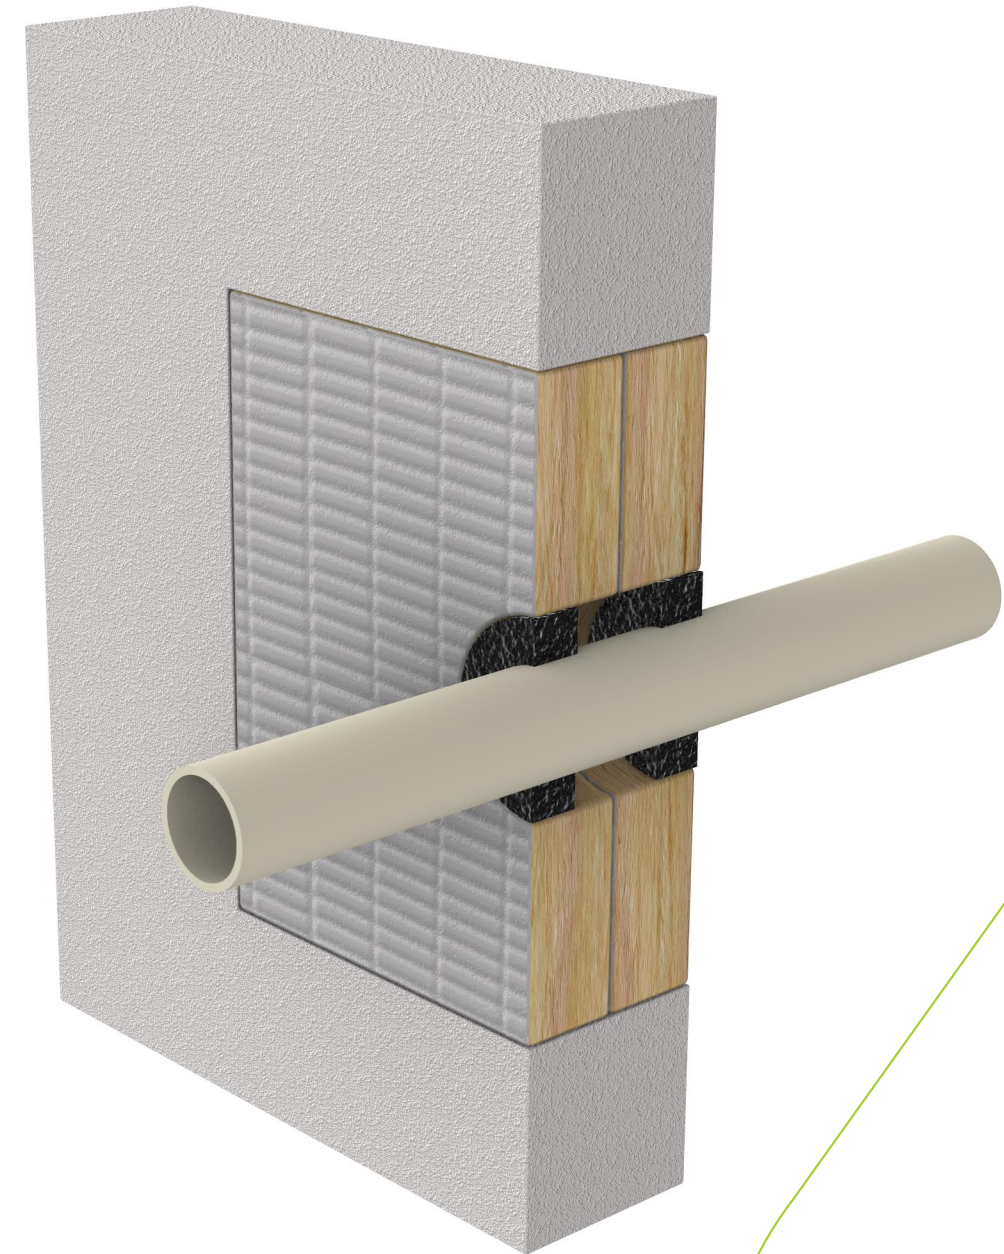


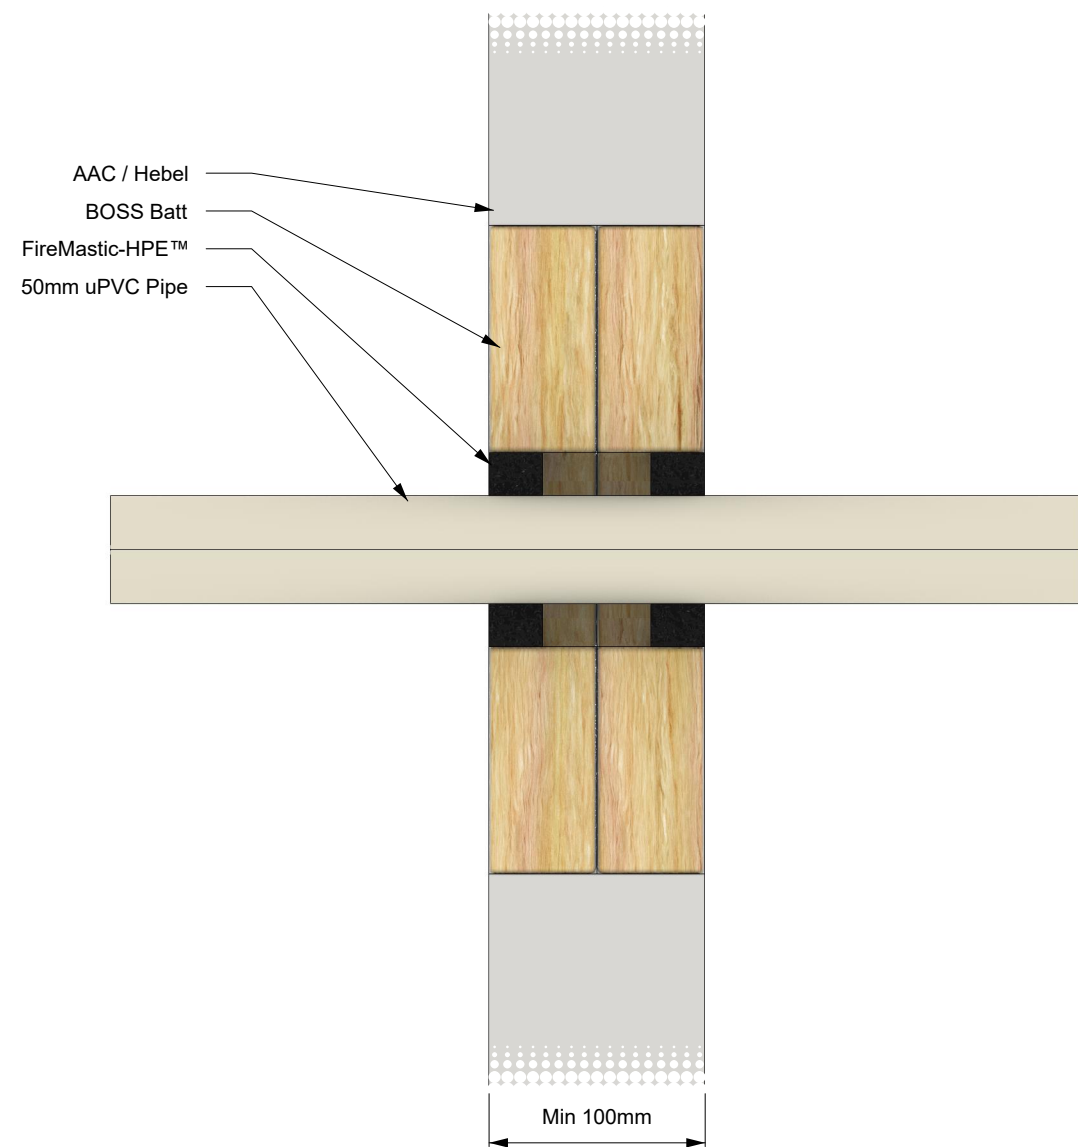

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	Approved for Uncapped/Capped - 50 mm x 2.4 mm wall thickness uPVC pipe installed through 100 mm thick double layer of BossBatt aperture in separating element, with factory applied BOSS Ablative coating to both faces and PS coating to exposed face. Sealant depth of 25mm in annular gap finished flush. Maximum aperture 600 mm x 600 mm.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	Plumbing / Hydraulic / Active Fire	BOSS Batt™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	UPVC	-	-		Report Reference:		WF FAS 190335	
Substrate:	AAC / Hebel	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2170.7	
Min Substrate Thickness (mm):	100	90	20		Date:		13/01/25	Rev:
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						01
Sealant Fillet (mm):	0	-						
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.