
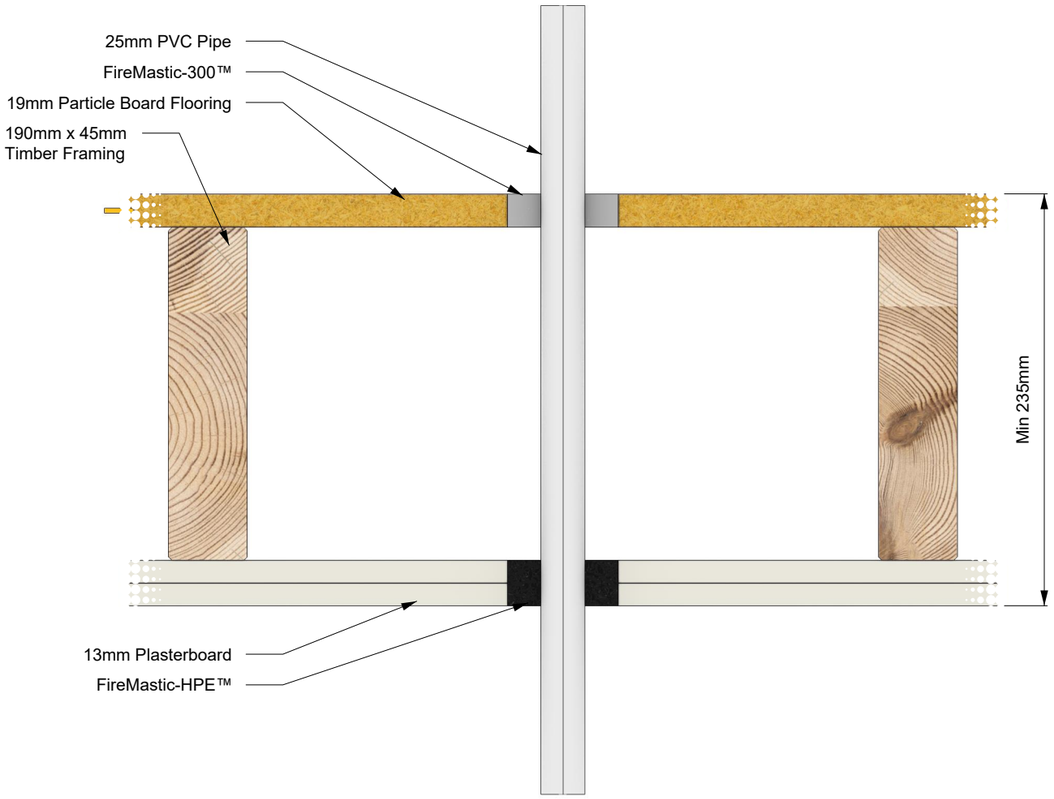


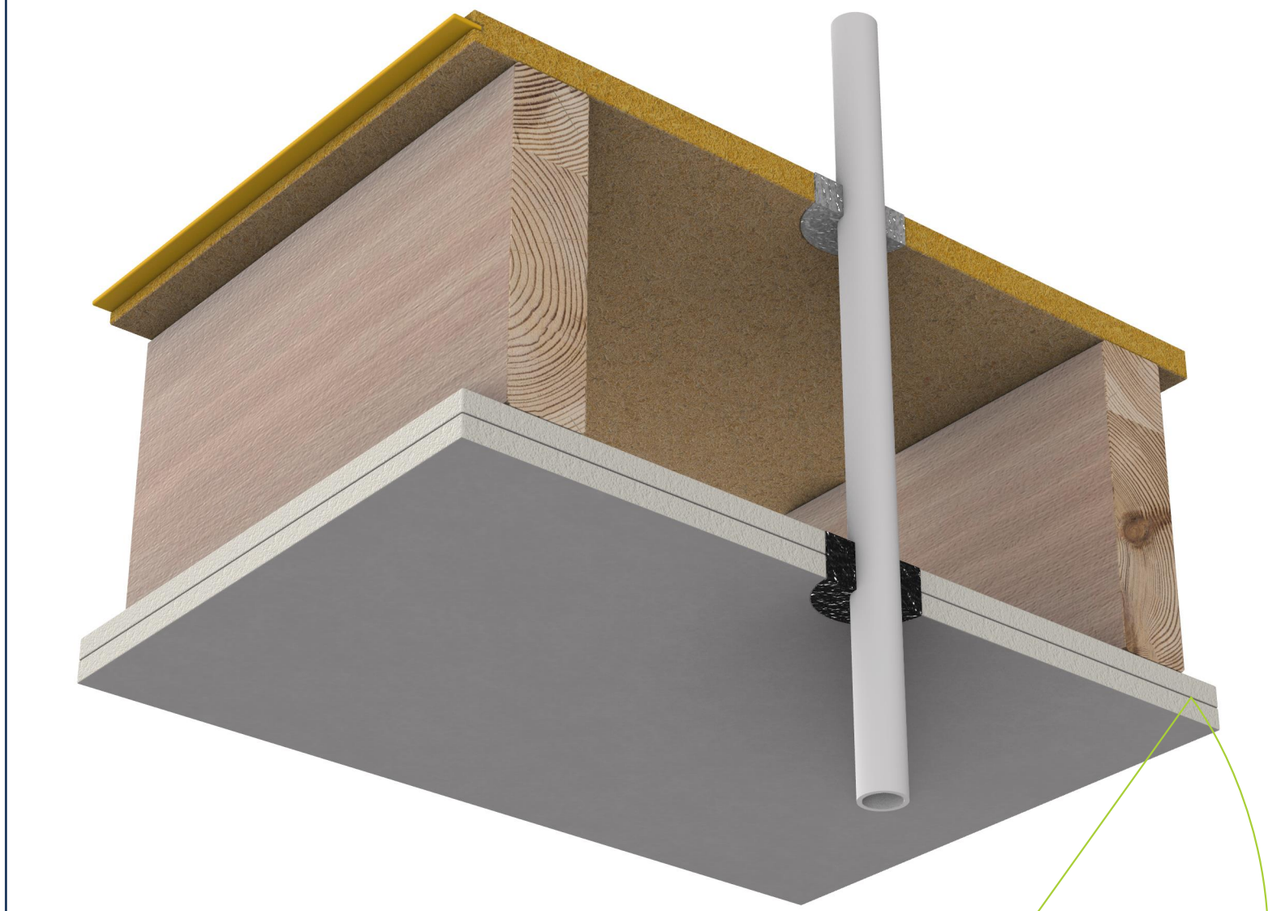

SYSTEM DESCRIPTION	
Orientation:	Ceiling
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	UPVC
Substrate:	Plasterboard ceiling systems
Min Substrate Thickness (mm):	235
Sealant Depth (mm):	26
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/90/90

FIRE STOPPING INFORMATION	
BOSS FireMastic-HPE™	-
BOSS FireMastic-300™	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
63	19
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Up to 25 mm PVC pipe. Sealant to full depth of plasterboard ceiling in annular gap finished flush on the underside. BOSS FM300 sealant was also used to seal the particle board flooring to its full depth in the annular gap on the top side, finished flush. The specimen also achieved RSIF of 55 minutes.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2174.27		
Date:	13/01/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.