
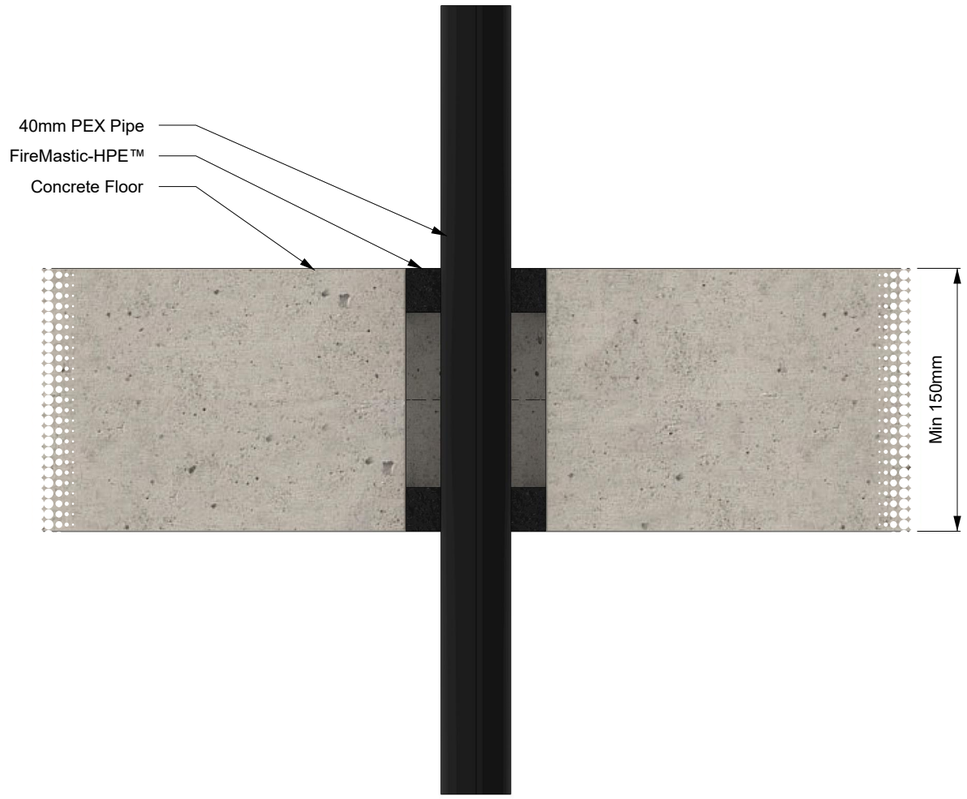


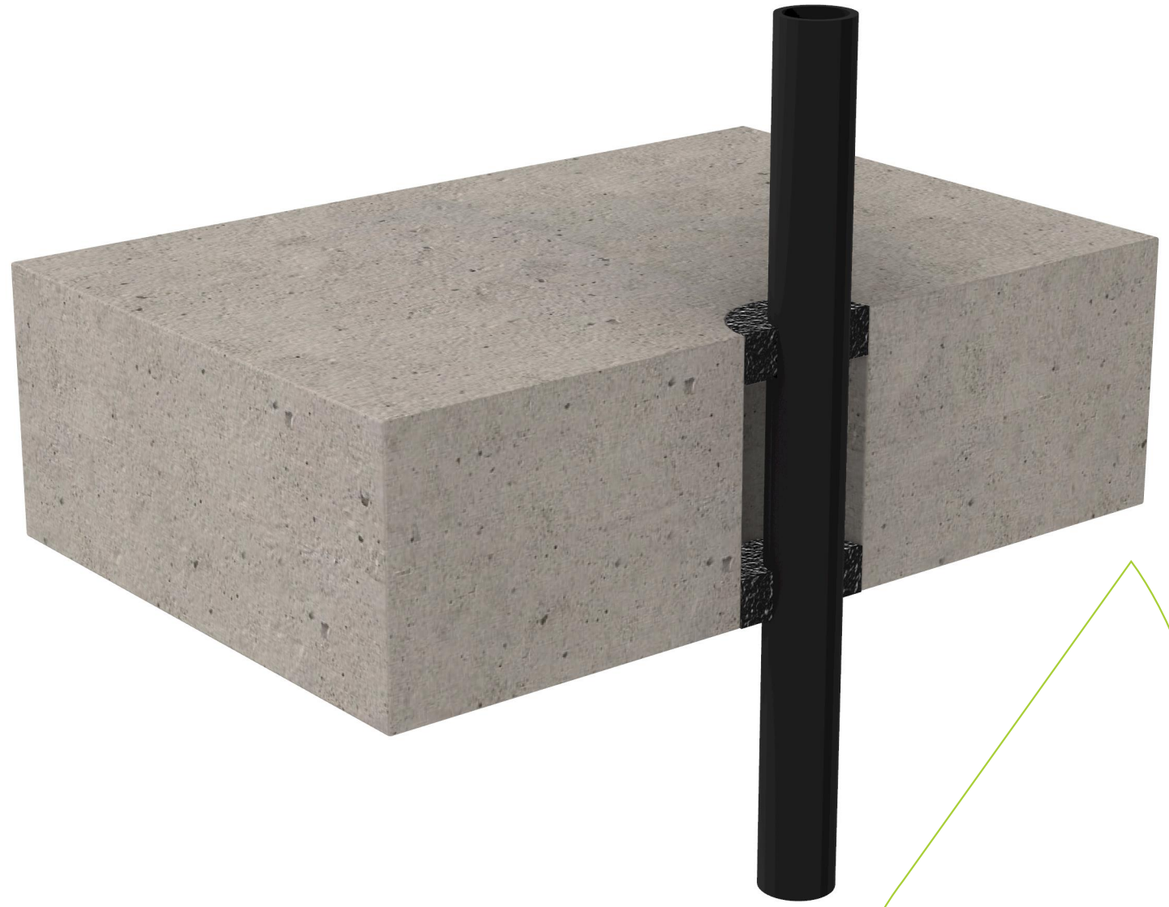

SYSTEM DESCRIPTION	
Orientation:	Floor
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	PEX
Substrate:	Concrete Floor
Min Substrate Thickness (mm):	150
Sealant Depth (mm):	25
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/120/120

FIRE STOPPING INFORMATION	
BOSS FireMastic-HPE™	-
-	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
80	20
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Up to 40 mm x 4 mm wall thickness PEX pipe. Sealant to depth of 25 mm in annular gap finished flush both sides.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2175.25		
Date:	13/01/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.