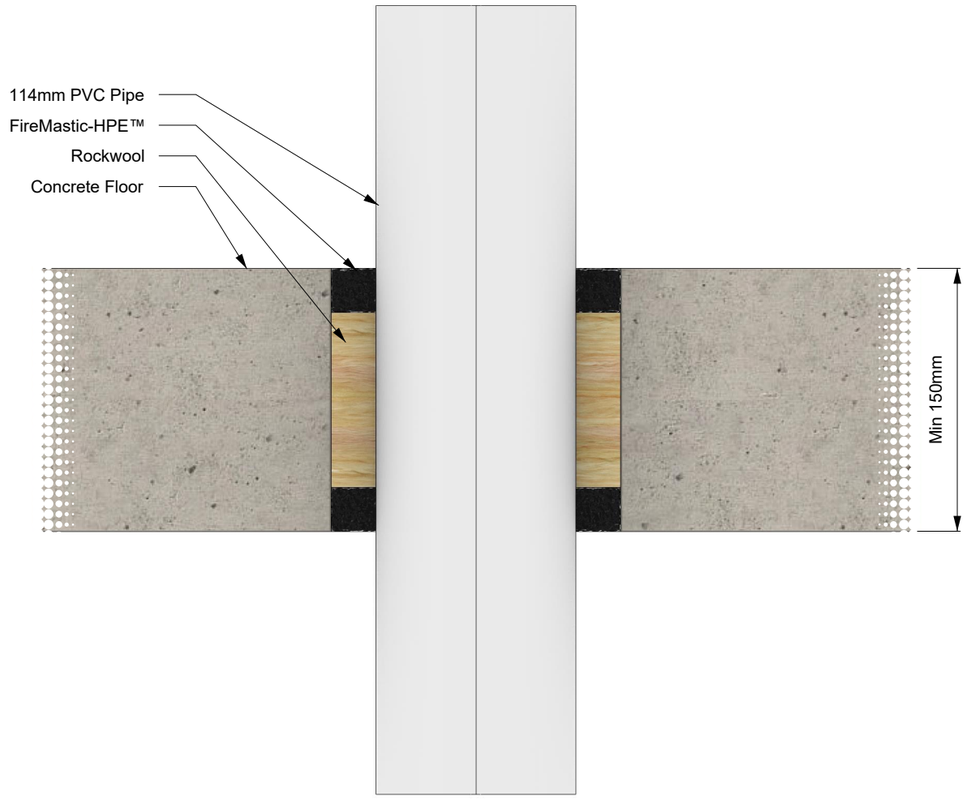

SYSTEM DESCRIPTION	
Orientation:	Floor
Trade / Type:	Plumbing / Hydraulic / Active Fire
Service:	UPVC
Substrate:	Concrete Floor
Min Substrate Thickness (mm):	150
Sealant Depth (mm):	25
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/120/30

FIRE STOPPING INFORMATION	
BOSS FireMastic-HPE™	-
-	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
165	25.5
ADDITIONAL INFORMATION	
-	

SERVICE SIZE & DETAILS

Up to 114 mm x 8.1 mm wall thickness PVC pipe. Sealant to depth of 25 mm in annular gap finished flush both sides. The system also includes a 100 mm deep infill friction fitted stone wool insulation, centrally located in the annular gap through the floor system.

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2185.25		
Date:	20/01/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.