
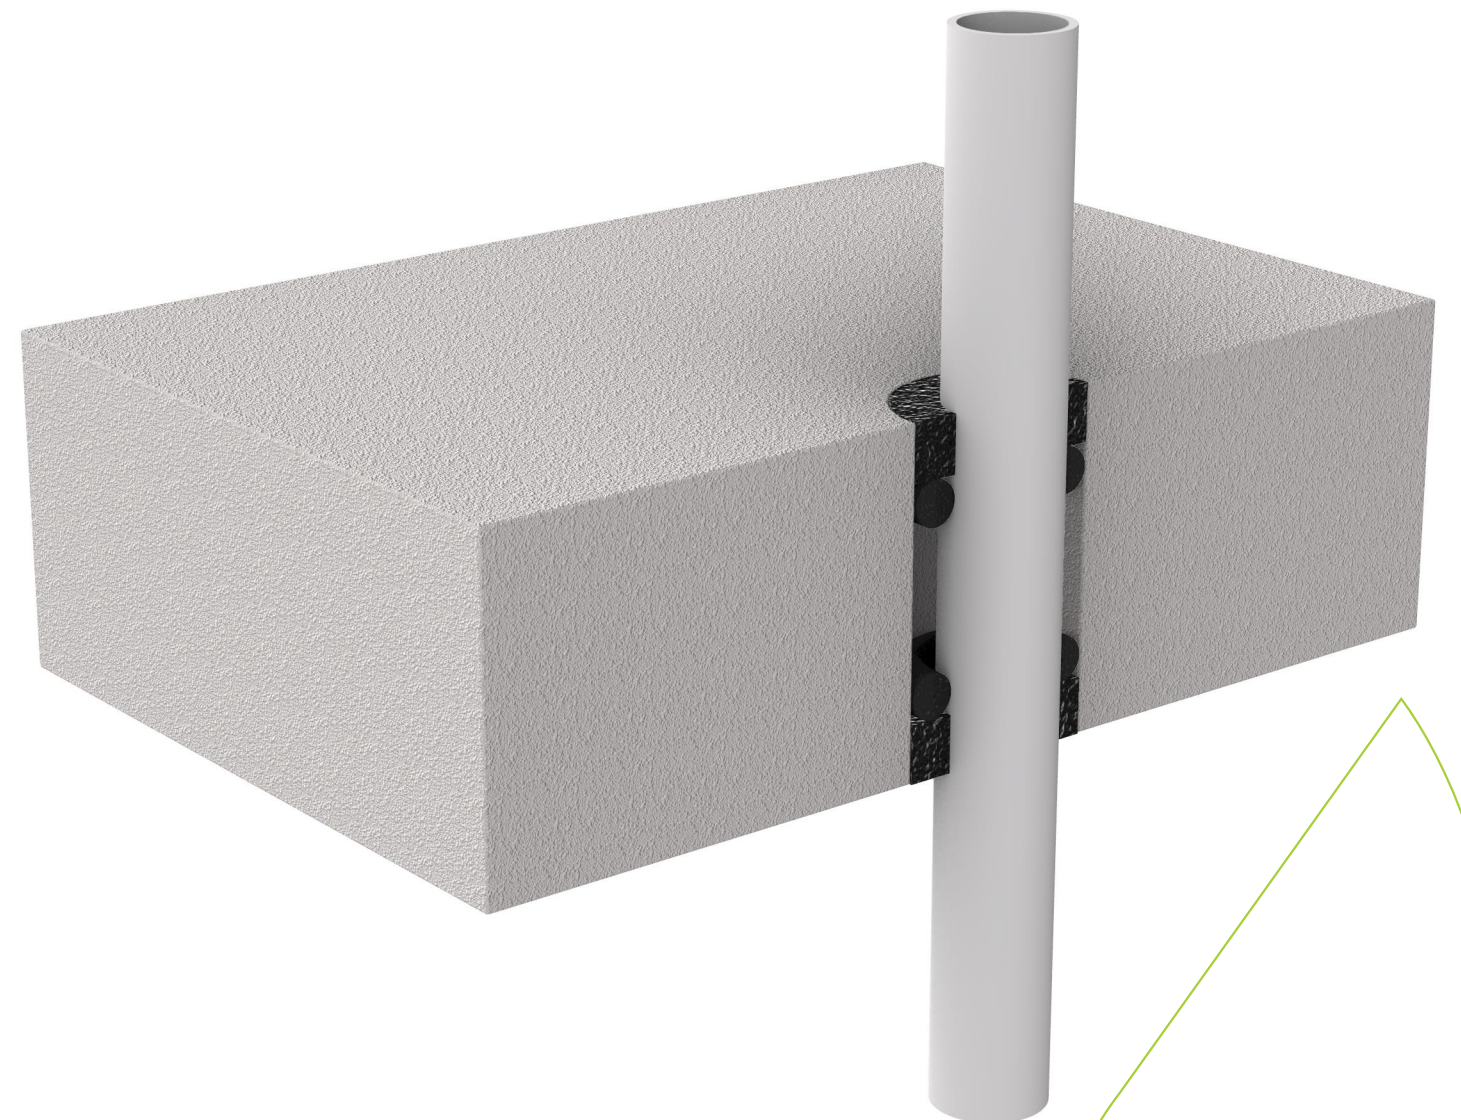


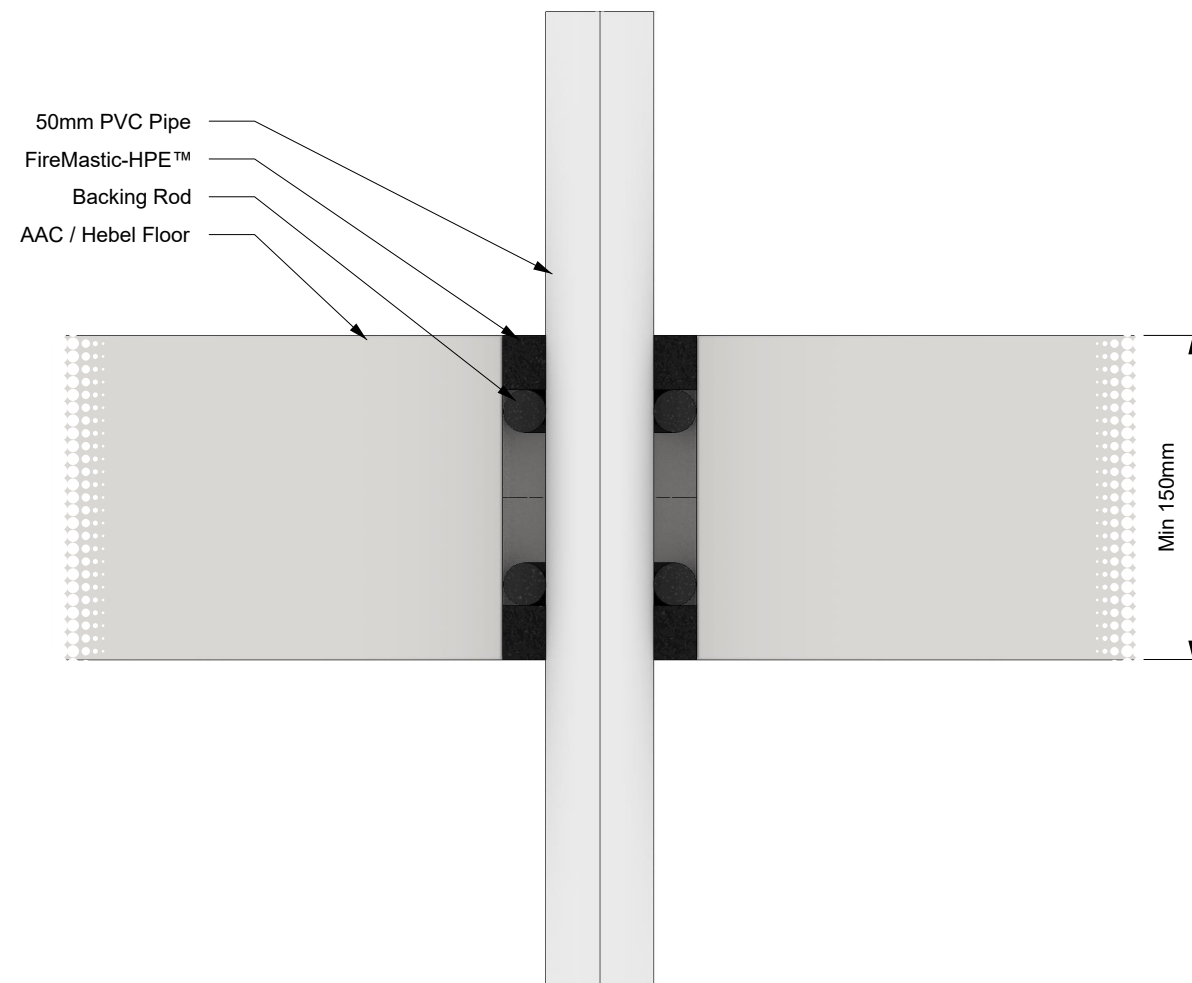

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION				
Orientation:	Floor	BOSS FireMastic-HPE™	-	50 mm x 2.4 mm wall thickness PVC pipe. Sealant to depth of 25 mm in annular gap to backing rod finished flush both sides.	Reference Standard:		AS 1530.4:2014		
Trade / Type:	Plumbing / Hydraulic / Active Fire	-	-		Supplementary Standard:		AS 4072.1-2005		
Service:	UPVC	-	-		Report Reference:		WF FAS 190335		
Substrate:	AAC / Hebel Floor	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2187.26		
Min Substrate Thickness (mm):	150	90	20		ADDITIONAL INFORMATION	Date:	20/01/25	Rev:	01
Sealant Depth (mm):	25								
Sealant Fillet (mm):	0								
Wrap Length (mm):	-								
FRL / FRR:	-/120/120								