BOSS BF-2193-1

AU: 1300 502 677 | NZ: 0800 502 677 www.bossfire.com

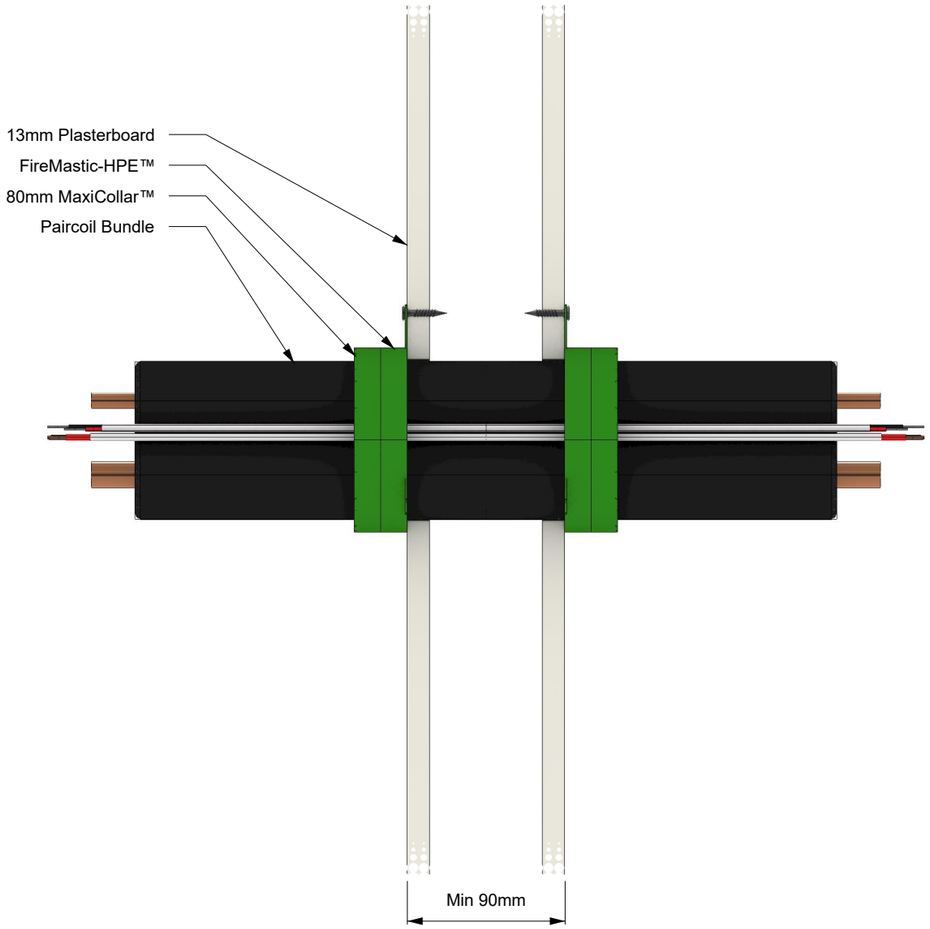

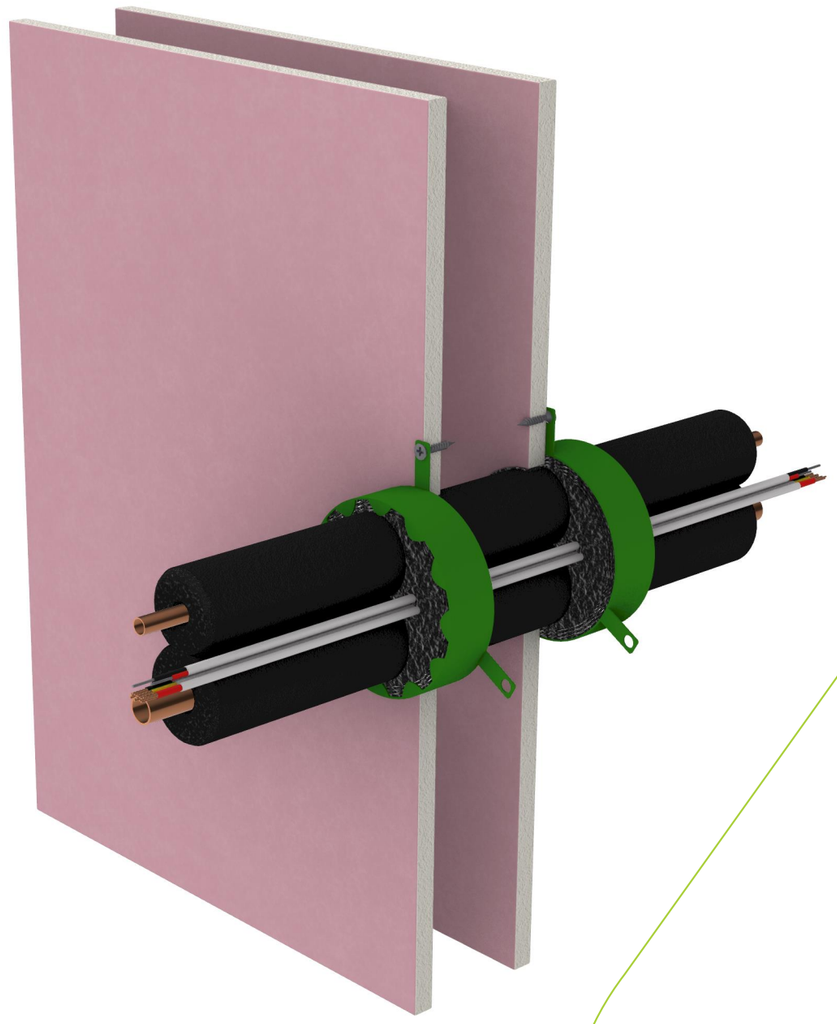

SYSTEM DESCRIPTION

Orientation:	Wall
Trade / Type:	HVAC
Service:	-
Substrate:	Single Layer Fire Rated Plasterboard System
Min Substrate Thickness (mm):	90
Sealant Depth (mm):	13
Sealant Fillet (mm):	0
Wrap Length (mm):	-
FRL / FRR:	-/60/60

FIRE STOPPING INFORMATION

BOSS MaxiCollar™	-
BOSS FireMastic-HPE™	-
-	-
APERTURE (mm)	**ANNULAR GAP (mm)**
80	-

ADDITIONAL INFORMATION

-

SERVICE SIZE & DETAILS

- Paircoil - Up to 10 mm/15 mm Insulated Copper Pipes with non-rated lagging,
- Up to 2.5mm² 2C+E TPS Power Cable,
- Up to 1.5mm² 2 Core Data Cable.

Boss MaxiCollar fixed to both sides of the wall. Sealant in the annular gap 13 mm deep finished flush. Sealant also to be applied to the annular gap between the services and collar to the depth of the collar finished flush.

SUPPORTING INFORMATION

Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2193.1		
Date:	20/01/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.