
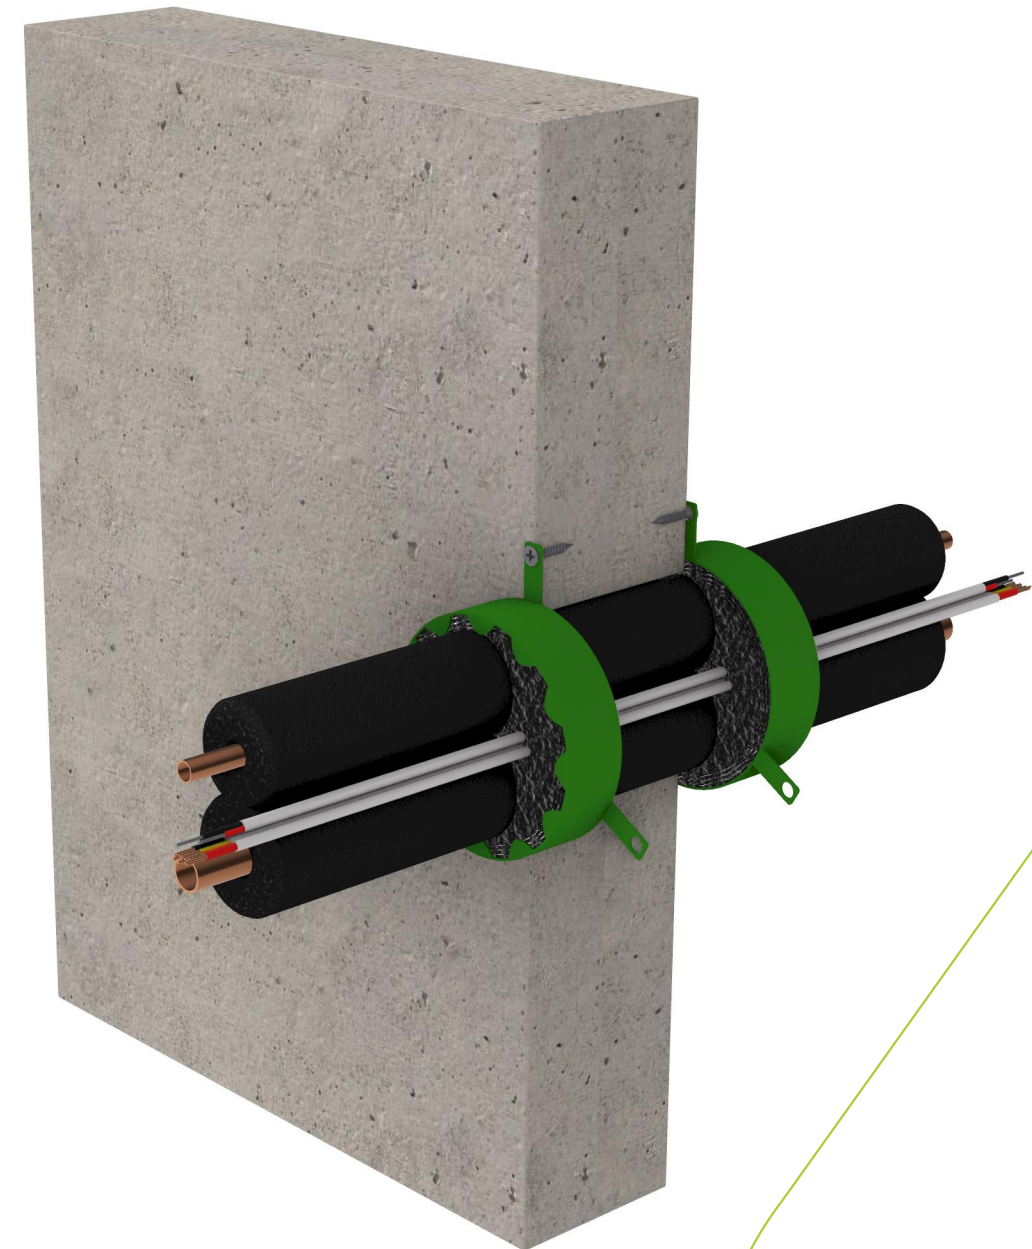


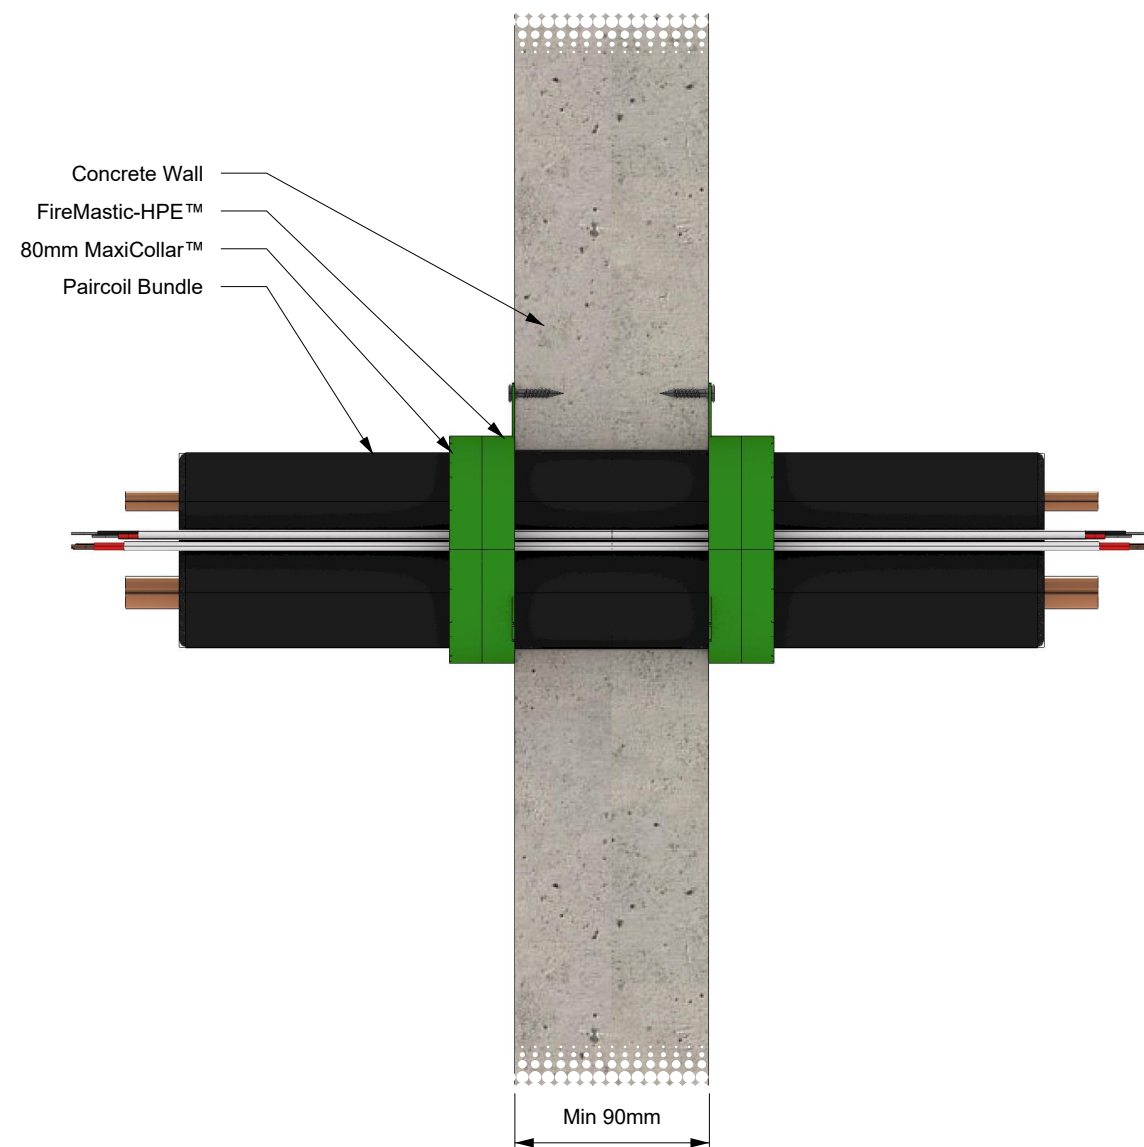

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS MaxiCollar™	-	- Paircoil - Up to 10 mm/15 mm Insulated Copper Pipes with non-rated lagging, - Up to 2.5mm² 2C+E TPS Power Cable, - Up to 1.5mm² 2 Core Data Cable. Boss MaxiCollar fixed to both sides of the wall. Sealant in the annular gap 13 mm deep finished flush. Sealant also to be applied to the annular gap between the services and collar to the depth of the collar finished flush.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	HVAC	BOSS FireMastic-HPE™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		WF FAS 190335	
Substrate:	Concrete wall	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2193.4	
Min Substrate Thickness (mm):	90	80	-		Date:	20/01/25	Rev:	01
Sealant Depth (mm):	13	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.