
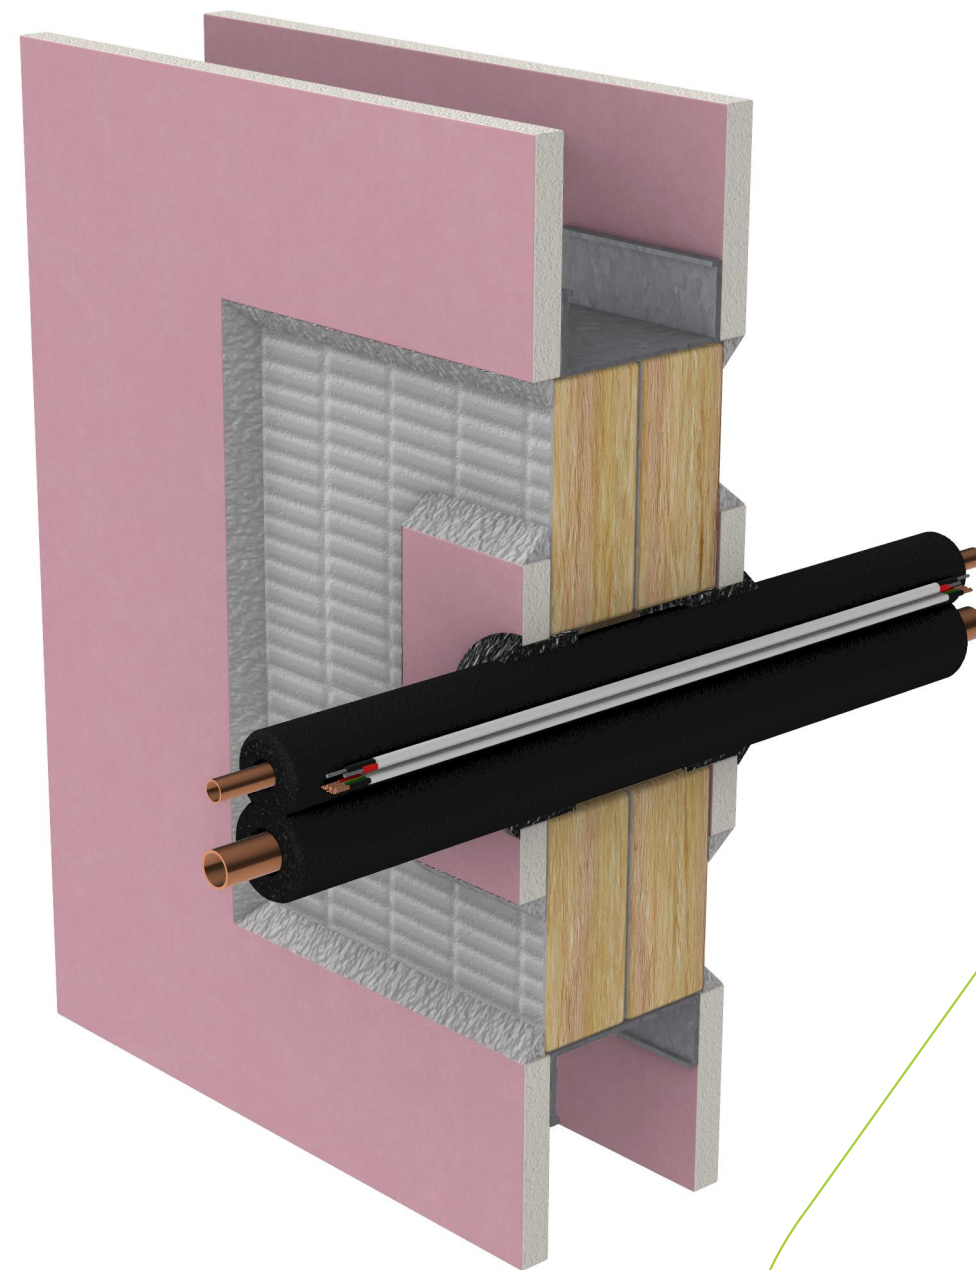


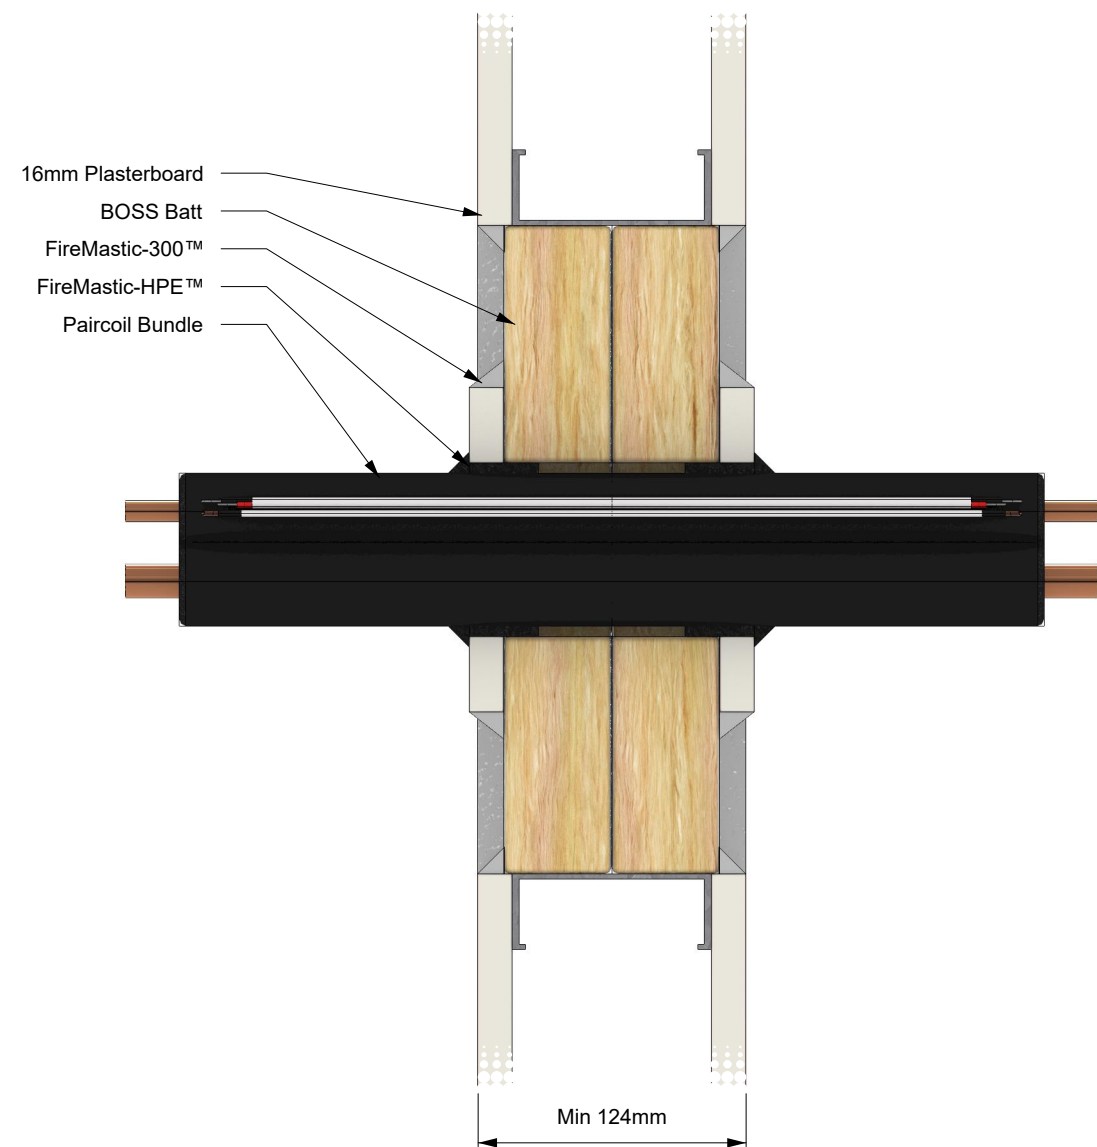

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	•Paircoil: - Up to 9.5 mm OD Copper Pipes with up to 35.5 mm OD lagging - Up to 15.8 mm OD Copper Pipes with up to 41.1 mm OD lagging. • Nexans Olex WK32 2015 V90 electric cables • Electra cables 2015 EAS7501P cable V-90 RoHS 16 mm plasterboard patch (patress) 150 mm x 150 mm placed over the penetration on both sides, fixed to the wall. The edges of the plasterboard build up coated with a 16 mm x 16 mm fillet of FM300. HPE sealant in the annular gap 26 mm deep with 10 mm x 10 mm fillet.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	HVAC	BOSS FireMastic-300™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		WF FAS 190335	
Substrate:	2 layers BOSS Batt - Friction fitted	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2194.13	
Min Substrate Thickness (mm):	124	80	-		Date:	20/01/25	Rev:	01
Sealant Depth (mm):	32	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	10							
Wrap Length (mm):	-							
FRL / FRR:	-/90/90							