


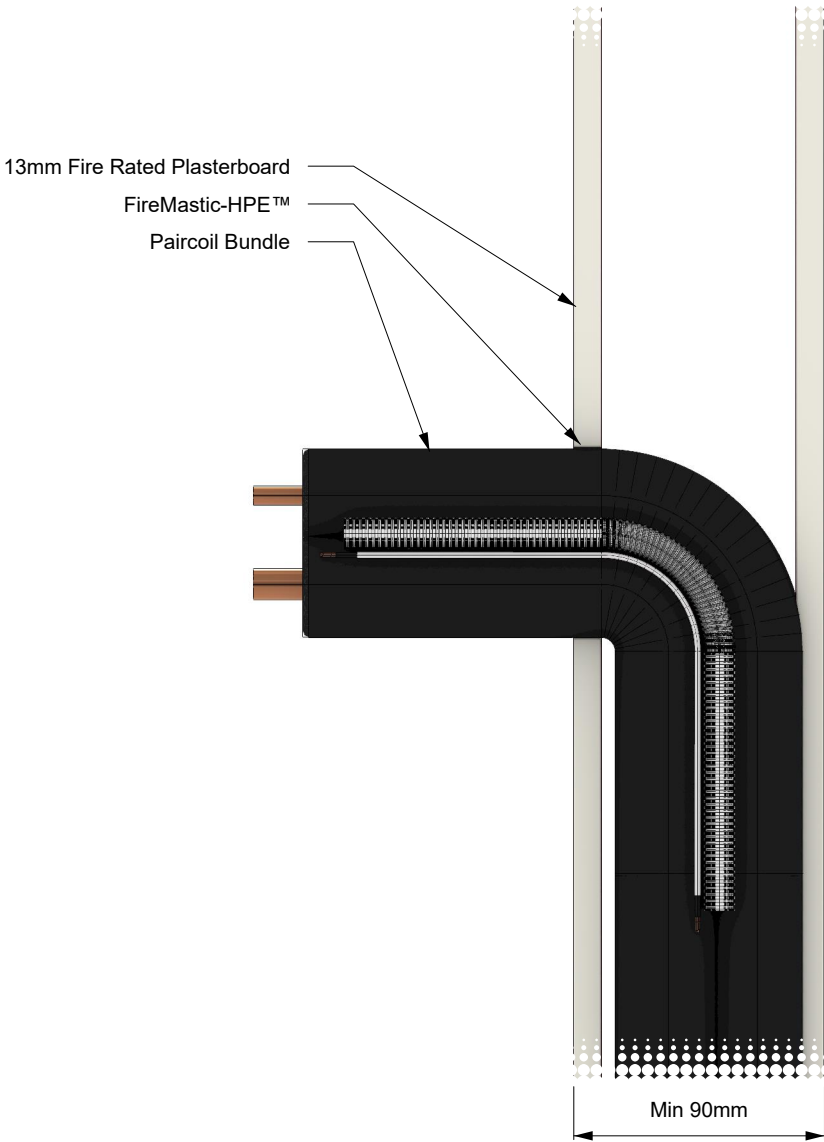

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	1-sided installation. System is approved for installation in both directions. - Paircoil - Up to 6.35 mm/9.52 mm Insulated Copper Pipes with non-rated lagging, - Up to 1.5 mm² 2C+E TPS Power Cable - Up to 16 mm diameter Polyaire top condition outlet pipe. 13 mm deep sealant in annular gap finished flush both sides, backed with a foam backing rod.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	HVAC	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		WF FAS 190335	
Substrate:	Single Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2196.1	
Min Substrate Thickness (mm):	90	80	-		Date:	20/01/25	Rev:	01
Sealant Depth (mm):	13	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							

IMPORTANT: This drawing is provided as a guide only and does not guarantee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.