
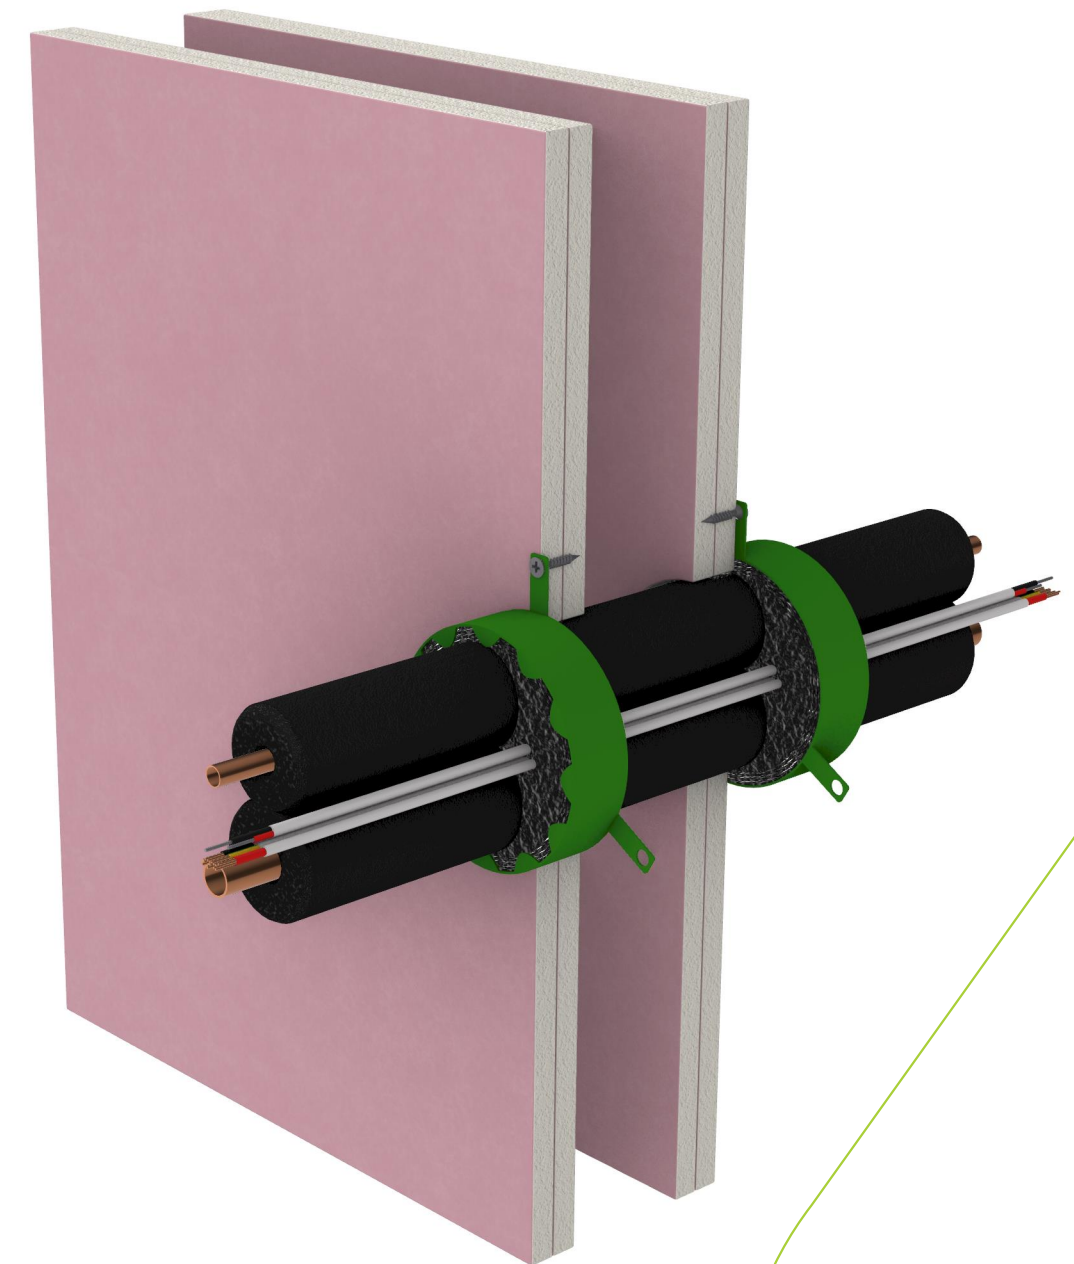


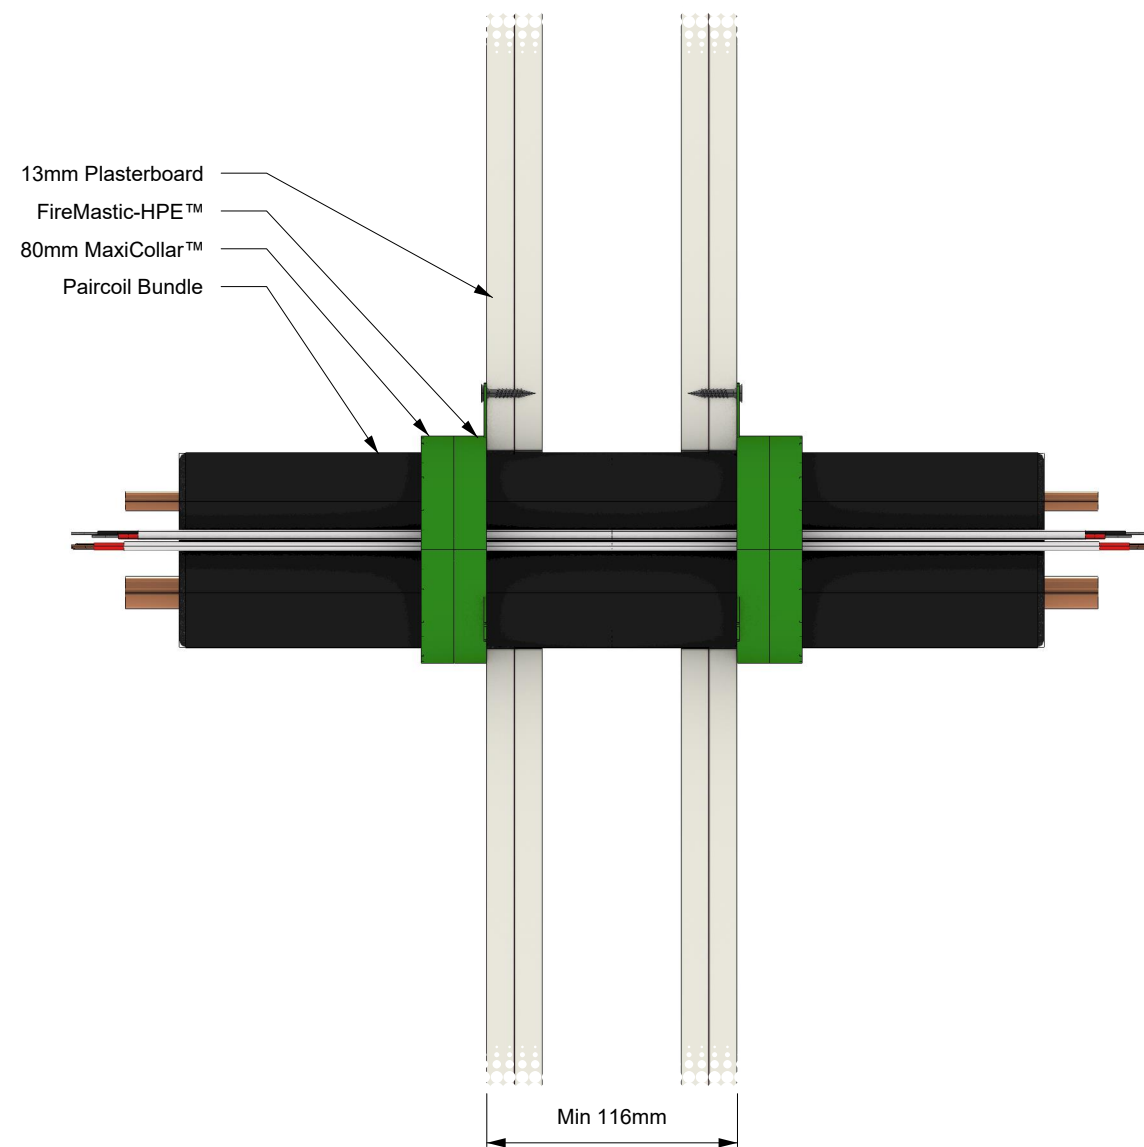

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS MaxiCollar™	-	- Paircoil - Up to 10 mm/15 mm Insulated Copper Pipes with non-rated lagging, - Up to 2.5 mm² 2C+E TPS Power Cable, - Up to 1.5 mm² 2 Core Data Cable. Boss MaxiCollar fixed to both sides of the wall. Sealant in the annular gap 13 mm deep finished flush. Sealant also to be applied to the annular gap between the services and collar to the depth of the collar finished flush both sides.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	HVAC	BOSS FireMastic-HPE™	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		WF FAS 190335	
Substrate:	Double Layer Fire Rated Plasterboard System	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2199.2	
Min Substrate Thickness (mm):	116	80	-		Date:	20/01/25	Rev:	01
Sealant Depth (mm):	13	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	0							
Wrap Length (mm):	-							
FRL / FRR:	-/60/60							