
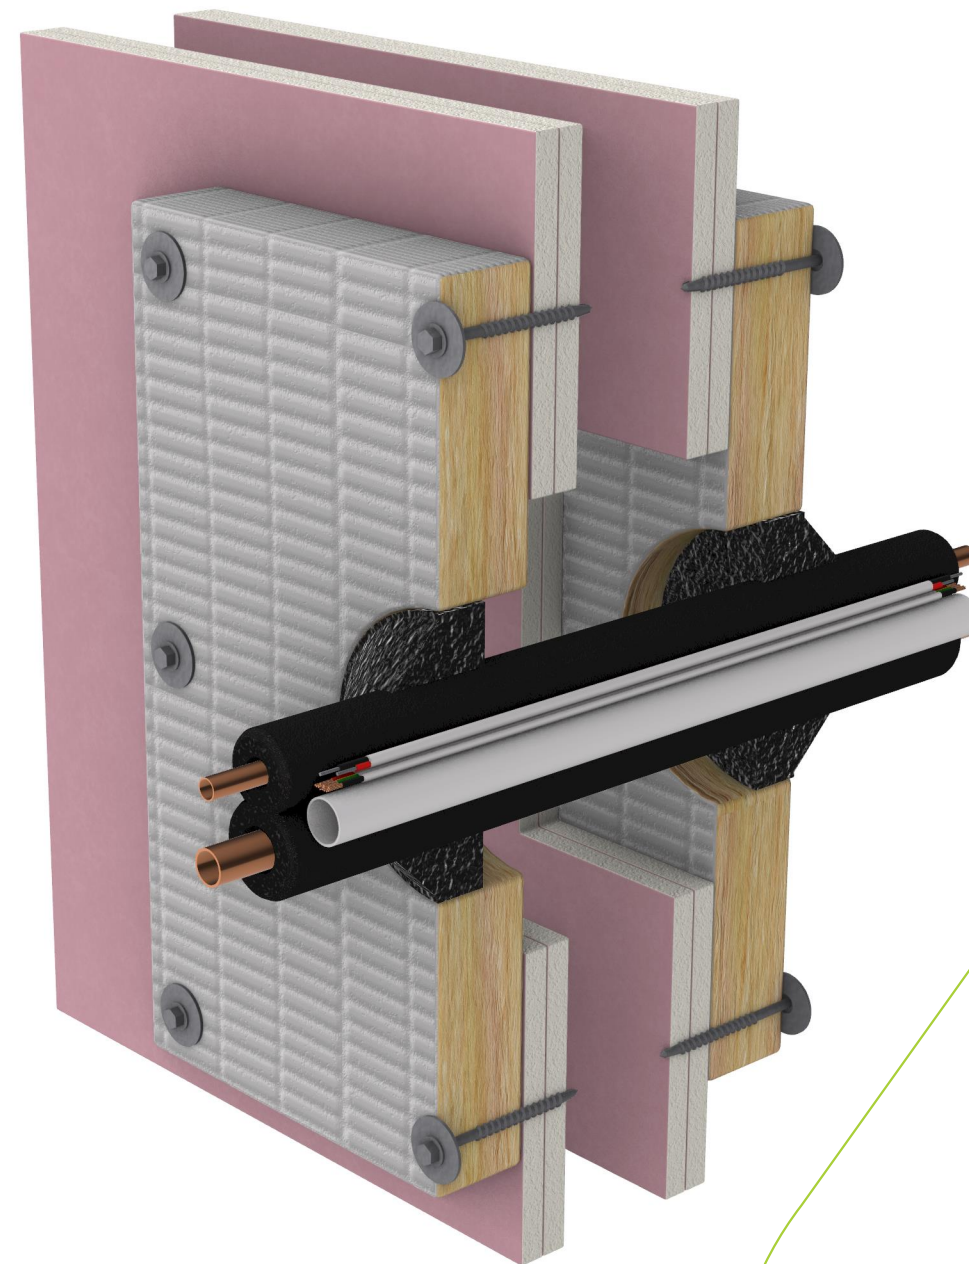


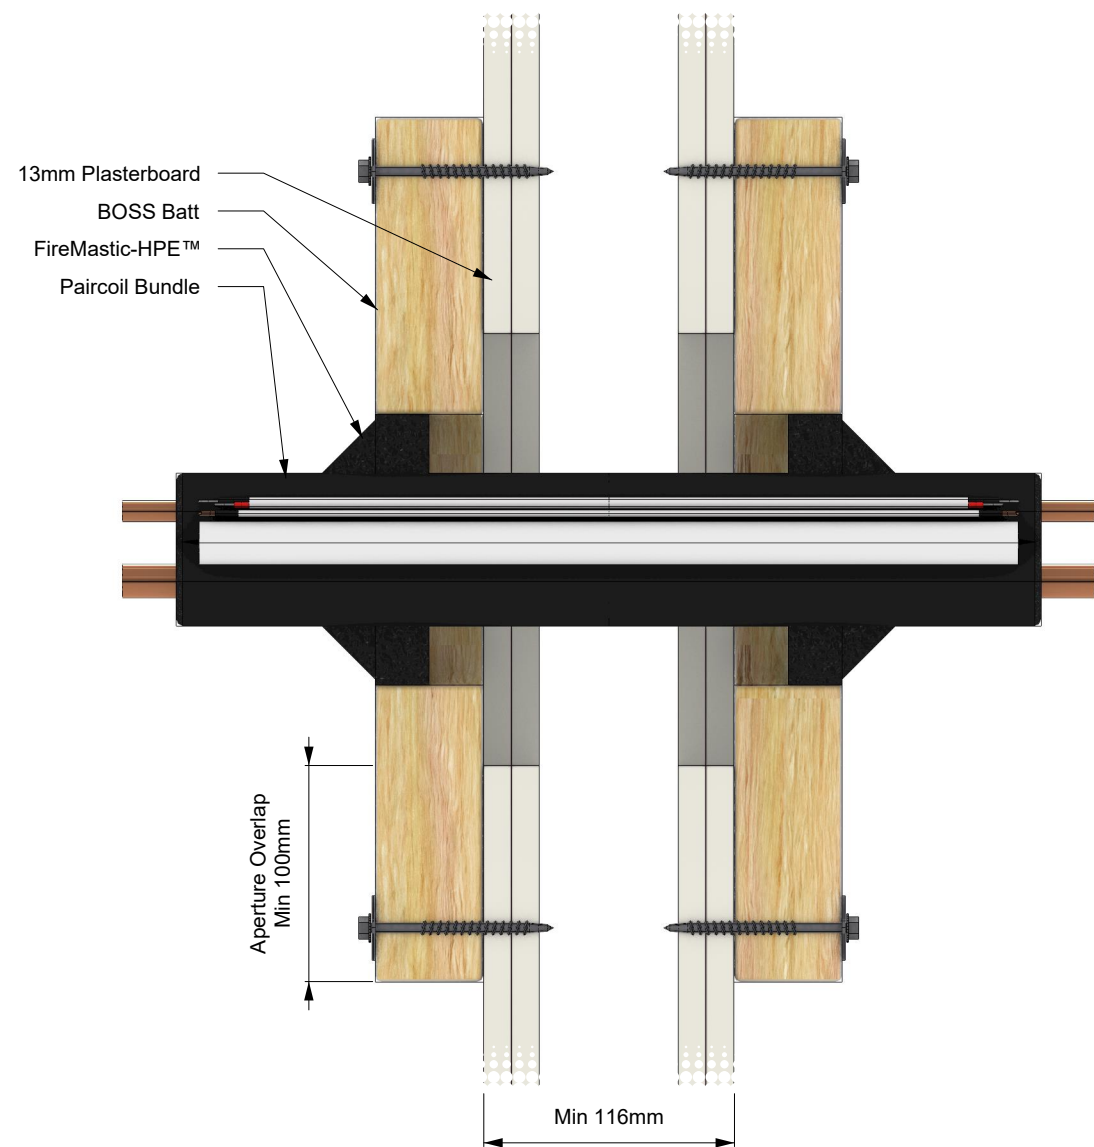

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION		SERVICE SIZE & DETAILS	SUPPORTING INFORMATION			
Orientation:	Wall	BOSS FireMastic-HPE™	-	- Paircoil - Up to 10 mm/16 mm Insulated Copper Pipes insulated with 13 mm thick rubber foam. - Up to 20 mm OD PVC conduit, - Up to 2.5 mm² 2C+E TPS Power Cable, - Up to 1.5 mm² 2 Core Data Cable. Sealant to a depth of 25 mm in annular gap with 25 mm x 25 mm fillet on both sides. Sealant backed with foam backing rod.	Reference Standard:		AS 1530.4:2014	
Trade / Type:	HVAC	-	-		Supplementary Standard:		AS 4072.1-2005	
Service:	-	-	-		Report Reference:		WF FAS 190335	
Substrate:	2 layers BOSS Batt - Pattress fitted either side	APERTURE (mm)	ANNULAR GAP (mm)		Drawing Number:		BF-2200.14	
Min Substrate Thickness (mm):	116	125	-		Date:	20/01/25	Rev:	01
Sealant Depth (mm):	25	ADDITIONAL INFORMATION						
Sealant Fillet (mm):	25	-						
Wrap Length (mm):	-							
FRL / FRR:	-/120/120							