
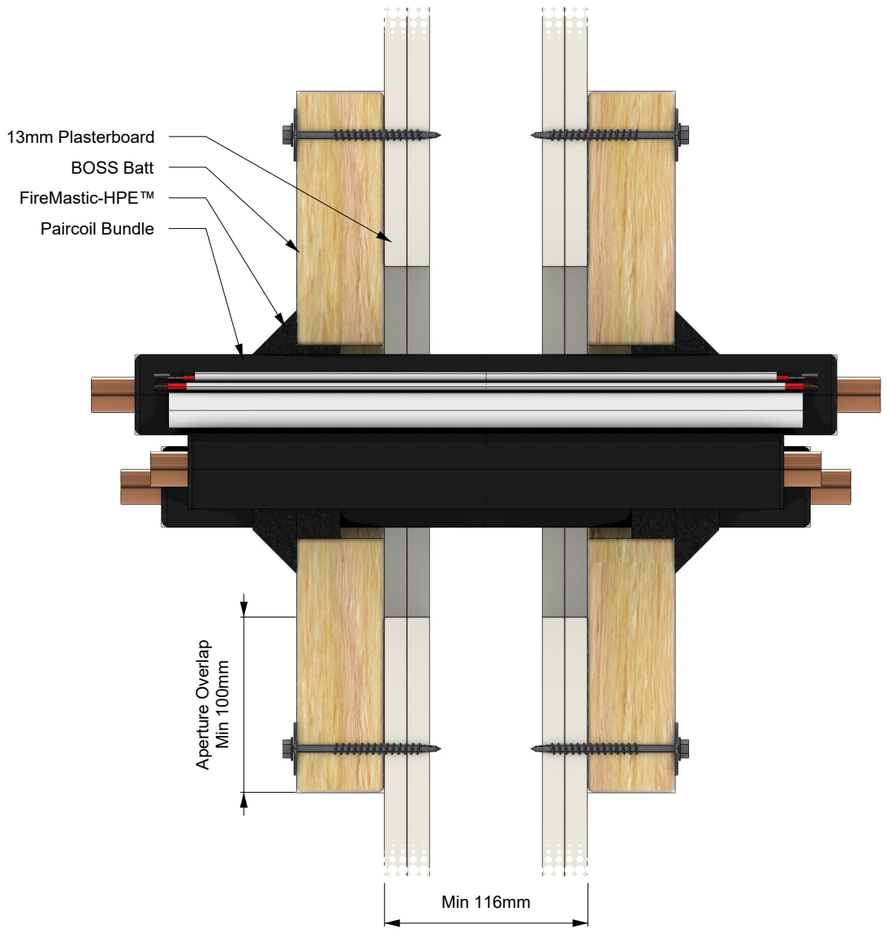


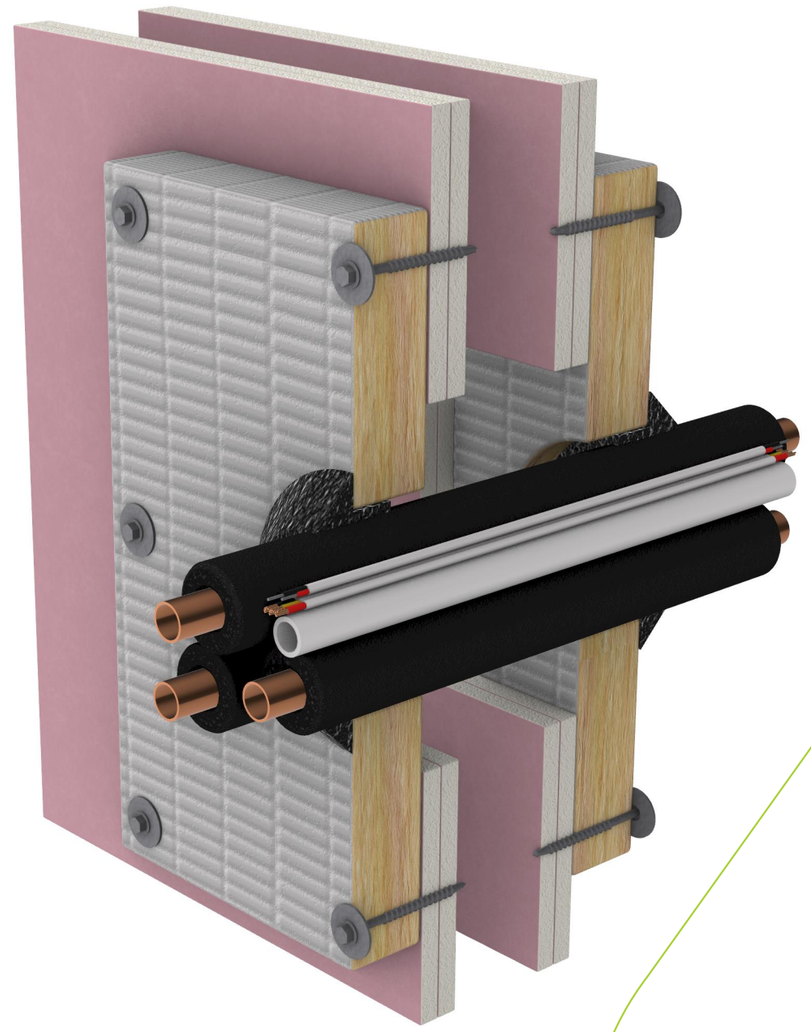

SYSTEM DESCRIPTION		FIRE STOPPING INFORMATION	
Orientation:	Wall	BOSS FireMastic-HPE™	-
Trade / Type:	HVAC	-	-
Service:	-	-	-
Substrate:	2 layers BOSS Batt - Pattress fitted either side	**APERTURE (mm)**	**ANNULAR GAP (mm)**
Min Substrate Thickness (mm):	116	Up to 125	-
Sealant Depth (mm):	25	**ADDITIONAL INFORMATION**	
Sealant Fillet (mm):	25	-	
Wrap Length (mm):	-		
FRL / FRR:	-/120/120		

SERVICE SIZE & DETAILS

- Up to 3 x 20 mm Copper Pipes insulated with Armaflex foamed nitrile rubber wrap
- TPS cable
-Data cable
- Up to 20 mm PVC conduit.
Sealant to a depth of 25 mm in annular gap with 25 mm x 25 mm fillet on both sides. Sealant backed with foam backing rod. .

SUPPORTING INFORMATION			
Reference Standard:	AS 1530.4:2014		
Supplementary Standard:	AS 4072.1-2005		
Report Reference:	WF FAS 190335		
Drawing Number:	BF-2202.14		
Date:	20/01/25	**Rev:**	01

IMPORTANT: This drawing is provided as a guide only and does not guarentee compliance for every application. Confirm that the supporting certification is applicable to your specific construction details and obtain acceptance from the relevant Certifying Authority before installation. BOSS Passive Fire reserves the right to amend this document without notice.